



## Noise Assessment

### Delmore Residential Development, Wainui, Delmore

#### Vineway Limited

Level 8, 55-56 Shortland Street  
Auckland 1011

Prepared by:

**SLR Consulting New Zealand**

SLR Project No.: 880.016699

11 February 2025

Revision: 2.0

## Revision Record

Revision	Date	Prepared By	Checked By	Authorised By
2.0	11 February 2025			

## Basis of Report

This report has been prepared by SLR Consulting New Zealand (SLR) with all reasonable skill, care and diligence, and taking account of the timescale and resources allocated to it by agreement with Vineway Limited (the Client). Information reported herein is based on the interpretation of data collected, which has been accepted in good faith as being accurate and valid.

This report is for the exclusive use of the Client. No warranties or guarantees are expressed or should be inferred by any third parties. This report may not be relied upon by other parties without written consent from SLR.

SLR disclaims any responsibility to the Client and others in respect of any matters outside the agreed scope of the work.



## Table of Contents

<b>Basis of Report .....</b>	<b>i</b>
<b>Acronyms and Abbreviations .....</b>	<b>iv</b>
<b>1.0 Introduction .....</b>	<b>1</b>
<b>2.0 Project Description and Site Location .....</b>	<b>1</b>
<b>3.0 Performance Standards .....</b>	<b>6</b>
3.1 Construction Noise .....	6
3.2 Construction Vibration .....	7
3.3 Operational Noise.....	7
3.4 Operational Vibration.....	8
<b>4.0 Construction Noise Assessment.....</b>	<b>8</b>
4.1 Expected Construction Noise Levels (without mitigation).....	10
4.2 Construction Noise Mitigation and Management .....	10
4.3 Construction Noise Effects .....	12
<b>5.0 Construction Vibration Assessment and Mitigation .....</b>	<b>12</b>
5.1 Piling .....	12
5.2 Rock Breaking.....	12
5.3 Compaction .....	13
<b>6.0 Operational Noise and Vibration Assessment .....</b>	<b>13</b>
6.1 Operational Noise.....	13
6.2 Operational Vibration.....	16
<b>7.0 Conditions .....</b>	<b>16</b>
<b>8.0 Conclusion.....</b>	<b>17</b>

## Tables

Table 1	Receivers .....	5
Table 2	Permitted Activity Construction Noise Limits for Activities Sensitive to Noise.....	6
Table 3	Construction Noise Limits for All Other Activities Not Sensitive to Noise.....	6
Table 4	Construction Vibration Human Amenity Limits .....	7
Table 5	Applicable Operational Noise Limits (Standard E25.6.3 and E25.6.15).....	7
Table 6	Applicable Operational Noise Limits (Standard E25.6.2).....	8
Table 7	Vibration levels for stationery machinery.....	8
Table 8	Mobile Plant Items and Typical Noise Emission Levels.....	9



## Figures

Figure 1	Propose Site Plan – Overall.....	2
Figure 2	Propose Site Plan – Stage 1.....	3
Figure 3	Propose Site Plan – Stage 2.....	3
Figure 4	AUP Zoning (both main project stages shown together) .....	4
Figure 5	Relevant Receivers.....	5
Figure 6	Temporary noise barrier - Example 1.....	11
Figure 7	Temporary noise barrier – Example 2.....	11
Figure 8	WWTP location.....	14
Figure 9	WWTP layout.....	15



## Acronyms and Abbreviations

<b>A' weighted</b>	A frequency adjustment which represents how humans hear sounds.
<b>AUP</b>	Auckland Unitary Plan Operative in part.
<b>dB</b>	Decibel
<b>dBA</b>	'A' weighted decibel
<b>Hz</b>	Hertz
<b>Impulsive noise</b>	Noise with a high peak of short duration, or sequence of peaks.
<b>Intermittent noise</b>	Noise which varies in level with the change in level being clearly audible.
<b>LAeq</b>	The 'A' weighted equivalent noise level. It is defined as the steady sound level that contains the same amount of acoustical energy as the corresponding time-varying sound.
<b>L<sub>Amax</sub></b>	The A' weighted maximum sound pressure level of an event.
<b>LP or SPL</b>	Sound Pressure Level.
<b>L<sub>w</sub> or SWL</b>	Sound Power Level.
<b>NZS 6801:2008</b>	New Zealand Standard NZS 6801:2008 "Measurement of Environmental Sound".
<b>NZS 6802:2008</b>	New Zealand Standard NZS 6802:2008 "Assessment of Environmental Noise."
<b>NZS 6803:1999</b>	New Zealand Standard NZS 6803:1999 "Acoustics – Construction Noise."
<b>Octave-band</b>	A frequency band where the highest frequency is twice the lowest frequency.
<b>Special Audible Characteristic</b>	Noise containing a prominent tonality or impulsive character.



## 1.0 Introduction

The Delmore Residential Development proposal (the project) comprises construction of approximately 1,250 residential dwellings in Wainui (Upper Ōrewa), Delmore. The project would be undertaken in two stages, with each stage being separated into sub-stages.

SLR has been commissioned to undertake an assessment of acoustic effects associated with aspects of the project.

The assessment evaluated compliance with the relevant noise and vibration limits and identified any necessary mitigation measures to achieve compliance with the requirements of Auckland Unitary Plan (AUP).

The assessment was based on information contained in the following project documents:

- Draft Coordination drawing set, Stage 1, prepared by Terra Studio.
- Draft Coordination drawing set, Stage 2, prepared by Terra Studio.
- Coordination drawing set, Site – Proposed (Sheet A-S-1-03), prepared by Terra Studio.
- WWTP drawing set titled *Delmore On Site WWTP, Provisional Layout Issued to Acoustic Consultant*, dated 10 December 2024.

## 2.0 Project Description and Site Location

The assessment comprised consideration of the following activities for both stages of the project:

- Construction noise and vibration emission associated with the civil site works.
- Operational noise and vibration emission from the proposed new wastewater treatment plant (WWTP), located within Stage 1.


The nearest proposed residential lot is more than 350 m from State Highway 1 (SH1), therefore noise impacts from SH1 at the proposal has not been considered further.

The site location and stage layouts are shown in **Figure 1**, **Figure 2**, and **Figure 3**.






**Figure 1 Propose Site Plan – Overall**

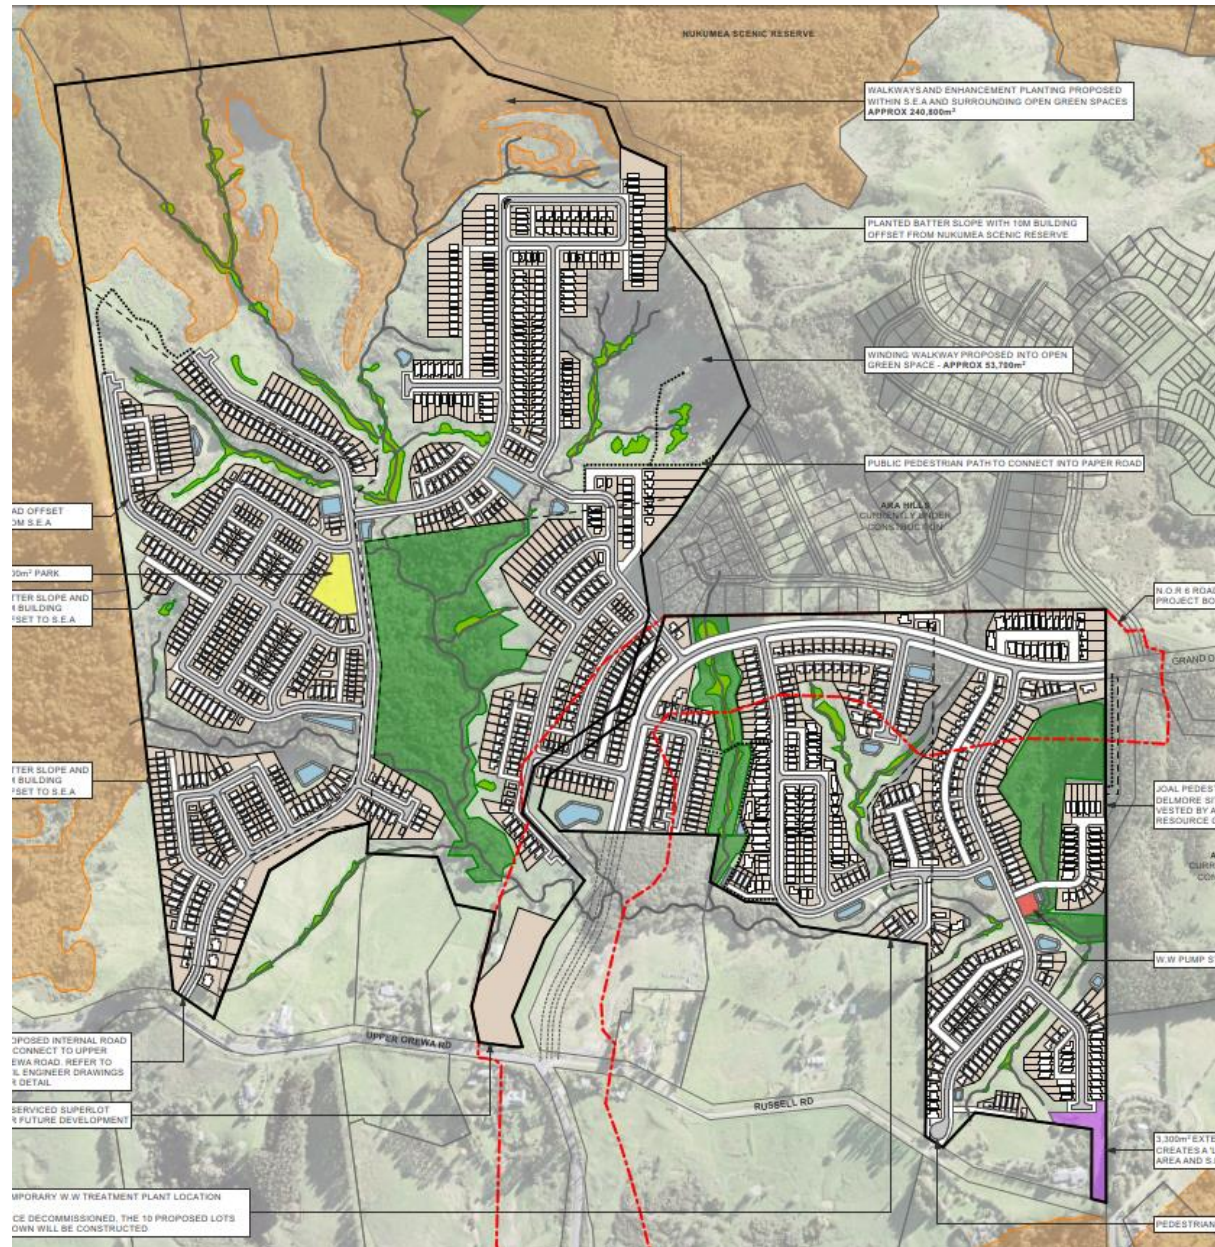




**Figure 2 Propose Site Plan – Stage 1**

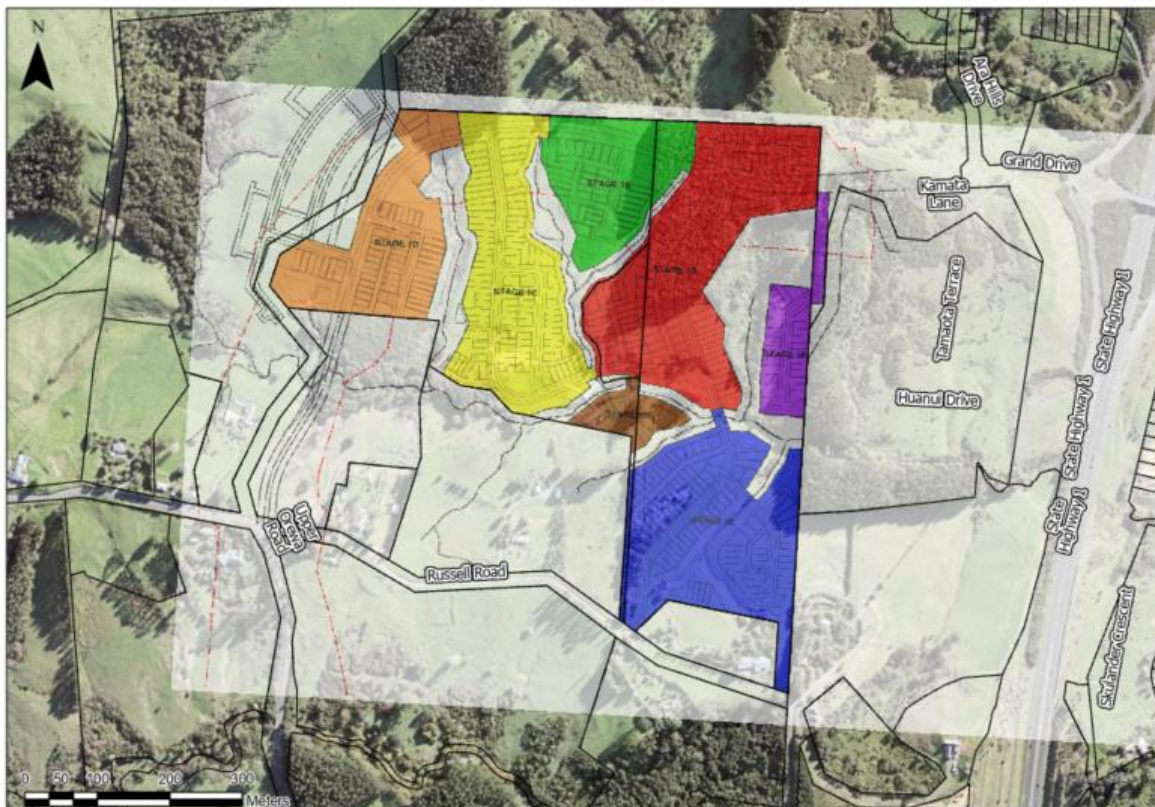


**Figure 3 Propose Site Plan – Stage 2**

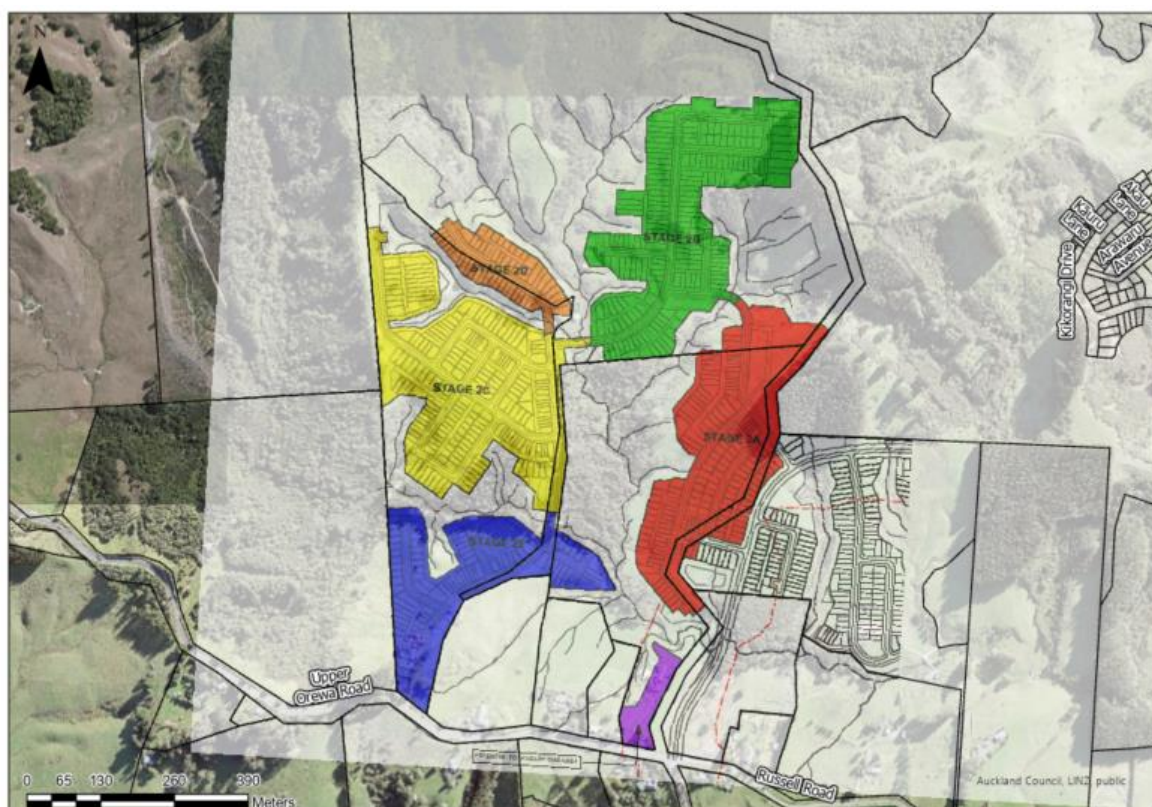



The surrounding receivers are on land currently zoned Future Urban and Rural Production in the AUP, with a small area zoned Open Space Conservation to the north, as shown in **Figure 4**. It is understood that the site and the surrounding area will be re-zoned in the future to become Residential – Mixed Housing Suburban Zone, and the assessment has considered the future zoning where relevant.


**Figure 4 AUP Zoning (both main project stages shown together)**

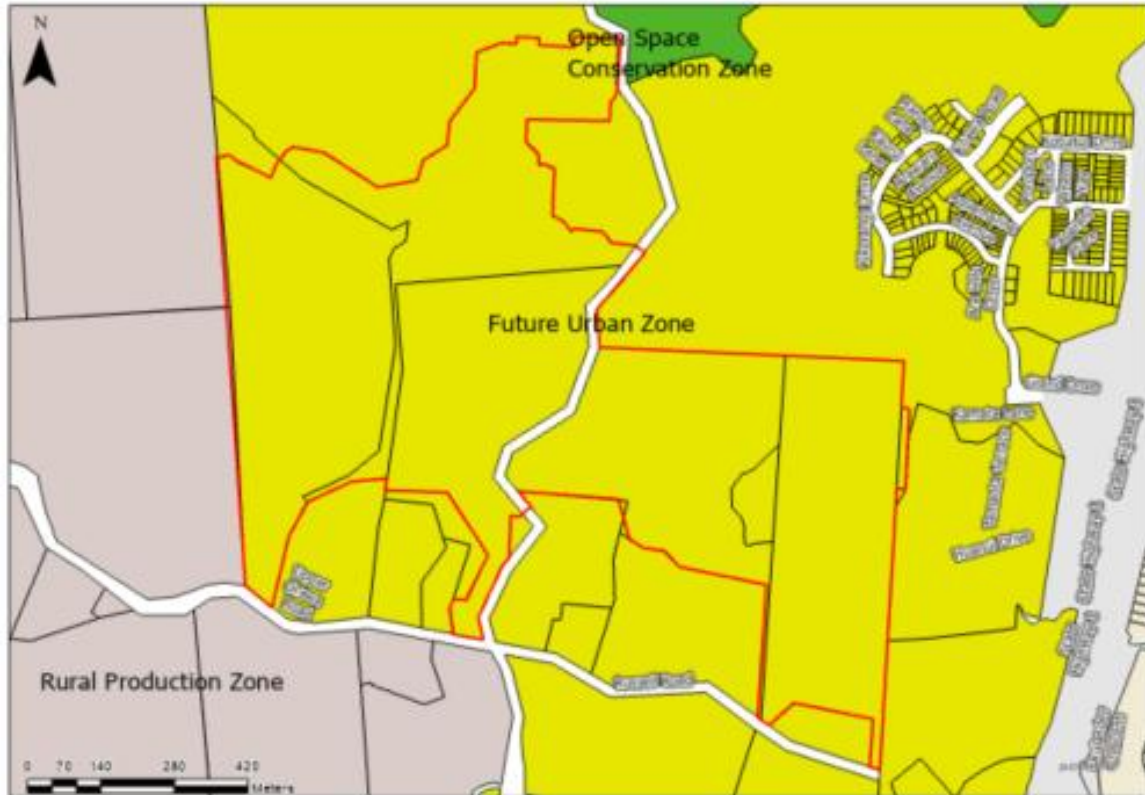

The surrounding properties which are relevant in terms of the assessed noise emission are all located toward the southern end of the project site, as shown in **Figure 5**. The receiver addresses are listed in **Table 1**.



**Figure 5 Relevant Receivers**

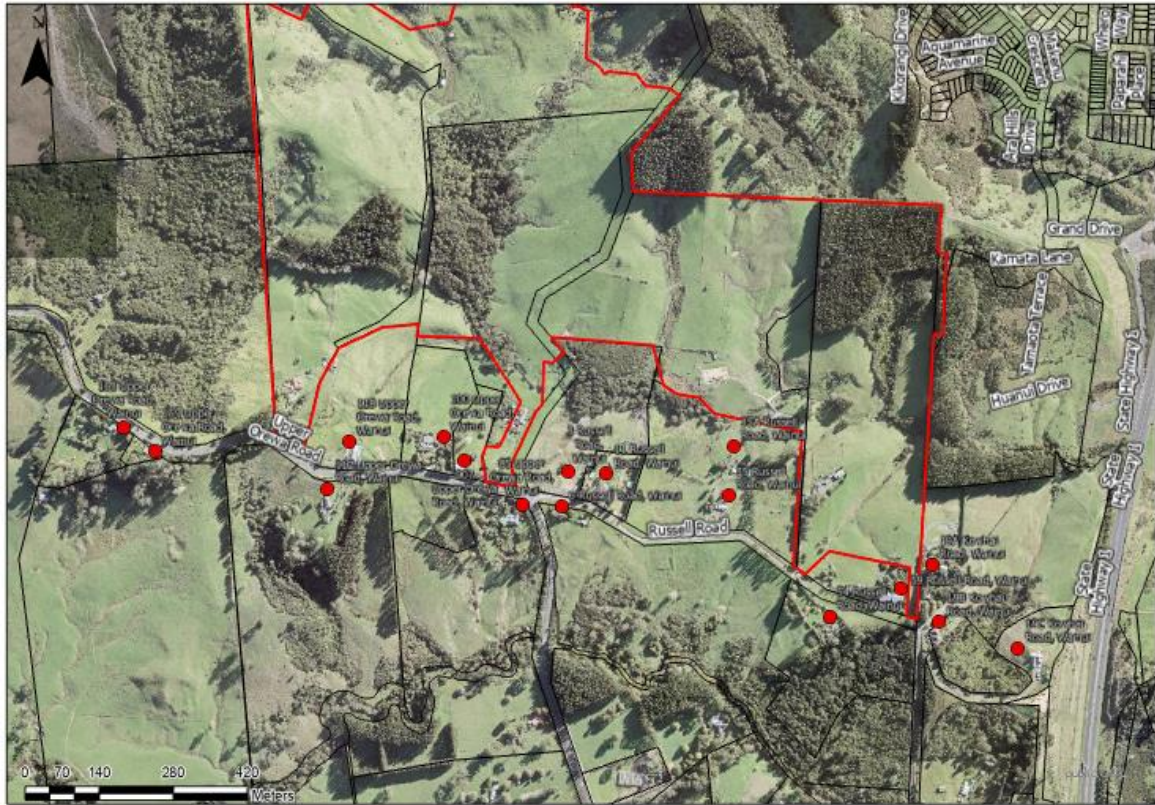

**Table 1 Receivers**

Receiver Address
3 Russell Road, Wainui
6 Russell Road, Wainui
11 Russell Road, Wainui
19A Kowhai Road, Wainui
19B Kowhai Road, Wainui
19C Kowhai Road, Wainui
35 Russell Road, Wainui
35A Russell Road, Wainui
54 Russell Road, Wainui
59 Russell Road, Wainui
85 Upper Ōrewa Road, Wainui
90 Upper Ōrewa Road, Wainui
100 Upper Ōrewa Road, Wainui
117 Upper Ōrewa Road, Wainui
118 Upper Ōrewa Road, Wainui
159 Upper Ōrewa Road, Wainui
163 Upper Ōrewa Road, Wainui



## 3.0 Performance Standards

### 3.1 Construction Noise

The expected total construction duration for the proposed development is expected to exceed 20 weeks. Standard E25.6.27 of the AUP states that in order to be a permitted activity, noise from construction activities for more than 20 weeks in the relevant zones must not exceed the limits in **Table 2** (for activities sensitive to noise in all zones) and **Table 3** (for any other activity).

The limits apply 1m from the facade of any building occupied during the works that contains an activity sensitive to noise. The AUP defines 'activities sensitive to noise' as:

*"...Any dwelling, visitor accommodation, boarding house, marae, papakāinga, integrated residential development, retirement village, supported residential care, care centres, lecture theatres in tertiary education facilities, classrooms in education facilities and healthcare facilities with an overnight stay facility..."*

**Table 2 Permitted Activity Construction Noise Limits for Activities Sensitive to Noise**

Day of Week	Time Period	Noise Limit, dBA	
		LAeq	Maximum LAmax
Weekdays	6:30 am - 7:30 am	55	70
	7:30 am - 6:00 pm	70	85
	6:00 pm – 8:00 pm	65	80
	8:00 pm – 6:30 am	40	70
Saturdays	6:30 am – 7:30 am	40	70
	7:30 am - 6:00 pm	70	85
	6:00 pm – 8:00 pm	40	70
	8:00 pm – 6:30 am	40	70
Sundays and Public Holidays	6:30 am – 7:30 am	40	70
	7:30 am - 6:00 pm	50	80
	6:00 pm – 8:00 pm	40	70
	8:00 pm – 6:30 am	40	70

**Table 3 Construction Noise Limits for All Other Activities Not Sensitive to Noise**

Time Period	Maximum noise levels LAeq, dB
7:30 am – 6:00 pm	70
6:00 pm – 7:30 am	75

AUP Objective E25.2 (4) provides that “construction activities that cannot meet noise and vibration standards are enabled while controlling duration, frequency and timing to manage adverse effects”.

In general accordance with the guidance in NZS 6803: 1999 *Acoustics – Construction noise* and the objectives of the AUP, it is common in Auckland to permit higher noise limits during short-term high noise generating activities provided these are subject to implementation of



the best practicable options (BPO) to control effects of those activities. This is due to the limited duration of such effects and the limited available options to mitigate associated noise effects from necessary construction activities.

### 3.2 Construction Vibration

AUP Standard E25.6.30 states that to be a permitted activity, construction activities must be controlled to ensure resulting vibration does not exceed:

- the limits set out in German Industrial Standard DIN 4150-3 (1999): Structural vibration – Part 3 Effects of vibration on structures when measured in accordance with that Standard on any structure not on the same site; and
- the limits in **Table 4** (as transcribed from Table 1 of E25.6.30) in any axis when measured in the corner of the floor of the storey of interest for multi-storey buildings, or within 500 mm of ground level at the foundation of a single storey building.

**Table 4 Construction Vibration Human Amenity Limits**

Receiver	Period	Peak Particle Velocity Limit <sup>1</sup>
Occupied building containing activity sensitive to noise <sup>2</sup>	Night-time 10:00 pm to 7:00 am	0.3 mm/s
	Daytime 7:00 am to 10:00 pm	2.0 mm/s
Other occupied buildings	At all times	2.0 mm/s

- In any axis direction.
- As defined in the AUP.

### 3.3 Operational Noise

The following AUP standards relating to the operational noise emissions (noise generated onsite and received offsite) apply to the proposal according to the current zoning scheme:

- Standard E25.6.3 “Noise levels in rural and future urban zones”
- Standard E25.6.15 “Rural – Mixed Rural Zone, Rural – Rural Production Zone, Rural – Rural Coastal Zone or Future Urban Zone interface”

Both these standards provide noise limits for the reasonable protection of amenity at dwellings in rural areas. The reference noise limits, and time periods are similar, with the only difference being the location where the limits apply, being:

- at the notional boundary of occupied dwellings on Rural zoned land, and
- at or within the boundary of any residential zoned property.

The relevant noise limits are summarised in **Table 5**.

**Table 5 Applicable Operational Noise Limits (Standard E25.6.3 and E25.6.15)**

Time Period	Noise Level
Monday to Saturday (7:00am to 10:00pm)	55 dB LAeq
Sunday (9:00am to 6:00pm)	
All other times	45 dB LAeq 75 dB LAFmax





It is understood that the site and the surrounding area will be re-zoned in the future to become Residential – Mixed Housing Suburban Zone. The noise limits associated with the future zoning are more stringent than under the existing zone rules, as shown in **Table 6**.

**Table 6 Applicable Operational Noise Limits (Standard E25.6.2)**

Time Period	Noise Level
Monday to Saturday (7:00am to 10:00pm)	50 dB LAeq
Sunday (9:00am to 6:00pm)	
All other times	40 dB LAeq 75 dB LAFmax

### 3.4 Operational Vibration

The AUP prescribes levels for vibration from permanently installed rotating machinery when measured in any occupied unit under different ownership from the source of the vibration. The levels from AUP Section E25.6.30 in Table E25.6.3 would be applicable for vibration emission from the WWTP and are reproduced in **Table 7**.

**Table 7 Vibration levels for stationery machinery**

Affected occupied building or area	Time of day	Maximum RMS vibration velocity 8 to 80 Hz (mm/s)
Noise sensitive spaces	7:00 am to 10:00 pm	0.2
Bedrooms and sleeping areas only within activities sensitive to noise	10:00 pm to 7:00 am	0.14

## 4.0 Construction Noise Assessment

The typical expected hours for construction activity are between 7:30 am to 6:00 pm Monday to Saturday. Outside of these hours, including on Sundays and public holidays, it is understood that site activity would only include low noise generating activity such as tool-box talks, site layout and planning, light vehicle movements, and administration based activities.

The highest levels of construction noise tend to be associated with the operation of large machinery associated with excavation (including rock breaking), piling and compaction works. The activity is expected to comprise a range of equipment used across the extent of the entire site which is marked in red in **Figure 4**.

There could also be assessable noise related to temporary dewatering equipment and laydown areas.

A summary of typical equipment and reference noise levels has been provided in **Table 8**. The noise levels are based on in-house measurements and published data taken from BS 5228 - 1:2009 *Code of practice for noise and vibration control on construction and open sites – Part 1; Noise*.

The noted setback distances to compliance have been calculated in accordance with the methodology in NZS 6803:1999 and include facade corrections.



**Table 8 Mobile Plant Items and Typical Noise Emission Levels**

Activity	Plant Item/s	Plant Noise Level at 10 m, dB LAeq	Approximate setback distance to compliance <sup>1</sup> (without mitigation), metres	Approximate setback distance to compliance (with mitigation) <sup>2</sup> , metres
Earthworks	Dozer, scraper, excavator, dump truck working in a group in the same area.	88	110	40
Rock breaking	Excavator with rock hammer attachment (includes acoustic shroud).	83	60	30
Demolition	Excavator (≤20 ton) with bucket or processor attachment.	75	25	10
Piling for retaining walls in Stage 1 <sup>3</sup>	Excavator (≤20 tons) fitted with piling attachment.	79	40	20
Compaction <sup>4</sup>	Vibratory Compaction Roller (10-15t)	80	45	15

Notes on **Table 8**:

- (1) AUP compliance level is 70 dB LAeq, during the daytime (7:30am to 6:00pm).
- (2) Based on acoustically effective screening between the noise source and receiver.
- (3) Piling for retaining walls only anticipated for Stage 1, based on the current design information.
- (4) Setback distance with mitigation is based on six movements (passing by an individual receiver) within 15-minutes as the plant is expected to be moving across the site and not idling/stationary at one location.

While most noise emission from the equipment in **Table 8** is reasonably steady state, there could be instantaneous maximum noise events that cause levels in the order of 10 to 15 dB higher than those presented. The noise limit for these transient noise events is 85 dB L<sub>Amax</sub>. We expect that compliance with the LAeq based noise limits would also result in compliance with the L<sub>Amax</sub> based limit.

Relatively stationary plant items such as dewatering equipment and activity associated with laydown areas can be effectively managed by siting these activities away from the adjacent receivers and locally screening if required. This strategy should be included in the project detailed construction planning stage, as noise associated with these sources are likely to occur outside of standard daytime hours and the noise limits are much lower outside of standard daytime hours.

Indicative buffer distance to achieve compliance with the night-time construction noise limit are listed below, these would be reviewed and updated as the specific plant is known:

- Dewatering plant – 500 m without noise mitigation, 150 m with noise mitigation.
- Laydown area activity - 800 m without noise mitigation, 250 m with noise mitigation.



## 4.1 Expected Construction Noise Levels (without mitigation)

The assessment has shown that construction of the project (without noise mitigation) can achieve the noise limits at most receivers, with the following exceptions:

- 19A Kowhai Road – 4 dB exceedance during Stage 1E earthworks only.
- 59 Russell Road – 14 dB exceedance during Stage 1E earthworks only.
- 90 Upper Ōrewa Road – 8 dB exceedance during Stage 2F earthworks only.

Recommendations for management and mitigation of noise to achieve compliance with the limits are given in **Section 4.2**.

Noise from other construction related activities (such as road truck and light vehicle movements, and construction of water treatment facilities) would be quieter than those assessed and are not expected to contribute such that it would cause elevated cumulative noise levels. For most of the construction period, noise levels are expected to be lower than the AUP permitted noise limit.

## 4.2 Construction Noise Mitigation and Management

Noise mitigation and management would be required for the following receivers:

- 19A Kowhai Road – during Stage 1E earthworks only.
- 59 Russell Road – during Stage 1E earthworks only.
- 90 Upper Ōrewa Road – during Stage 2F earthworks only.

It is most common for the mitigation and management measures to be included in a Construction Noise and Vibration Management Plan (CNVMP). A CNVMP sets out the procedures for the contractor to manage and mitigate construction noise and vibration effects and adopt the best practicable options. To ensure the appropriate level of mitigation is implemented it is recommended that the requirement for a CNVMP is included as a condition of consent.

Options for managing the effects of construction noise at the receivers could include the use of temporary noise barriers, selecting quiet plant and equipment, or scheduling of activity to times most suitable for the receivers. The best practicable options can be determined during preparation of the CNVMP when there is typically more detail available regarding the detailed project design.

The use of temporary noise barriers would be expected to reduce the level of activity noise to compliant levels. The noise barriers should be located parallel to the common site boundaries and be of sufficient height to more than just block the line of sight between the activity and the receiving building facade.

An effective noise barrier can provide approximately 10 dB of noise reduction and should be maintained throughout the relevant activity period, being relocated as required to provide effective screening.

For information, an image of a temporary noise barriers used to control construction noise is shown in **Figure 6** and **Figure 7**.

With noise barriers in place, compliance with the noise limits would be expected at all properties bar one. A potential marginal exceedance of up to 5 dB is predicted at 59 Russell Road during Stage 1E earthworks only. All of the Stage 1E earthworks are expected to be completed in one week, with only a limited portion of that time involving works close to 59 Russell Road.





**Figure 6 Temporary noise barrier - Example 1**



**Figure 7 Temporary noise barrier – Example 2**



The panels should be constructed from materials with a surface mass of at least  $7 \text{ kg/m}^2$  and be at least 1.8 m high. The noise barrier panels should be abutted or overlapped to provide a continuous screen without gaps at the bottom or sides of the panels. The barriers should extend sufficiently on either side of the activity area to more than break the line of sight between the noise source and the receiving buildings.





Suitable materials include plywood (e.g., 17mm thick) or proprietary noise barrier panels hung from mesh fencing such as the following types:

- Duraflex Noise Control Barrier - Performance Series
- Soundex Acoustic Curtain - Performance Series

Alternatives should be approved by a suitably qualified acoustic specialist because some proprietary noise curtains may have insufficient surface mass for general use.

For the receiver at 59 Russell Road, we recommend consulting with the occupant prior to commencing the work to investigate options for timing the activity closest to the receiver to limit the effect of noise from the construction activity.

### 4.3 Construction Noise Effects

Conventional residential buildings (façade elements like weatherboard and standard glazing) can typically reduce external noise levels by 20 - 25 dB.

At most surrounding properties, other than 59 Russell Road, external noise levels would be at or below the AUP limit – being below the limit for the majority of the time. Internal noise would be less than 50 dB  $L_{Aeq}$  during the noisiest works and would be audible within the building if quiet activities are occurring.

Internal noise levels in rooms within 59 Russell Road facing the works may reach approximately 50 dB  $L_{Aeq}$  during the noisiest works. At these levels, concentration may be affected but residential and office activities can generally continue. Sound levels for television, radio, and phone conversations would need to be slightly raised. These levels would be expected for a duration of less than one week.

On this basis, if the above noise control measures are adopted the noise effects would be reasonable.

## 5.0 Construction Vibration Assessment and Mitigation

It is worth noting that the principal concern of receivers regarding vibration relates to the potential damage to their property, rather than impact on their amenity – noting that a certain level of amenity impact is expected and common during construction (as is the case with noise). Such effects are commonly accepted with prior advice, e.g., via letter drop, to make occupants aware ahead of the works beginning.

### 5.1 Piling

Piling is expected to be undertaken at locations in Stage 1 during the construction of retaining walls. The nearest piling location to a receiver is understood to be approximately 120 metres from the dwelling at 35 Russell Road. At that separation distance the level of piling vibration received at the dwelling would be expected to comply with the AUP requirements by some margin. As such, no specific management or mitigation of piling vibration is recommended.

### 5.2 Rock Breaking

At the time of writing the specific locations of rock breaking are not known, this section therefore provides guidance around managing effects should rock breaking be required close to dwellings.

Vibration from an excavator using a 900 kg rock hammer can be in the order of 2 to 3 mm/s on the foundation of a structure (building) located ten metres from the activity. The closest



parts of 59 Russell Road (dwelling) and 90 Upper Ōrewa Road (domestic car garage) have buildings within 10 metres of the project site boundary. Therefore, compliance with the AUP amenity requirements (being no higher than 5 mm/s for up to 3 days) would be expected so long as any rock breaking within 10 m of these structures takes no more than 3 days to complete. This is understood to be achievable based on discussions with the project team. The avoidance of cosmetic damage limits (being higher than the amenity limits) are expected to be met at all properties.

Vibration from rock breaking can be managed to comply by ensuring that appropriately sized equipment is used if rock breaking needs to be undertaken within 10 metres of adjacent receiving structures. This can be confirmed through vibration monitoring of the activity at locations separated from receivers a technique which has been successfully implemented on multiple sites across Auckland. The procedure for this would be set out in the CNVMP.

All other potentially occupied buildings are set back more than 15 metres from potential rock breaking activity and compliance with the AUP requirements would be expected at these locations.

### 5.3 Compaction

Vibration from a 10 tonne vibratory roller could be in the order of 2 to 3 mm/s on the foundation of a structure (building) located ten metres from the activity. These levels should be considered indicative only due to the potential difference in machinery, ground conditions and other variable factors. The closest receiving building (the domestic car garage at 90 Upper Ōrewa Road) is located close to the project site boundary and vibratory compaction activity could potentially cause non-compliance with the AUP requirements for cosmetic damage. This could be mitigated to compliance by using a static rolling or plate compactor methodology if compaction is required close to 90 Upper Ōrewa Road.

It is recommended that the applicant undertake vibration monitoring at the adjacent structures at the initial stages of compaction, if vibratory compaction needs to be undertaken within five metres of adjacent receiving structures. Alternatively, investigate options for compaction using non-vibratory methods for that part of the site, if required.


## 6.0 Operational Noise and Vibration Assessment

### 6.1 Operational Noise


Stage 1 will include installation of a wastewater treatment plant (WWTP). The indicative location and orientation of the WWTP within Stage 1G is shown in **Figure 8** and the WWTP layout is shown in **Figure 9**.




**Figure 8 WWTP location**

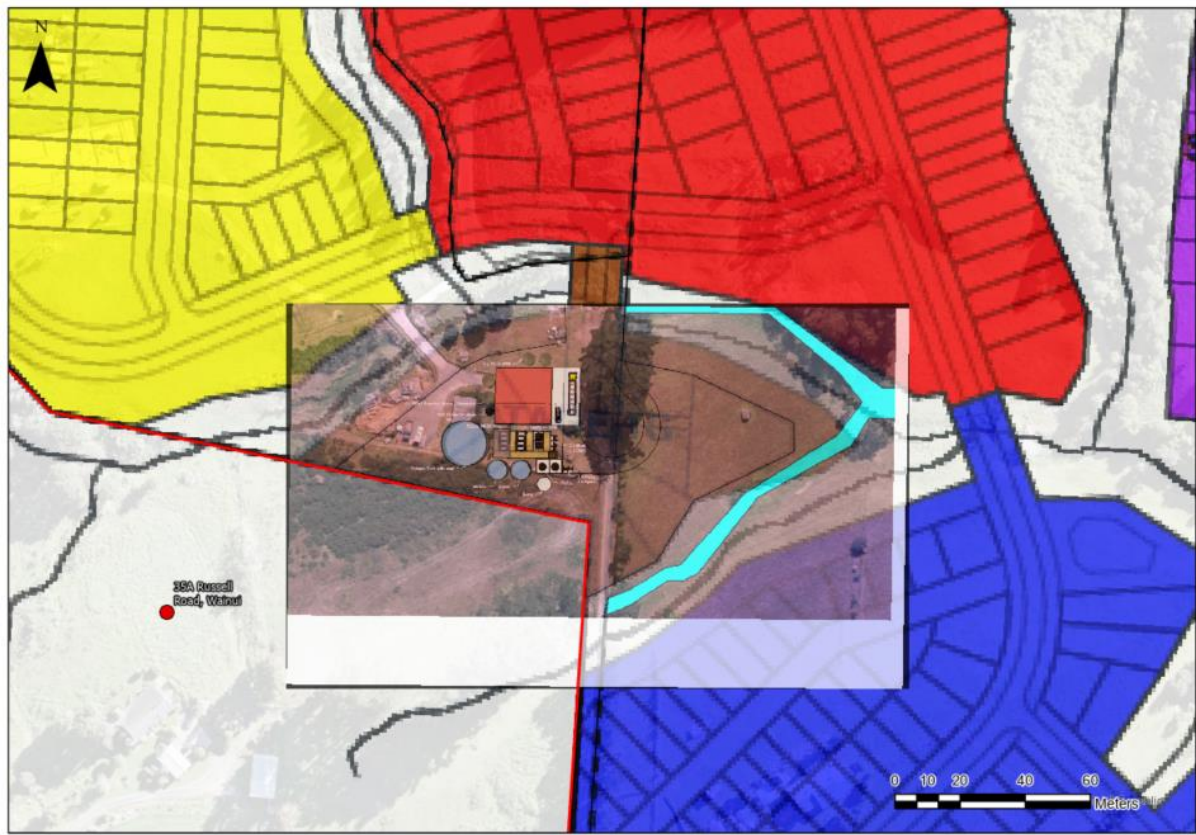

**Figure 9 WWTP layout**

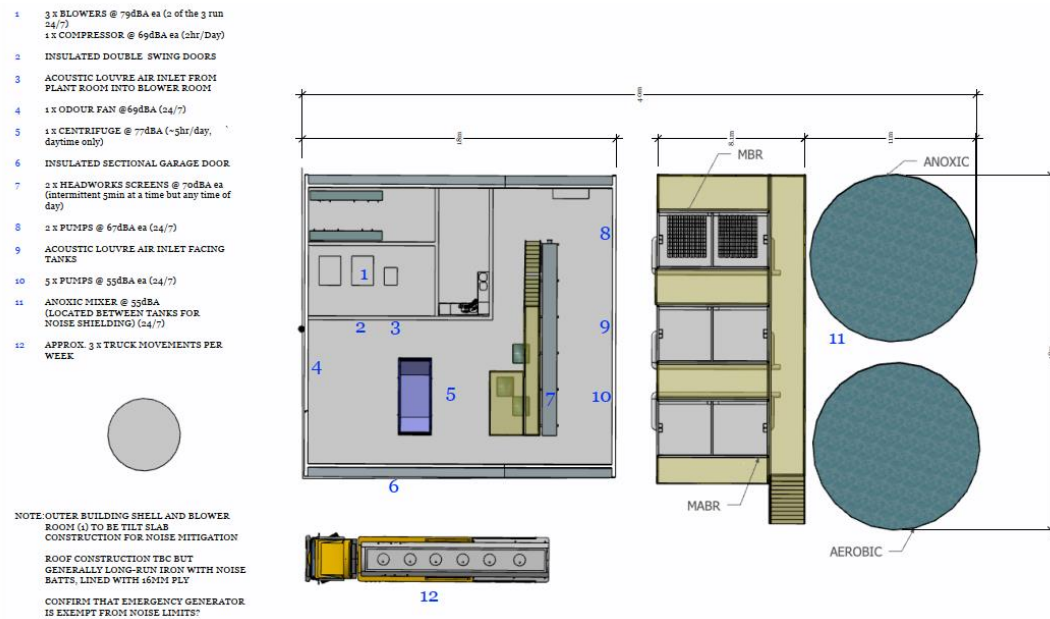

PRELIMINARY PLANT LAYOUT LOCATION OF SIGNIFICANT NOISE SOURCES	 Delmore On Site WWTP	REVISIONS		01
		NO. / DATE	REMARKS	
		1 / 10 / 24	PROVISIONAL LAYOUT ISSUED TO ACOUSTIC ENGINEERS	
		2 /		
		3 /		
		4 /		

The WWTP will operate 24 hours per day, seven days per week. As such, the most stringent noise limit (based on the assumed future zoning) for WWTP operational noise would be 40 dB LAeq and 75 dB LAFmax.

The design of the WWTP building facade comprises pre-cast concrete walls, acoustic louvred openings and a plywood lined metal deck roof.

Based on the indicative noise source emission levels provided by the project team the combined sound power level for the sources housed inside the building is expected to be approximately 95 dBA SWL, with a single noise source outside the building at 60-65 dBA SWL. A 5 dB adjustment for special audible characteristics (SAC) has been included in the below assessment and advice to provide a conservative assessment of effects.

Based on a conservative combined building facade reduction of 15 dB (accounting for the louvre opening), compliance with the future zone AUP noise limit (40 dB LAeq) would be expected at the nearest residential site boundaries within the surrounding Stages (1A, 1C, 1C, 1F) and at the notional boundary of the nearest existing receiver at 35A Russell Road. To meet the future Residential zone noise limit at or within the legal boundary of 35A Russell Road may require orienting openings in the building away from the boundary and/or installing acoustically effective screening on the common boundary. The details of whether this is required and what form the mitigation would take would need to be defined during the detailed design of the WWTP when more detail of the equipment and WWTP building design is known.

It is understood that the WWTP capacity may need to be increased at some stage in the future, beyond the design which has been assessed in this report. It is anticipated that any future upgrades to the WWTP, such as to increase treatment capacity if the need arises, can be designed and constructed to maintain compliance with the noise limits through careful





plant selection and standard mitigation measures. Further, given the noise emission from the WWTP would be reasonably steady-state, compliance with the  $L_{Aeq}$  based noise limit would be expected to also result in compliance with the  $L_{Amax}$  based noise limit.

The WWTP would be serviced by three truck movements per week which are anticipated to take place during daytime hours. The noise from the truck activity at the WWTP is expected to comply with the most stringent daytime noise limit of 50 dB  $L_{Aeq}$  at the relevant receiver locations.

## 6.2 Operational Vibration

The WWTP will be located in a stand-alone building which will not be structurally connected to any adjacent noise sensitive spaces. The WWTP building which houses the majority of the rotating machinery would be located approximately 25 metres from the nearest receiving site boundary, according to the assumed future zoning, and approximately 55 metres from the nearest proposed residential site within Stage 1A. As such, vibration from the WWTP is expected to comply with the AUP requirements without specific vibration mitigation and the effect of vibration would be reasonable.

## 7.0 Conditions

The following conditions are recommended to provide suitable control of construction noise and vibration levels.

1. The consent holder shall prepare and implement a Construction Noise and Vibration Management Plan (CNVMP) with reference to Annex E of *NZS 6803:1999 Acoustics – Construction noise*. The CNVMP shall include as a minimum:
  - a. Applicable site noise and vibration criteria (limits);
  - b. Programme of works and hours of operation;
  - c. Identification of surrounding noise and/or vibration sensitive receivers;
  - d. Details of the specific management and mitigation measures required to comply with the relevant noise and vibration criteria;
  - e. The requirement to provide written communication to occupants of all immediately neighbouring buildings prior to the commencement of activities on site. The written advice shall set out:
    - a brief overview of the construction works;
    - the working hours and expected duration;
    - all mitigation measures to be implemented;
    - the procedure for recording concerns/complaints regarding noise and vibration;
    - the procedure for noise and vibration monitoring where concerns are raised by receivers; and
    - contact details for site personnel for any concerns regarding noise and vibration.
2. Noise arising from construction activity on-site shall not exceed the following limits when measured or assessed at any building on any other site that is occupied during the works, where affected party approval has not been obtained.

### 59 Russell Road

75 dB  $L_{Aeq}$  during earthworks.



Noise limits in Standard E25.6.27 at all other times

### **All other properties**

Noise limits in Standard E25.6.27 at all times.

3. If vibration levels from construction activity exceeding 2 mm/s are predicted or measured in the corner of the floor of the storey of interest for multi-storey buildings (if applicable), or within 500 mm of ground level at the foundation of a single storey building, the consent holder must consult with the relevant occupants to:
  - a) Discuss the nature of the work and the anticipated days and hours when the exceedances are likely to occur;
  - b) Determine whether the exceedances could be timed or managed to reduce the effects on the receiver; and
  - c) Provide in writing, no less than three days before to the work begins, details of the location and duration of the works, a phone number for complaints and the name of the site manager.

## **8.0 Conclusion**

SLR has been commissioned to undertake an assessment of noise and vibration effects associated with the Delmore Residential Development proposal (the project) which comprises construction of approximately 1,250 residential dwellings in Wainui (Upper Ōrewa), Delmore. The project would be undertaken in two stages, with each stage being separated into sub-stages.

The assessment comprised consideration of the following for both stages of the project:

- Construction noise and vibration emission associated with the civil site works.
- Operational noise and vibration emission from the proposed wastewater treatment plant (WWTP), located within Stage 1G.


The findings of the assessment can be summarised as follows:

1. Noise mitigation measures to control noise levels generated by construction works have been recommended for three receivers during earthworks planned in the adjacent areas only.
2. With mitigation measures in place, including acoustic screening, Standard E25.6.27 of the AUP (long-term construction noise limits) may be temporarily exceeded by 5 dB at one receiver only during works in the proximity, being 59 Russell Road. The effects of this infringement can be described as reasonable as the duration of infringement is less than one week. Further, concentration may be affected but residential and office activities can generally continue at the resultant internal noise levels during the infringement.
3. It is expected that construction vibration can be managed to comply with Standard E25.6.30(1) relating to construction vibration, using vibration monitoring or alternative compaction methods. Vibration monitoring has been recommended if vibration intensive construction activity (rock breaking) is required to be undertaken at locations close to receivers.
4. Operation of the WWTP can comply with the with the AUP requirements prescribed within E25.6.2, E25.6.3, E25.6.15 and E25.6.30. Future upgrades to the WWTP, such as to increase capacity, can be designed to maintain compliance.



5. Overall, with the recommended mitigation and design measures in place the anticipated noise and vibration effects from the project are expected to be reasonable.



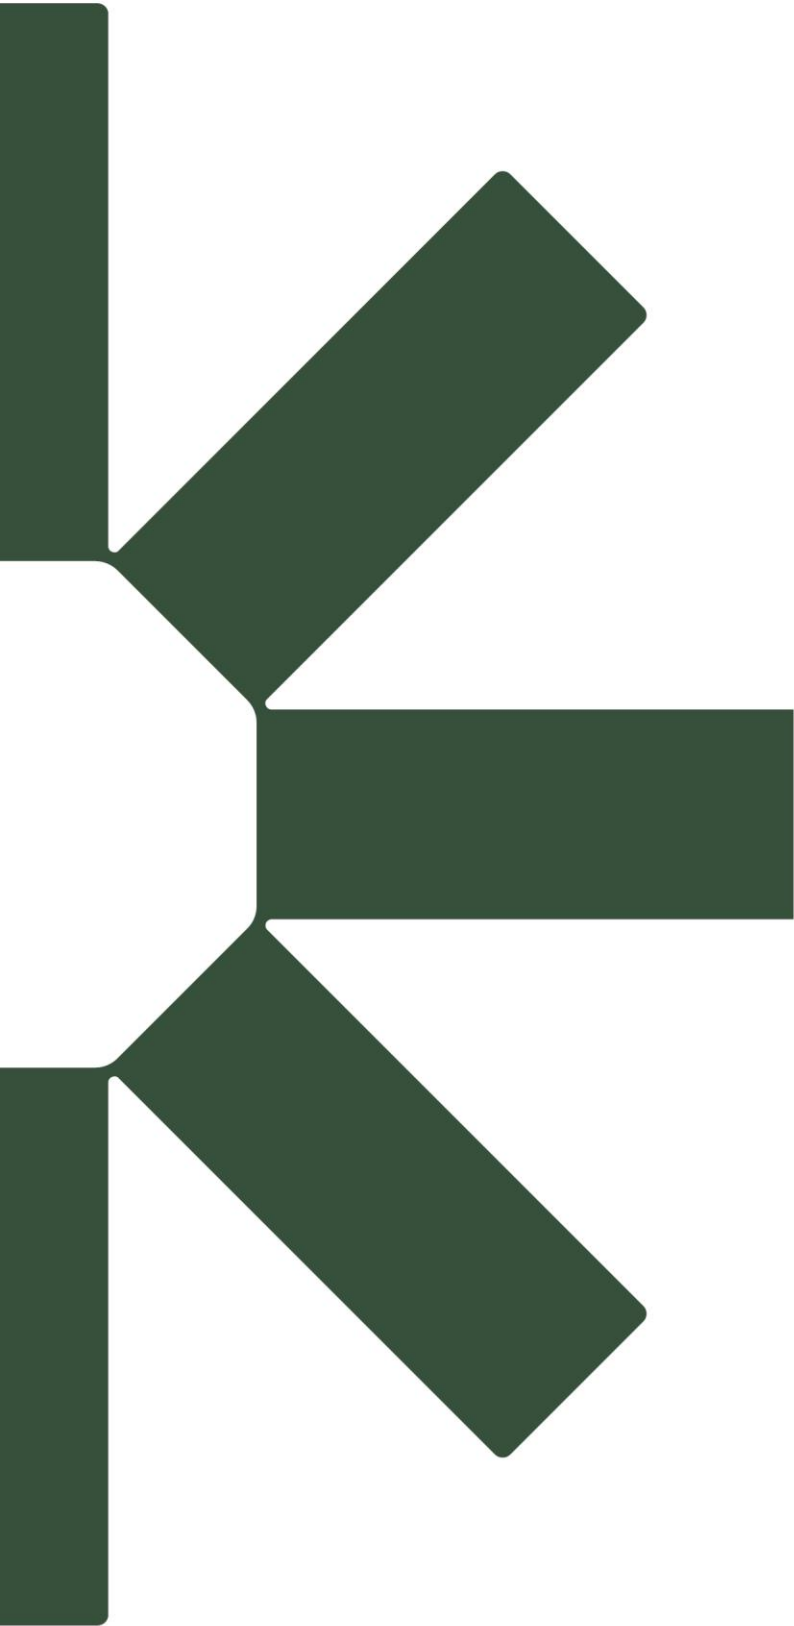

Making Sustainability Happen