



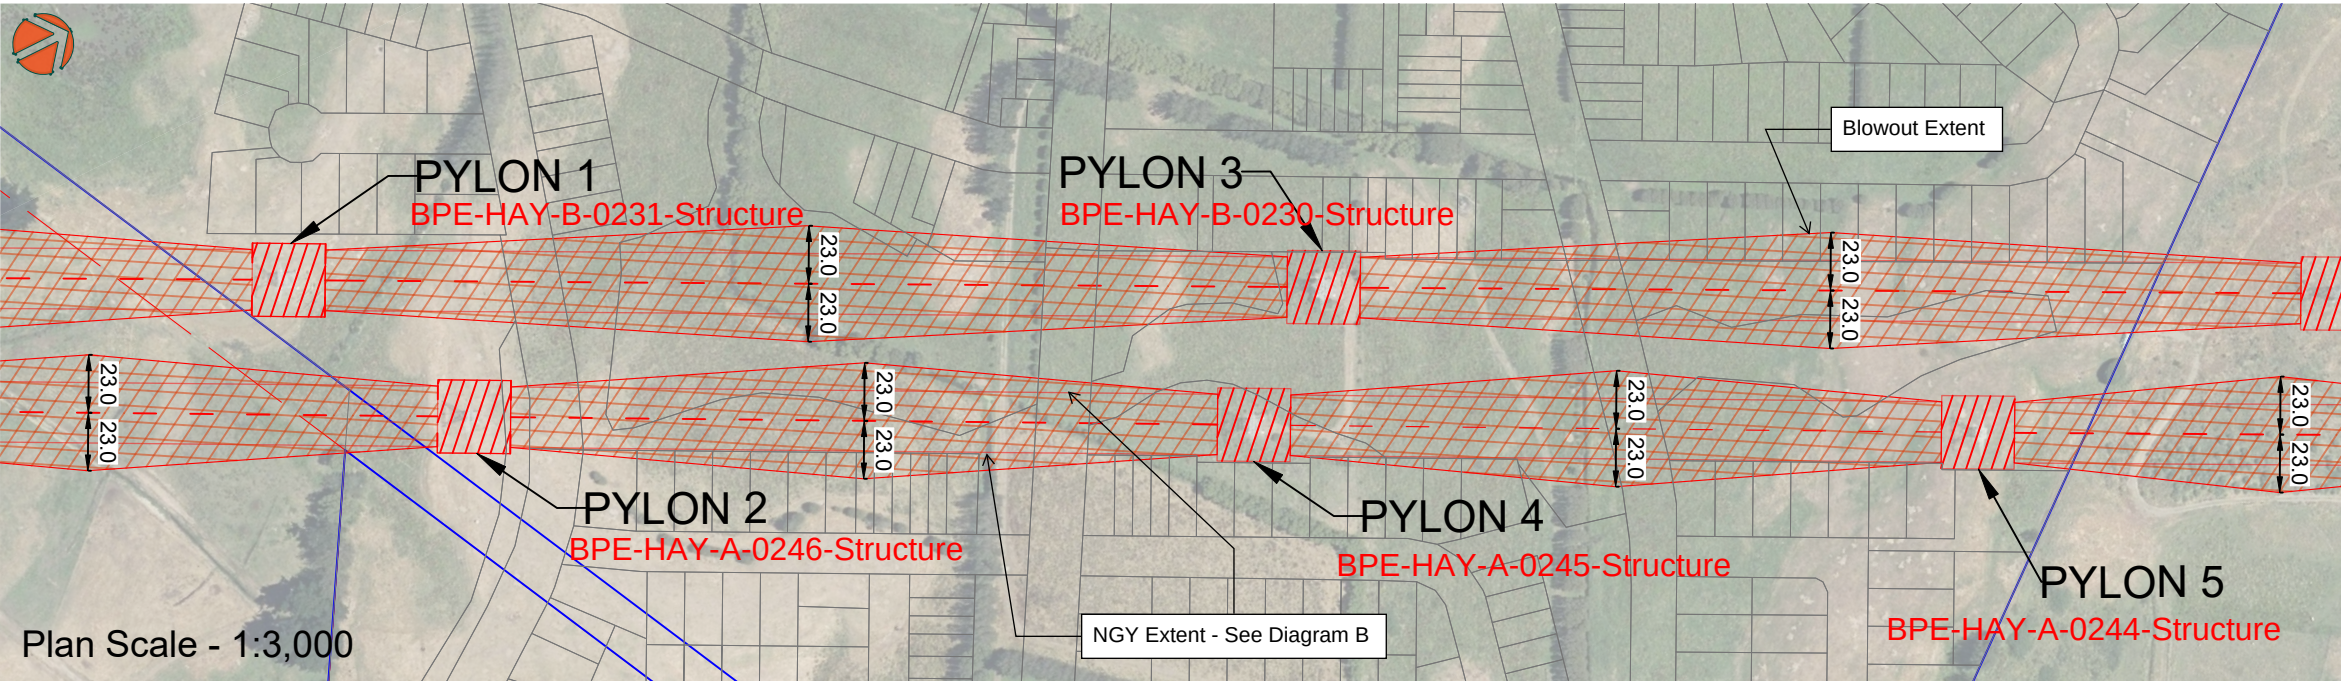


**NOTES**

1. Plan is in terms of NZGD2000 (Whanganui Circuit) and NZVD2016
2. Areas and dimensions are subject to cadastral survey.
3. Grids are 10m horizontal & 0.5m Vertical increments
4. Pylon locations are indicative only.

**DIAGRAM B:**  
Tower and corridor offset distances  
National Grid Yards National Policy Statement on Electricity Transmission 2008 (NPSET)


PYLON 3 N-S

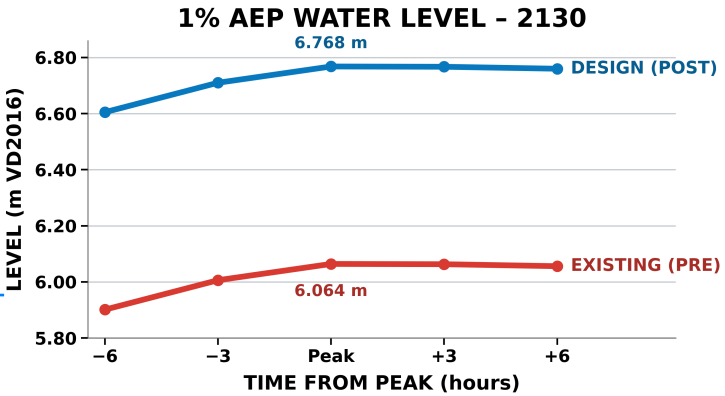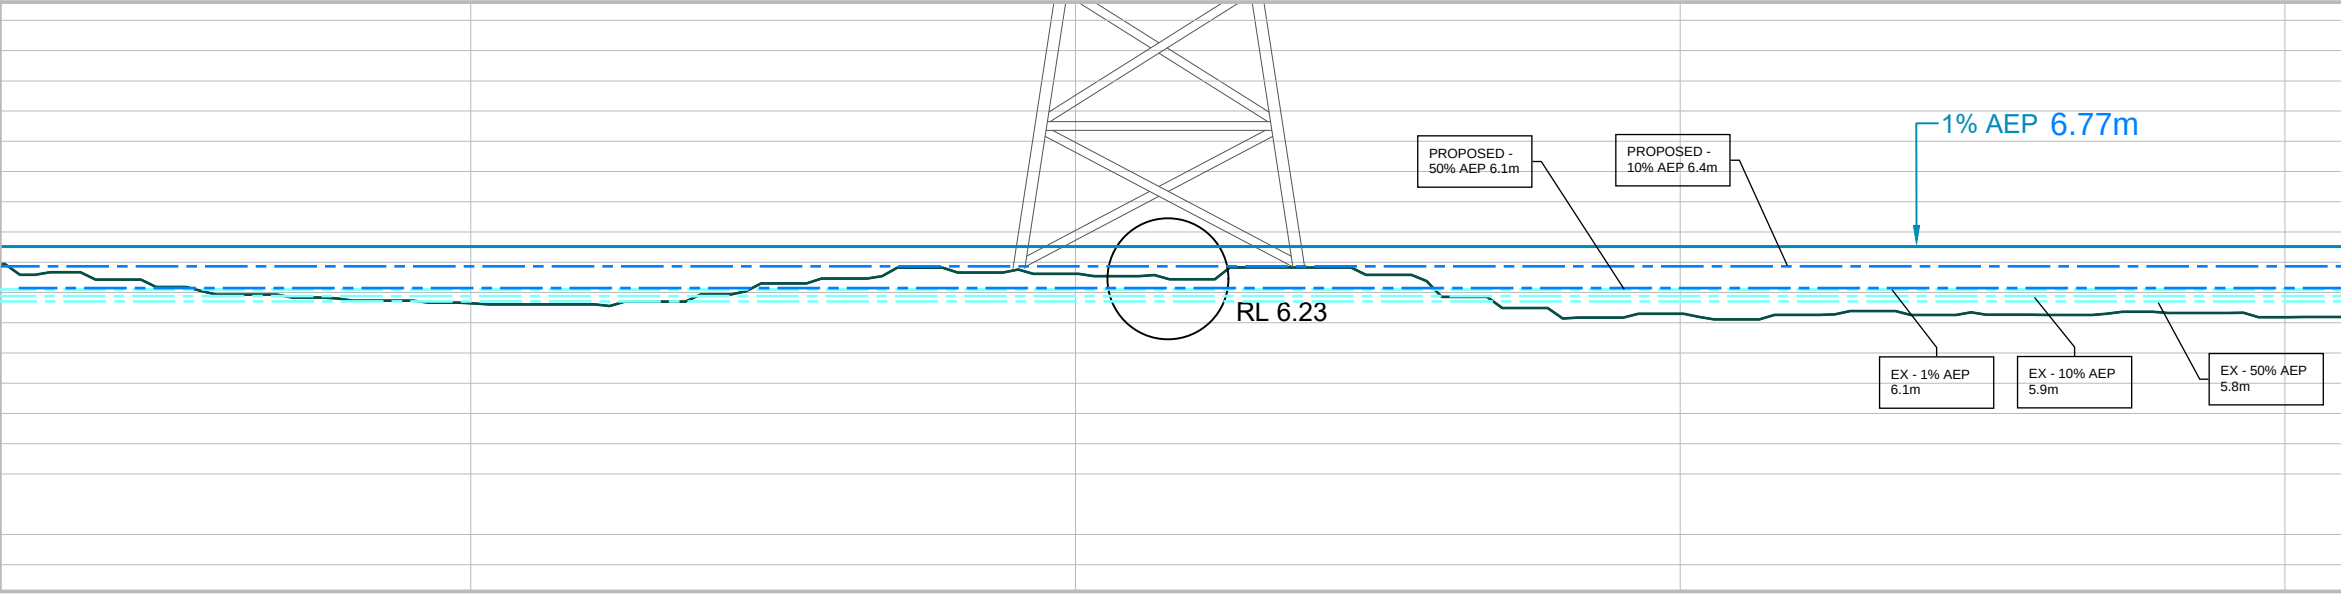

**KEY**

- PROPOSED GROUND PROFILE
- EXISTING GROUND PROFILE
- PROPOSED 1% AEP - 6.75m

PYLON 4 N-S

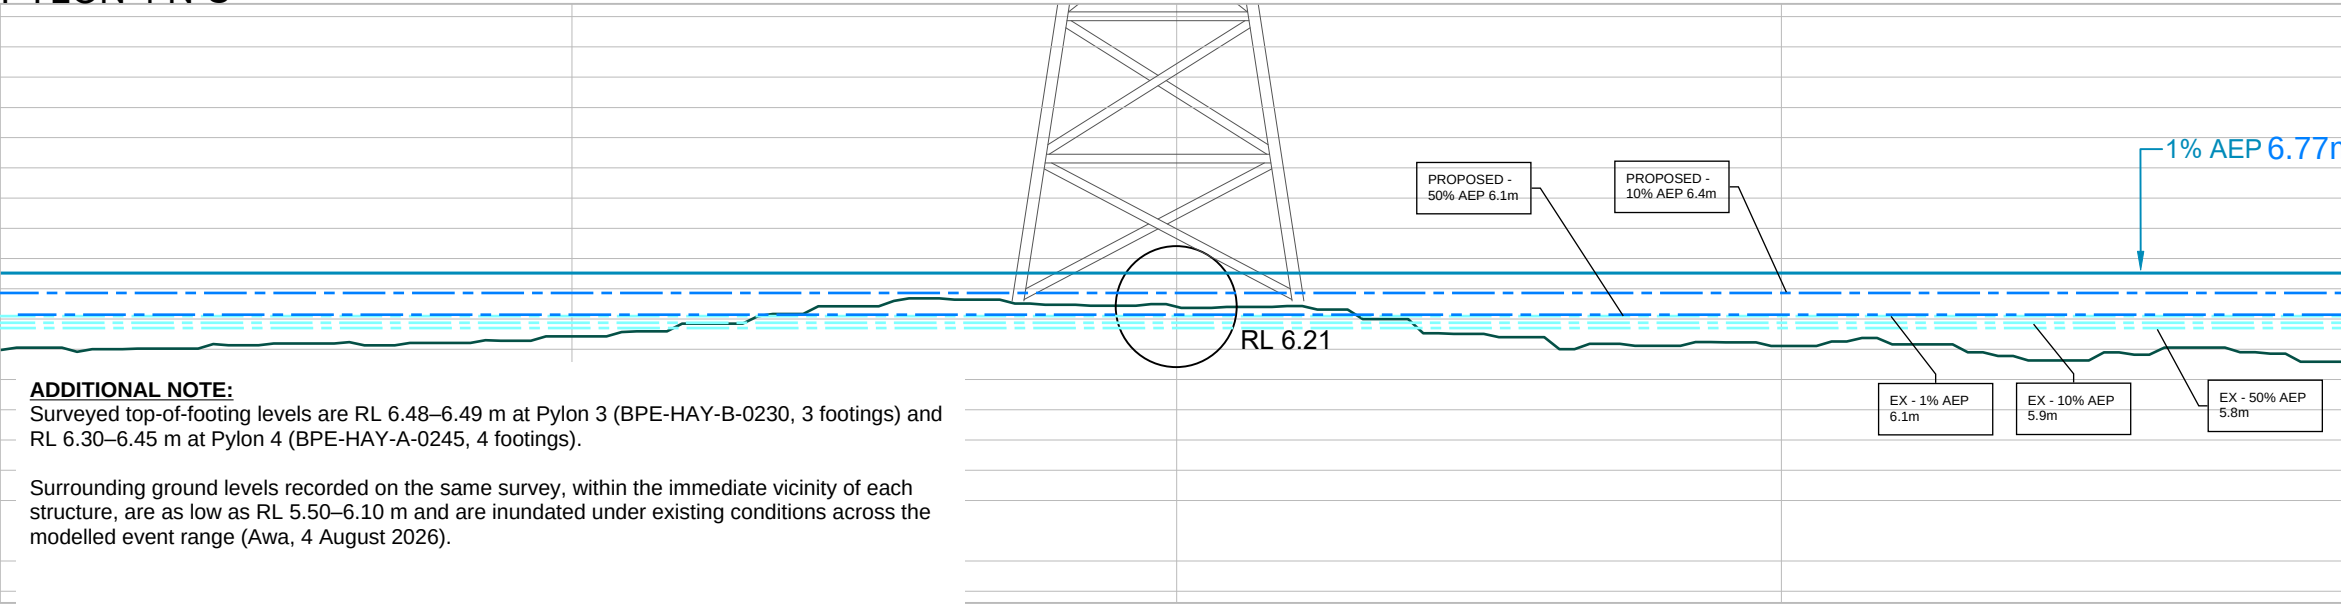

| REVISION | A        | ORIGINAL |         |
|----------|----------|----------|---------|
| -        | -        | JH       | JJH     |
| SURVEYED | DESIGNED | DRAWN    | CHECKED |





DATE **04/08/2026**

SCALE **1:500**

TITLE **Transpower Coordination Plans**  
TRANSPOWER - S53 QUERY RESPONSE

CLIENT **Waikanae North Developments Ltd**

PROJECT **171 Peka Peka Rd**  
Peka Peka

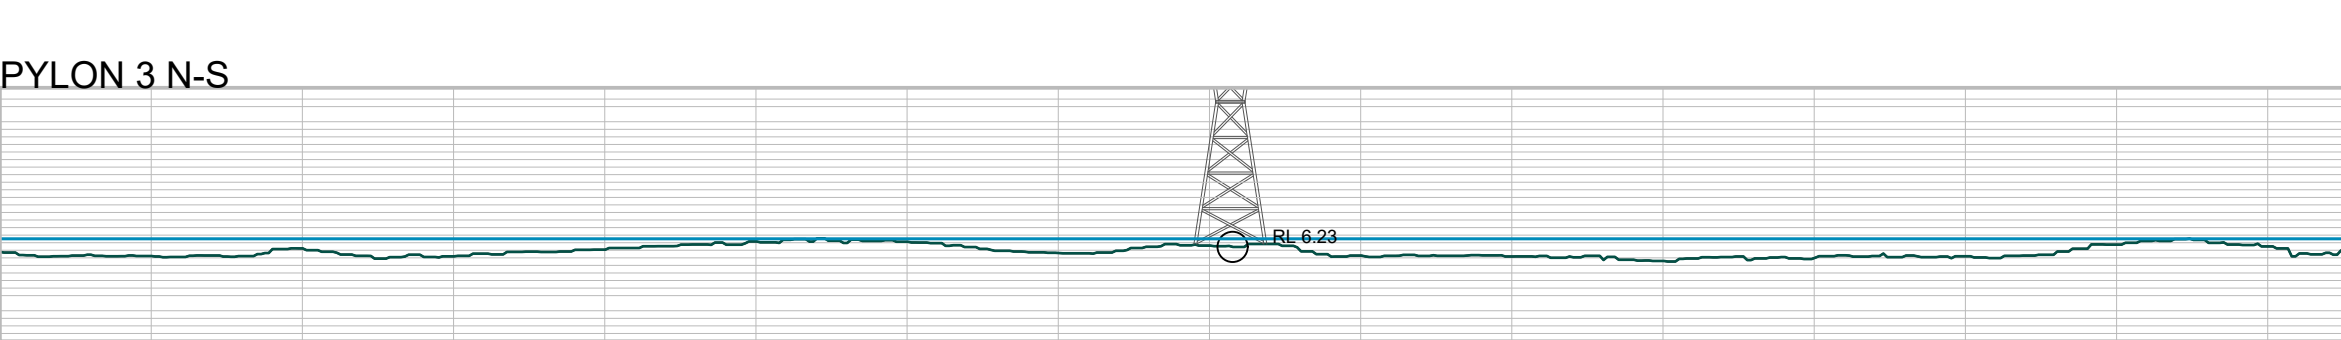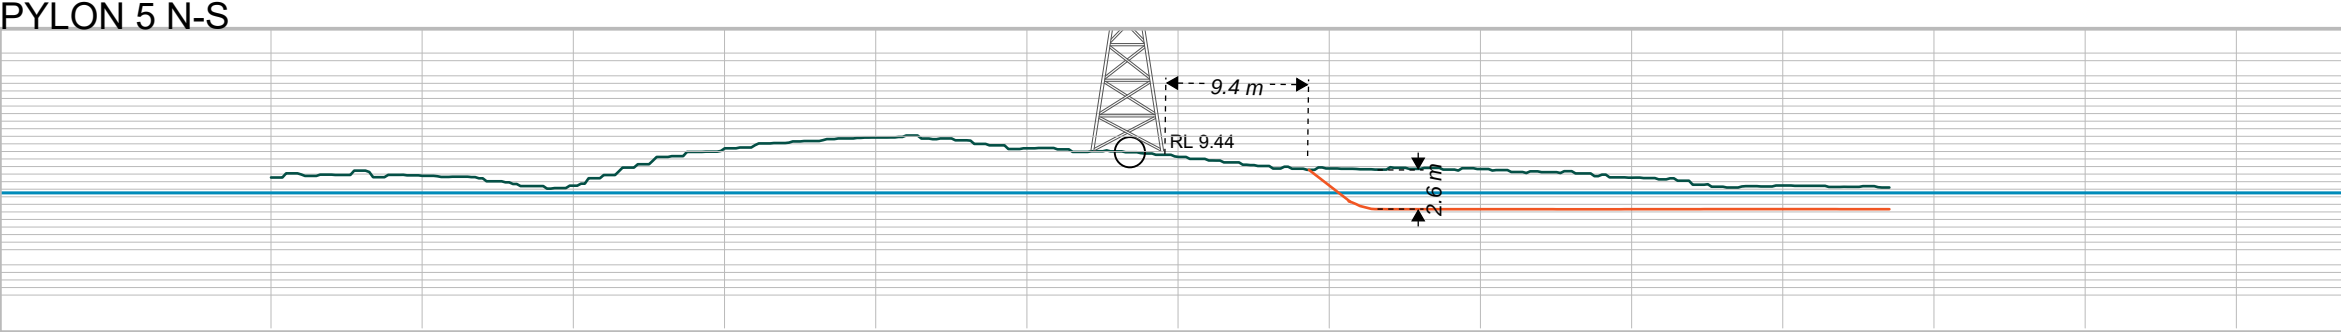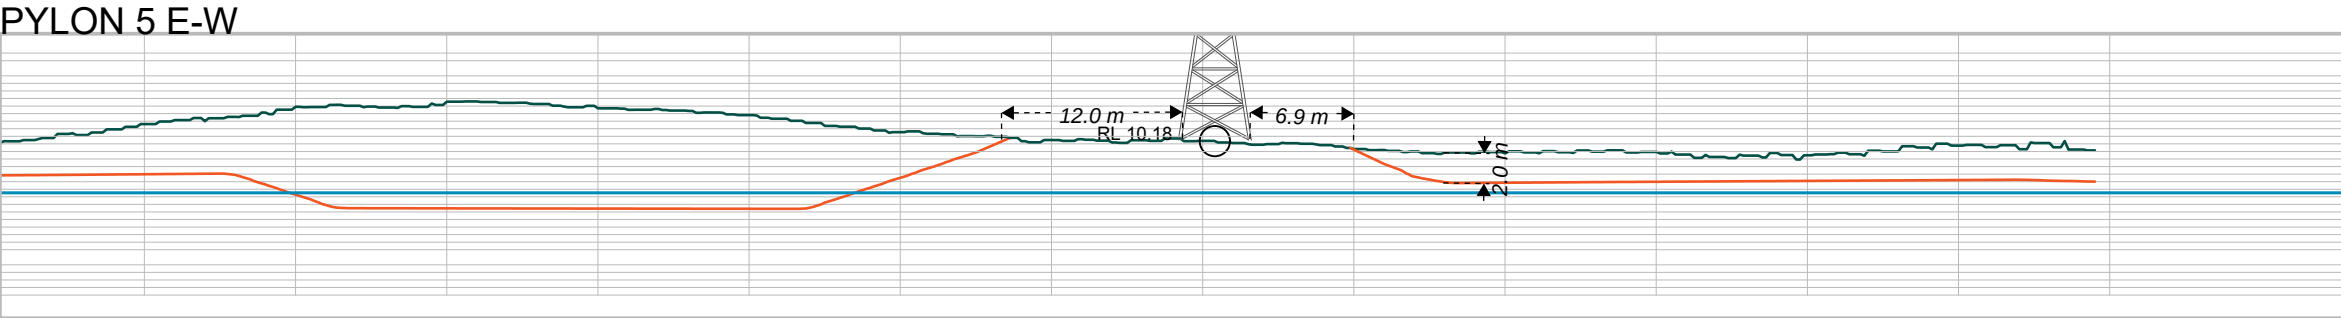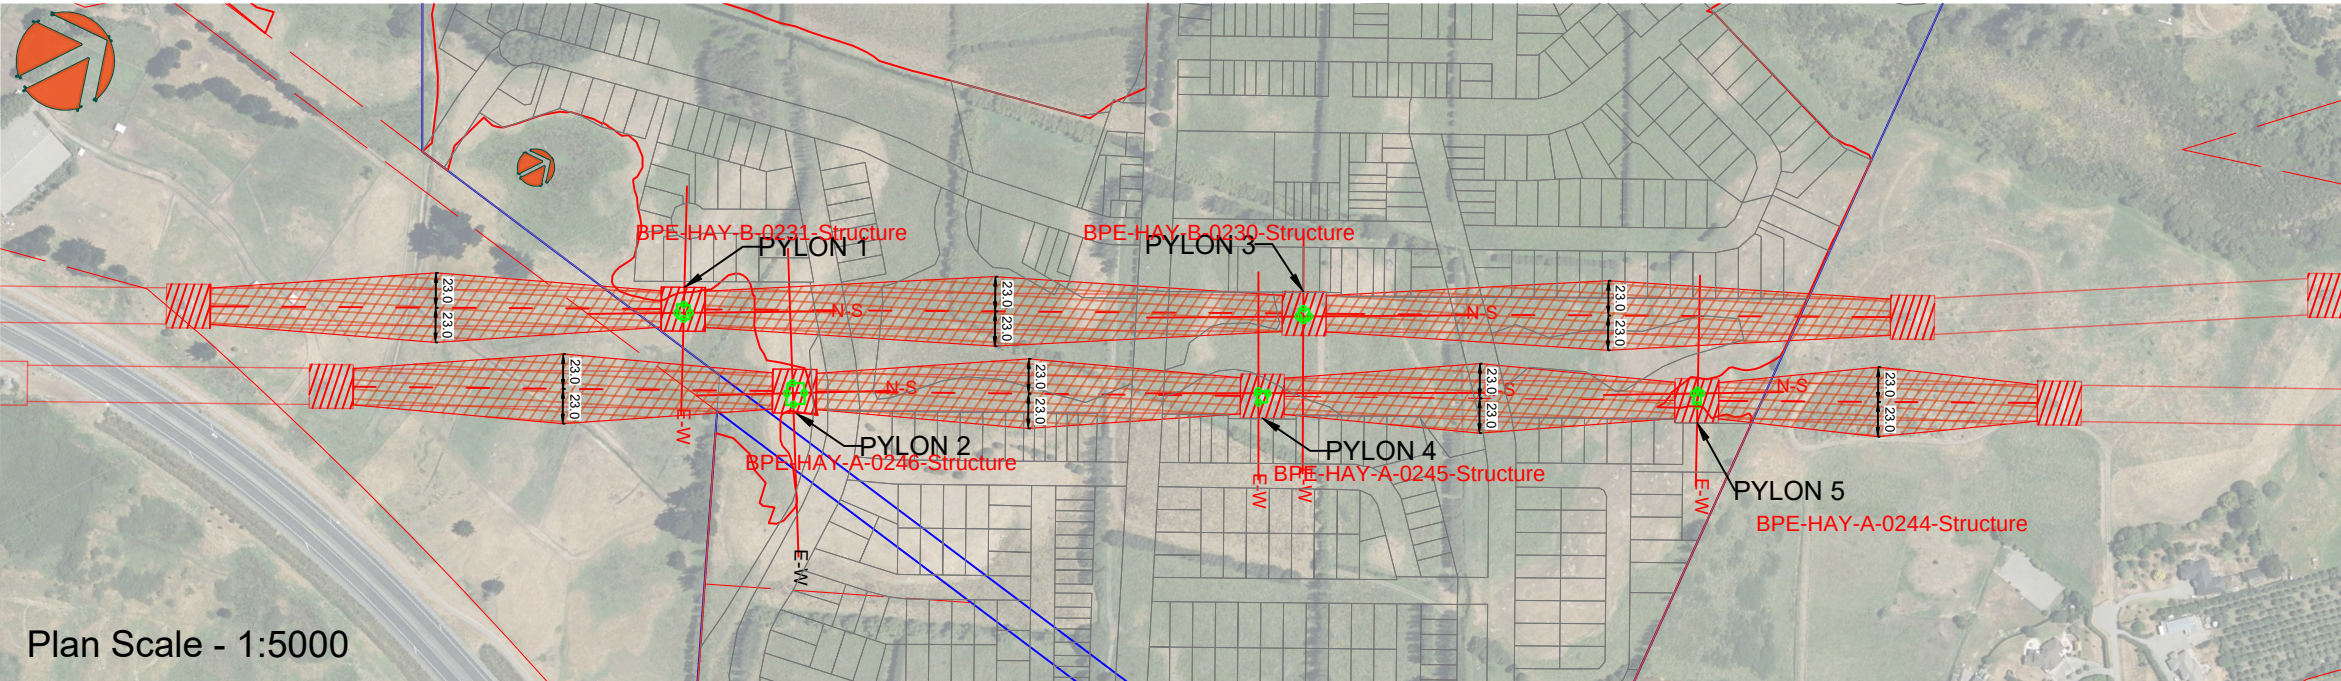

NOTES

1. Plan is in terms of NZGD2000 (Whanganui Circuit) and NZVD 2016.
2. Areas and dimensions are subject to cadastral survey.
3. Grids are 10m horizontal & 0.5m Vertical increments
4. Pylon locations are indicative only.

Section 2.2.3 of NZECP34:2001

Specifically, no excavation shall:

(a) exceed a depth greater than 300mm within 6 metres of the outer edge of the visible foundations of the tower; or

(b) exceed a depth greater than 3 metres between 6 metres and 12 metres of the outer edge of the visible foundation of the tower; or

(c) create an unstable batter.

**KEY**

— PROPOSED GROUND PROFILE

— EXISTING GROUND PROFILE

— 1% AEP - 6.75m

| REVISION | B        | S53 RESPONSE |         |
|----------|----------|--------------|---------|
| -        | -        | JH           | JJH     |
| SURVEYED | DESIGNED | DRAWN        | CHECKED |

DATE **04/08/2026**


SCALE **1:500**

TITLE **Transpower Coordination Plans**  
PYLON CROSS SECTION (1 OF 2)


CLIENT **Waikanae North Developments Ltd**

PROJECT **171 Peka Peka Rd**  
Peka Peka


PYLON 4 N-S

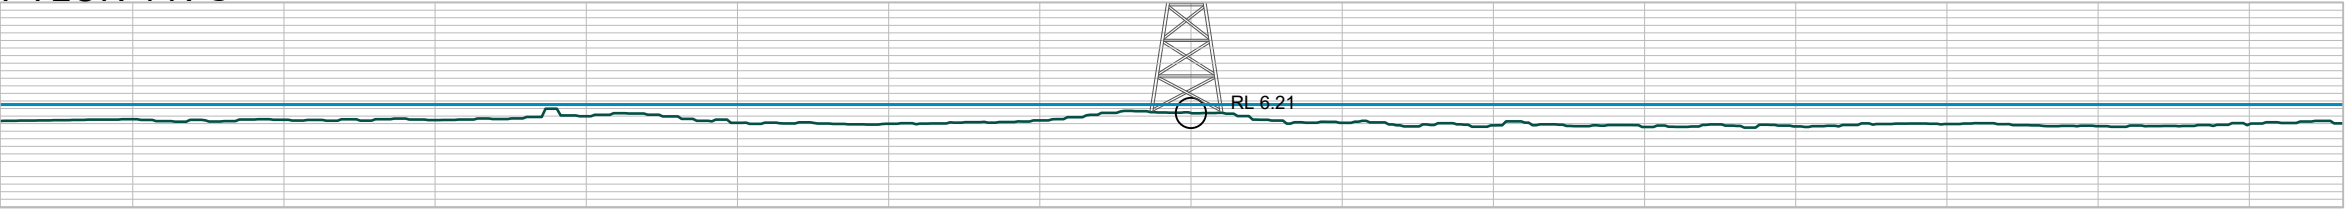


PYLON 4 E-W

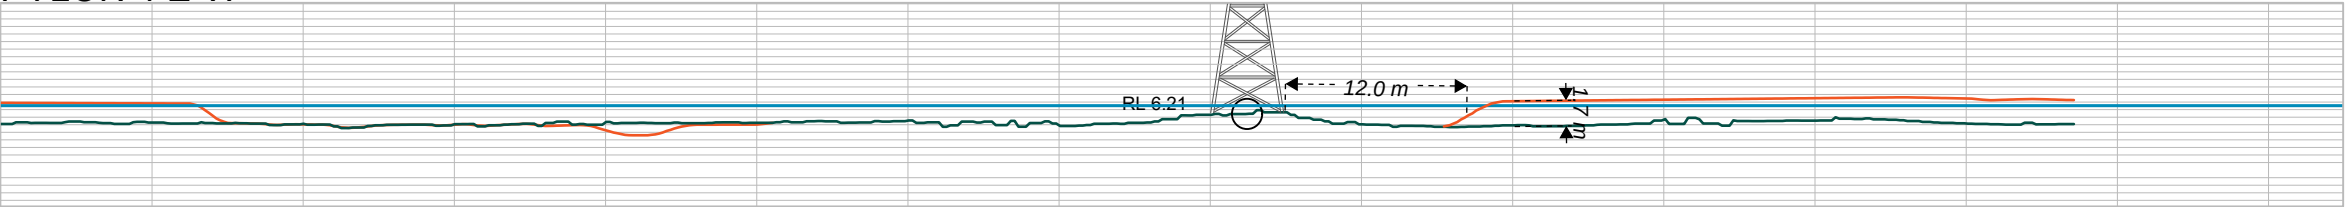


PYLON 2 N-S

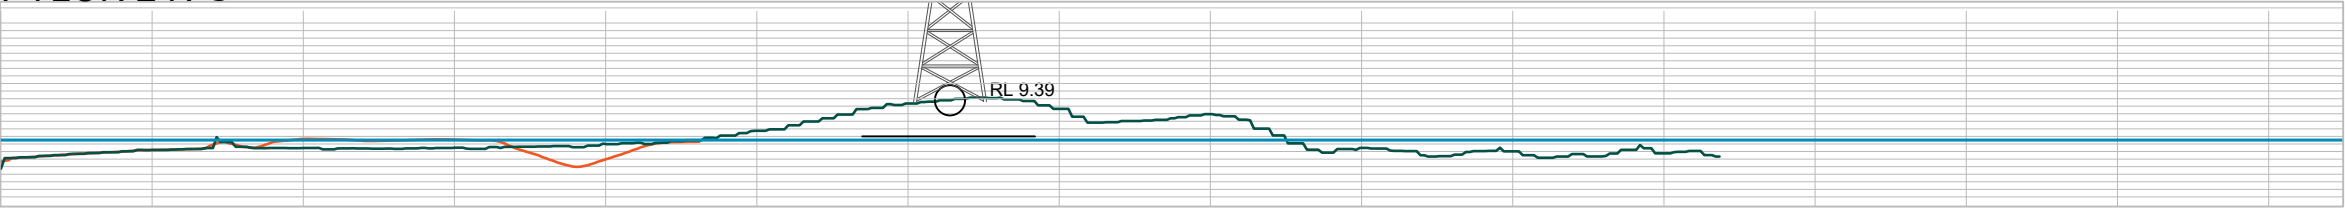


PYLON 2 E-W

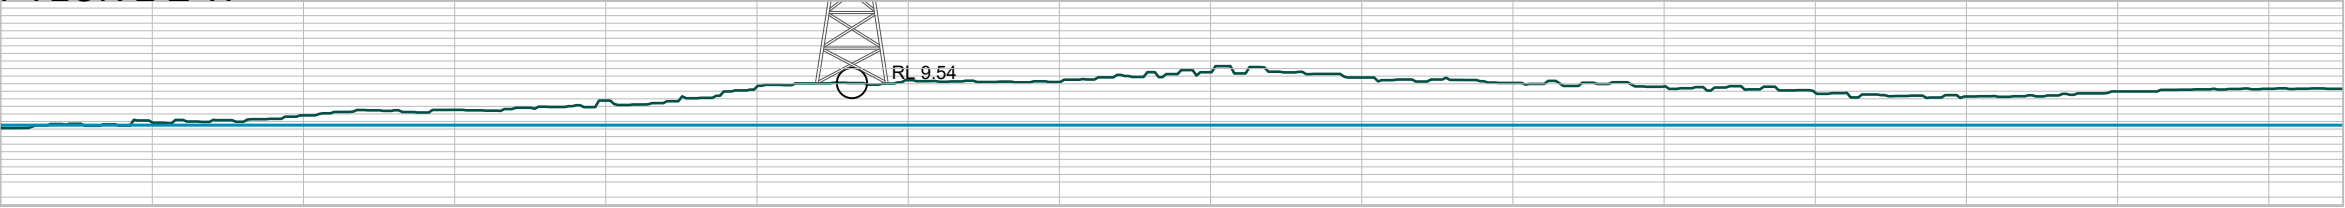

PYLON 1 E-W

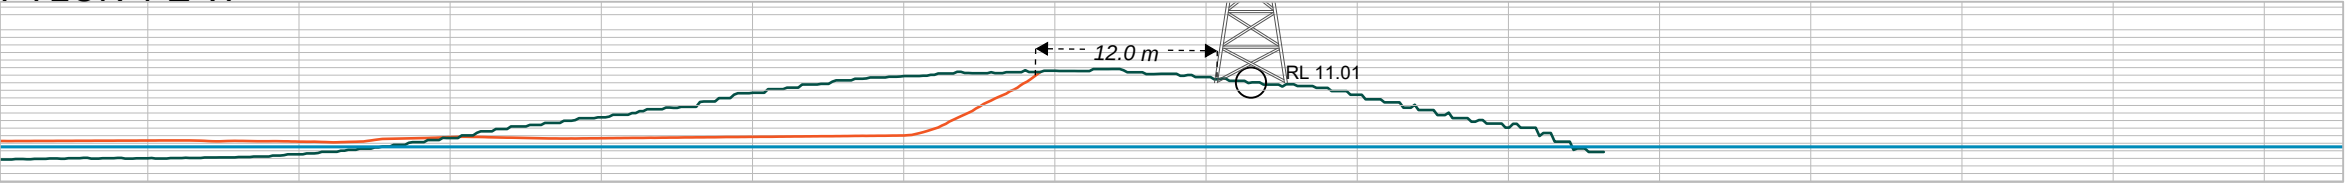

PYLON 1 N-S

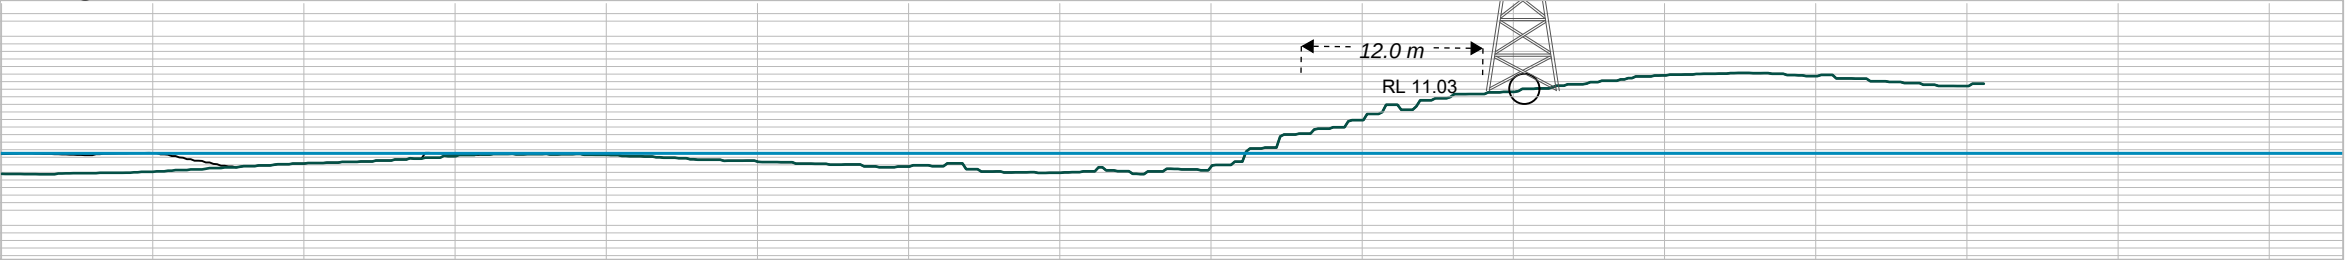

NOTES

1. Plan is in terms of NZGD2000 (Whanganui Circuit) and NZVD 2016.
2. Areas and dimensions are subject to cadastral survey.
3. Grids are 10m horizontal & 0.5m Vertical increments
4. Pylon locations are indicative only.

Section 2.2.3 of NZECP34:2001

Specifically, no excavation shall:

(a) exceed a depth greater than 300mm within 6 metres of the outer edge of the visible foundations of the tower; or

(b) exceed a depth greater than 3 metres between 6 metres and 12 metres of the outer edge of the visible foundation of the tower; or

(c) create an unstable batter.

KEY

- PROPOSED GROUND PROFILE
- EXISTING GROUND PROFILE
- 1% AEP - 6.75m

| REVISION | B        | S53 RESPONSE |         |
|----------|----------|--------------|---------|
| -        | -        | JH           | JJH     |
| SURVEYED | DESIGNED | DRAWN        | CHECKED |

DATE 04/08/2026

SCALE 1:500

TITLE Transpower Coordination Plans  
PYLON CROSS SECTION (2 OF 2)

CLIENT Waikanae North Developments Ltd

PROJECT 171 Peka Peka Rd  
Peka Peka

| JOB   | STAGE  | SHEET | REV |
|-------|--------|-------|-----|
| 2911- | P0-056 | -B    |     |