




- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL ROAD CROSSINGS TO COUNCIL STANDARDS.
 5. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS. ALL MANHOLES SHALL HAVE STAINLESS GRATES INSTALLED.
 6. ALL LINES ARE TO BE 150mmØ PVC CLASS SN16 UNLESS SHOWN OTHERWISE.
 7. 150mmØ PIPES THAT DO NOT TERMINATE IN A MANHOLE MUST BE TERMINATED WITH A 100mmØ ON A 150mmØ LONDON JUNCTION AND BLANK CAP.
 8. MANHOLE DIAMETERS SHOWN ON STRUCTURE LABEL ARE INTERNAL DIAMETER.
 9. MEASUREMENTS SHOWN ON LOT CONNECTIONS ARE DISTANCE TO CENTER OF LOT CONNECTION FROM THE NEAREST DOWNSTREAM MANHOLE.

LEGEND	
	EX BDY
	PROP BDY
	EX WASTEWATER
	PROP WASTEWATER
	EX STORMWATER
	PROP STORMWATER
	EX/PROP WWMH
	PR WW LOT CON
	EX/PROP SWMH
	PR SWCP SINGLE
	PR SWCP DOUBLE
	PR LOT CONNECTION

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
Survey	MAVEN		05/2025
Design	MKS		04/2026
Drawn	MKS		04/2026
Checked	SM		09/2026

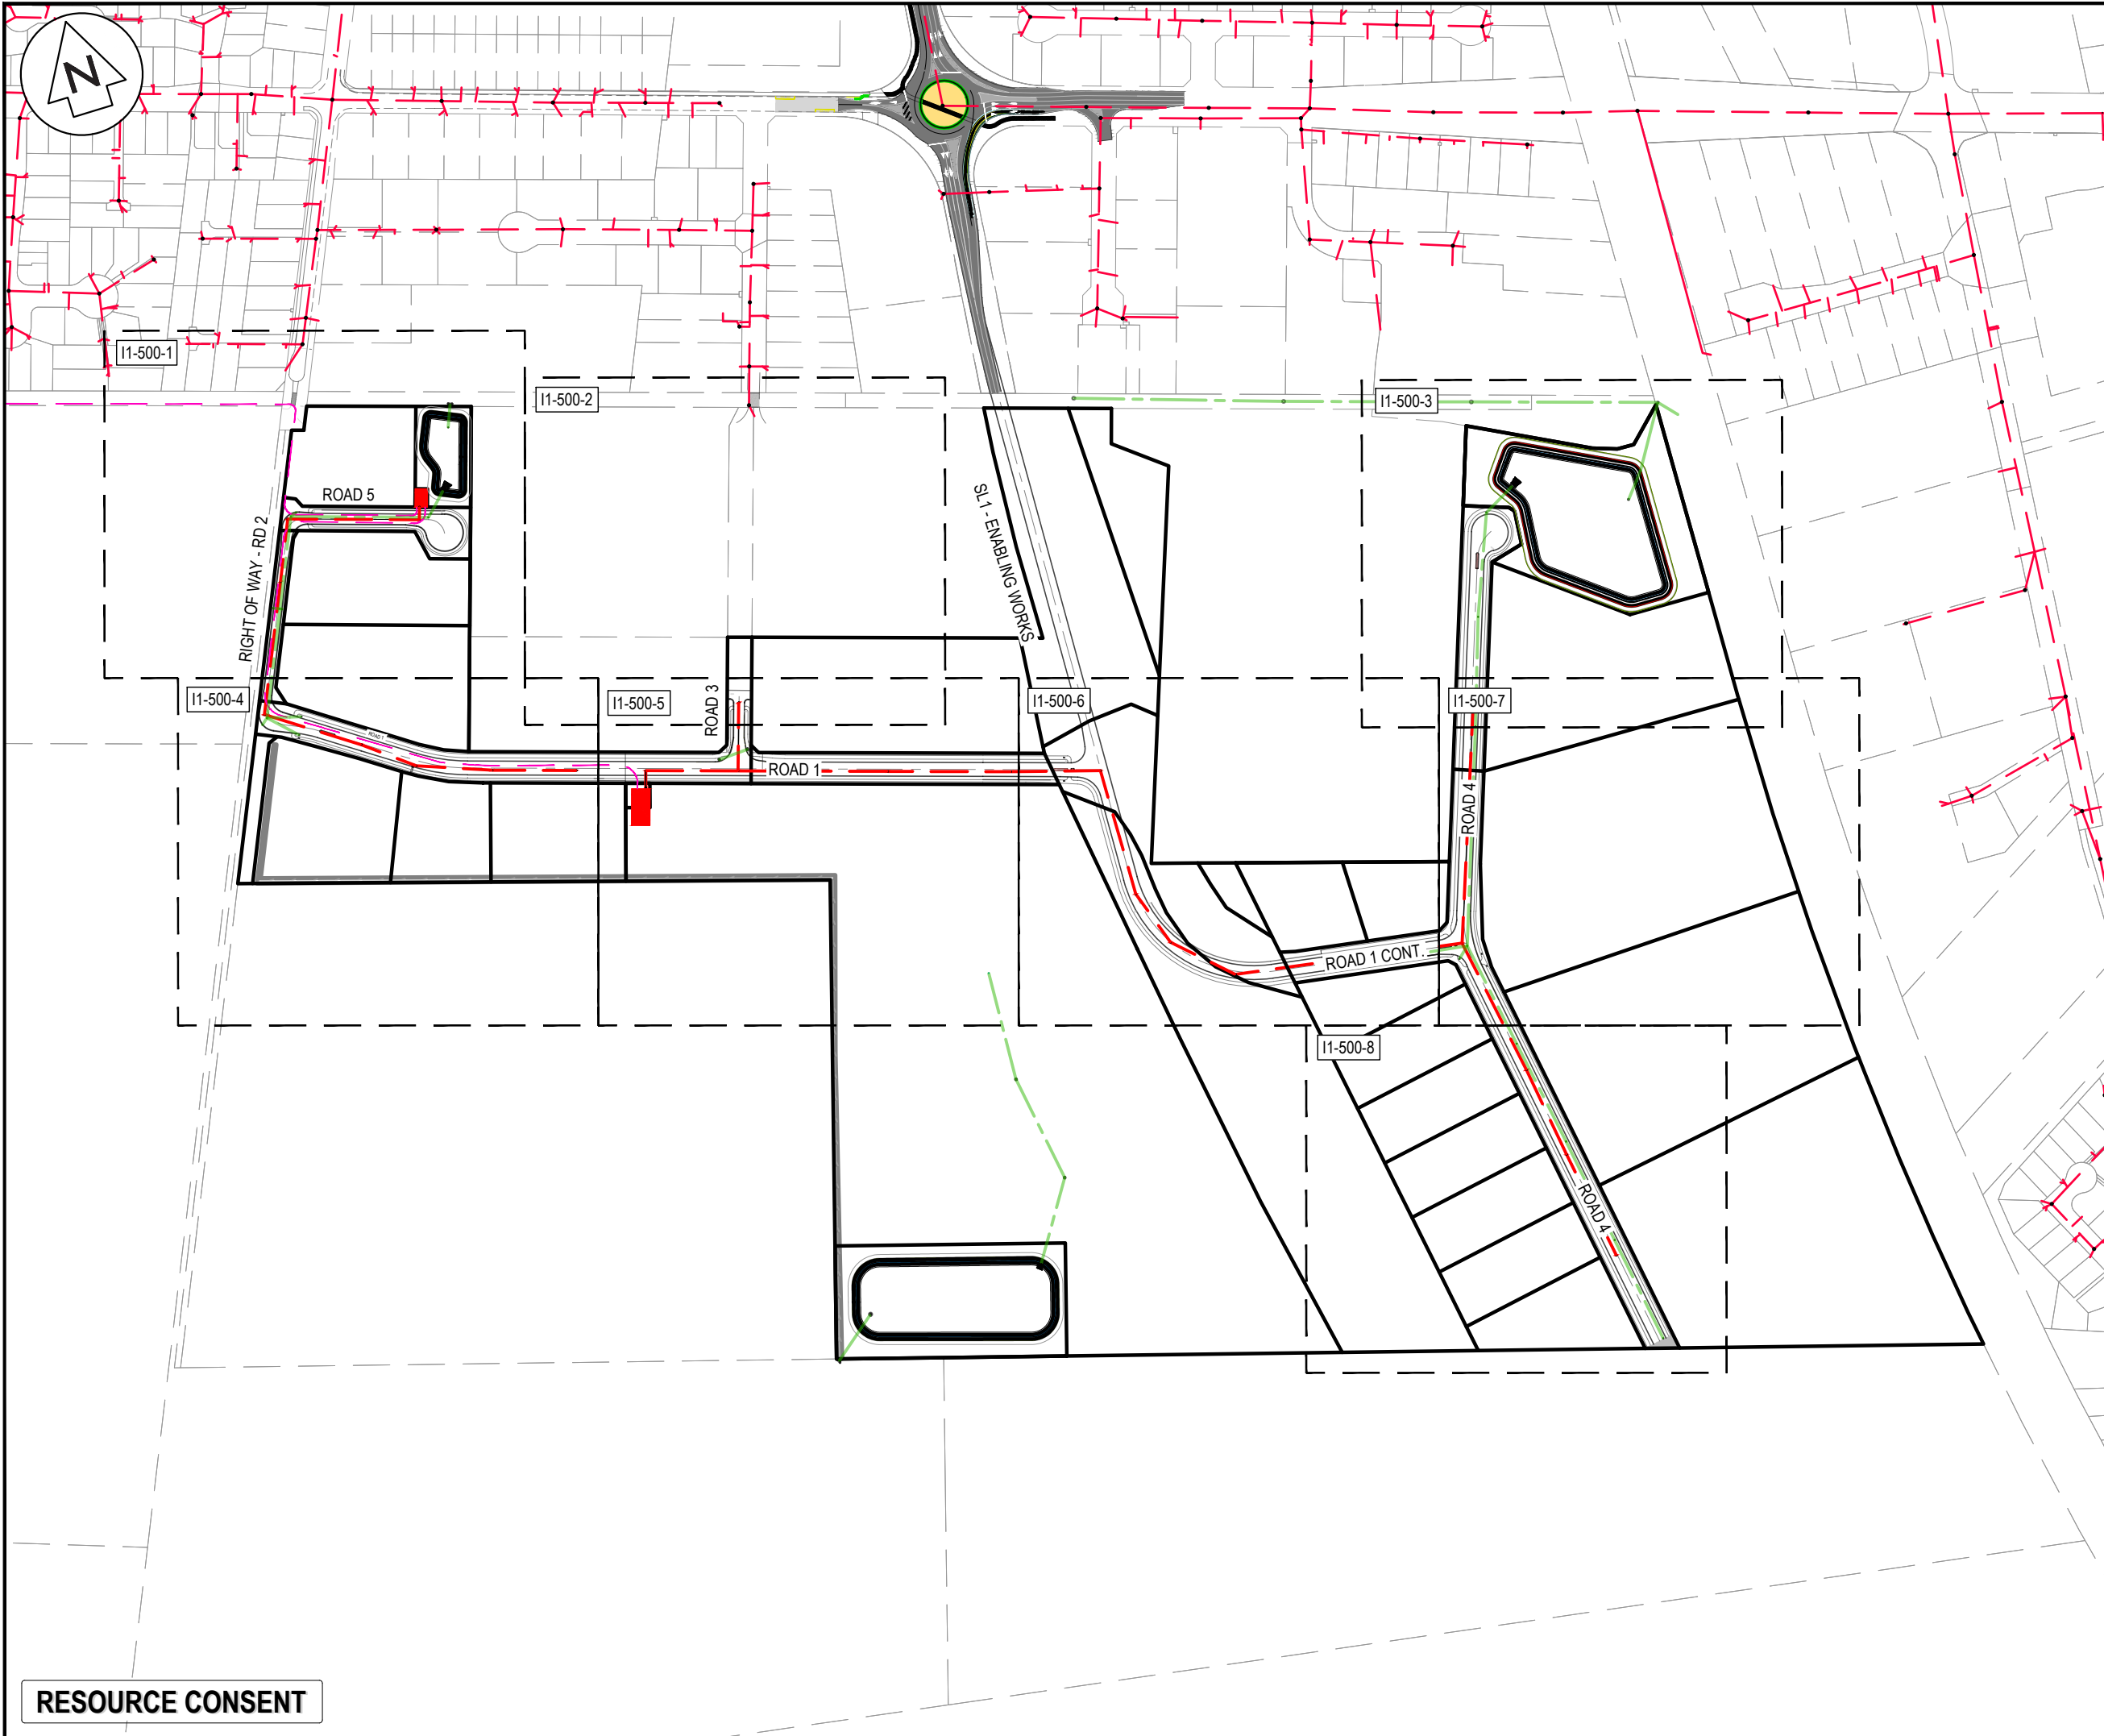



Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project
**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title
**PROPOSED
WASTEWATER
OVERVIEW PLAN**

Project no.	298002		
Scale	1:5000 @ A3		
Cad file	298002-I1-C500 WW.DWG		
Drawing no.	I1-C500	Rev	A

RESOURCE CONSENT

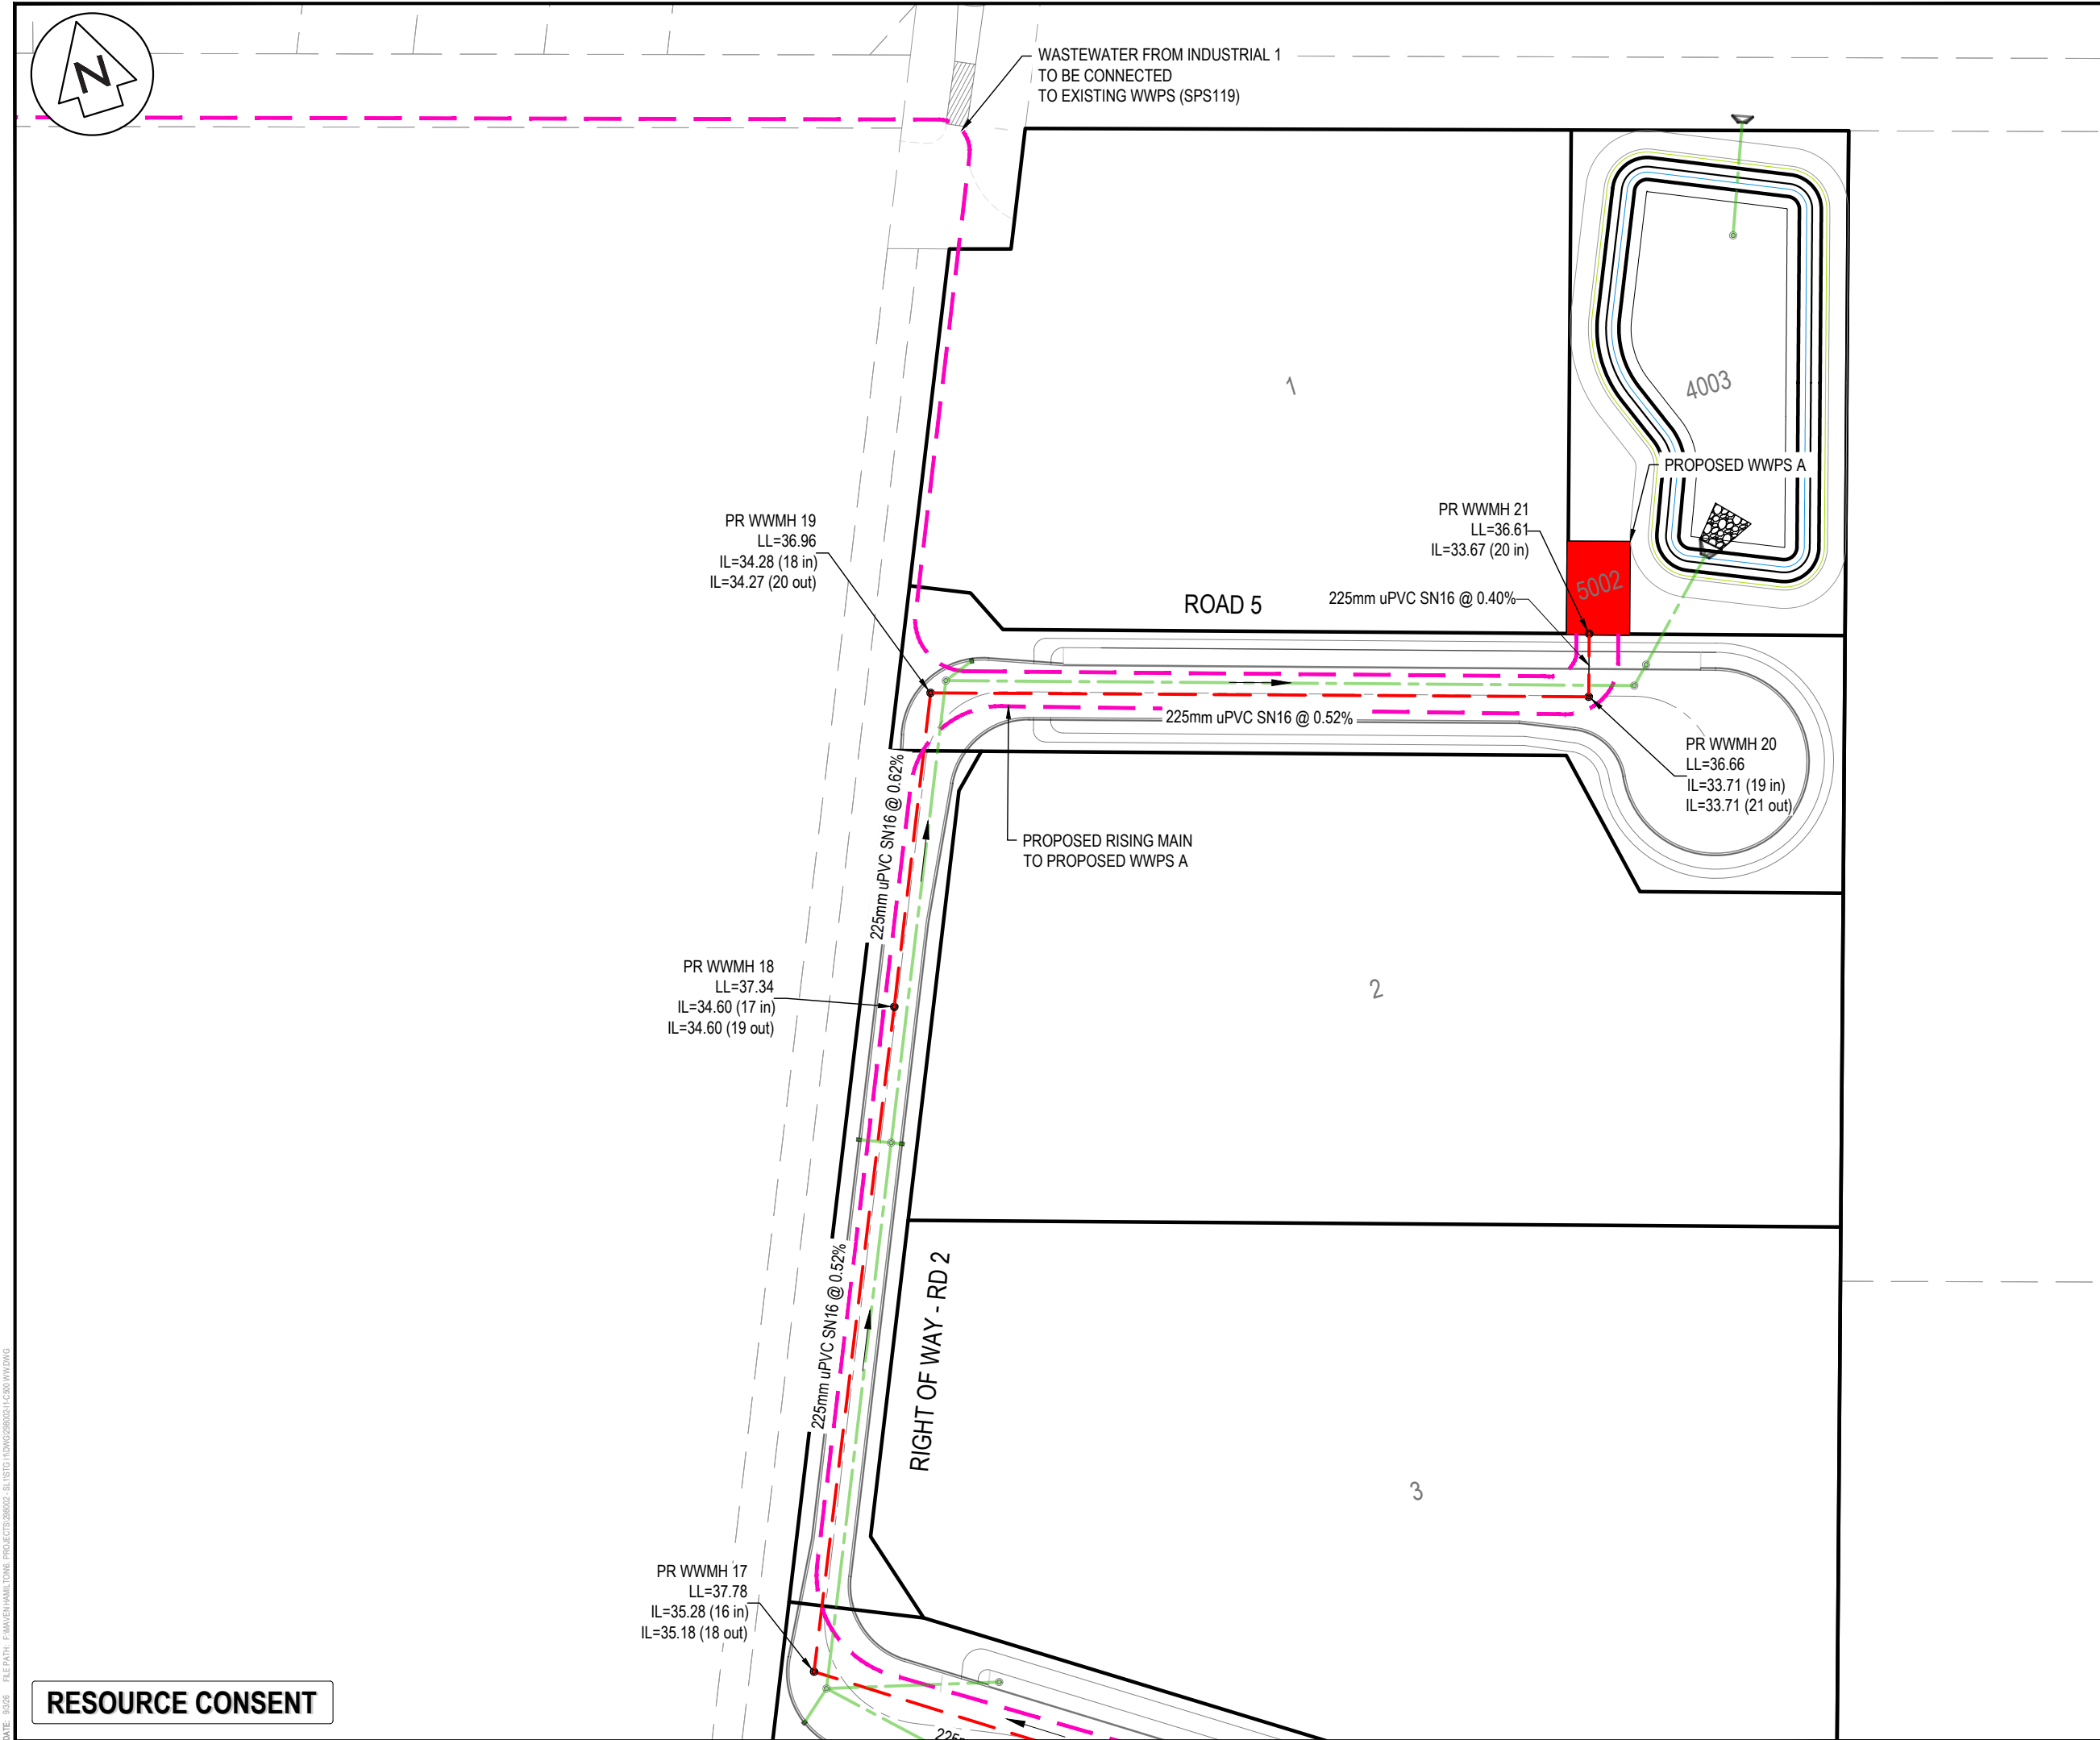

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL ROAD CROSSINGS TO COUNCIL STANDARDS.
 5. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS. ALL MANHOLES SHALL HAVE STAINLESS GRATES INSTALLED.
 6. ALL LINES ARE TO BE 150mmØ PVC CLASS SN16 UNLESS SHOWN OTHERWISE.
 7. 150mmØ PIPES THAT DO NOT TERMINATE IN A MANHOLE MUST BE TERMINATED WITH A 100mmØ ON A 150mmØ LONDON JUNCTION AND BLANK CAP.
 8. MANHOLE DIAMETERS SHOWN ON STRUCTURE LABEL ARE INTERNAL DIAMETER.
 9. MEASUREMENTS SHOWN ON LOT CONNECTIONS ARE DISTANCE TO CENTER OF LOT CONNECTION FROM THE NEAREST DOWNSTREAM MANHOLE.

LEGEND	
	EX BDY
	PROP BDY
	EX WASTEWATER
	PROP WASTEWATER
	PROP RISING MAIN
	EX/PROP WWMH
	PR WW LOT CON
	EX STORMWATER
	PR STORMWATER
	EX/PROP SWMH
	PROP SWCP SINGLE
	PROP SWCP DOUBLE
	PR LOT CONNECTION

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	Survey	MAVEN	05/2025
	Design	MKS	04/2026
	Drawn	MKS	04/2026
	Checked	SM	09/2026






Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project
**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title
**PROPOSED
WASTEWATER
PLAN**

Project no.	298002		
Scale	1:1000 @ A3		
Cad file	298002-11-C500 WW.DWG		
Drawing no.	I1-C500-1	Rev	A

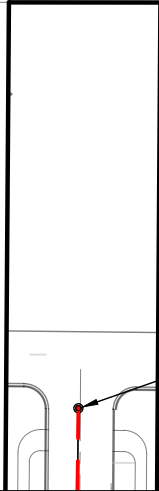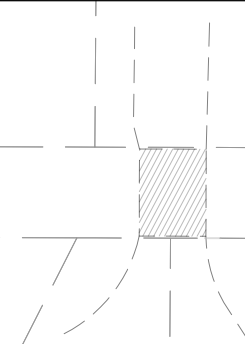

ROAD 3

PR WWMH 14
LL=40.71
IL=36.92 (2 out)

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL ROAD CROSSINGS TO COUNCIL STANDARDS.
 5. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS. ALL MANHOLES SHALL HAVE STAINLESS GRATES INSTALLED.
 6. ALL LINES ARE TO BE 150mmØ PVC CLASS SN16 UNLESS SHOWN OTHERWISE.
 7. 150mmØ PIPES THAT DO NOT TERMINATE IN A MANHOLE MUST BE TERMINATED WITH A 100mmØ ON A 150mmØ LONDON JUNCTION AND BLANK CAP.
 8. MANHOLE DIAMETERS SHOWN ON STRUCTURE LABEL ARE INTERNAL DIAMETER.
 9. MEASUREMENTS SHOWN ON LOT CONNECTIONS ARE DISTANCE TO CENTER OF LOT CONNECTION FROM THE NEAREST DOWNSTREAM MANHOLE.

LEGEND	
	EX BDY
	PROP BDY
	EX WASTEWATER
	PROP WASTEWATER
	PROP RISING MAIN
	EX/PROP WWMH
	PR WW LOT CON
	EX STORMWATER
	PR STORMWATER
	EX/PROP SWMH
	PROP SWCP SINGLE
	PROP SWCP DOUBLE
	PR LOT CONNECTION

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	By	Date	
Survey	MAVEN	05/2025	
Design	MKS	04/2026	
Drawn	MKS	04/2026	
Checked	SM	09/2026	



Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project

SOUTHERN LINKS 1

INDUSTRIAL STAGE 1

HAMILTON, WAIKATO

FOR SL1

NORTHERN CONSORTIUM



Title

PROPOSED

WASTEWATER

PLAN

Project no.	298002		
Scale	1:1000 @ A3		
Cad file	298002-11-C500 WW.DWG		
Drawing no.	I1-C500-2	Rev	A

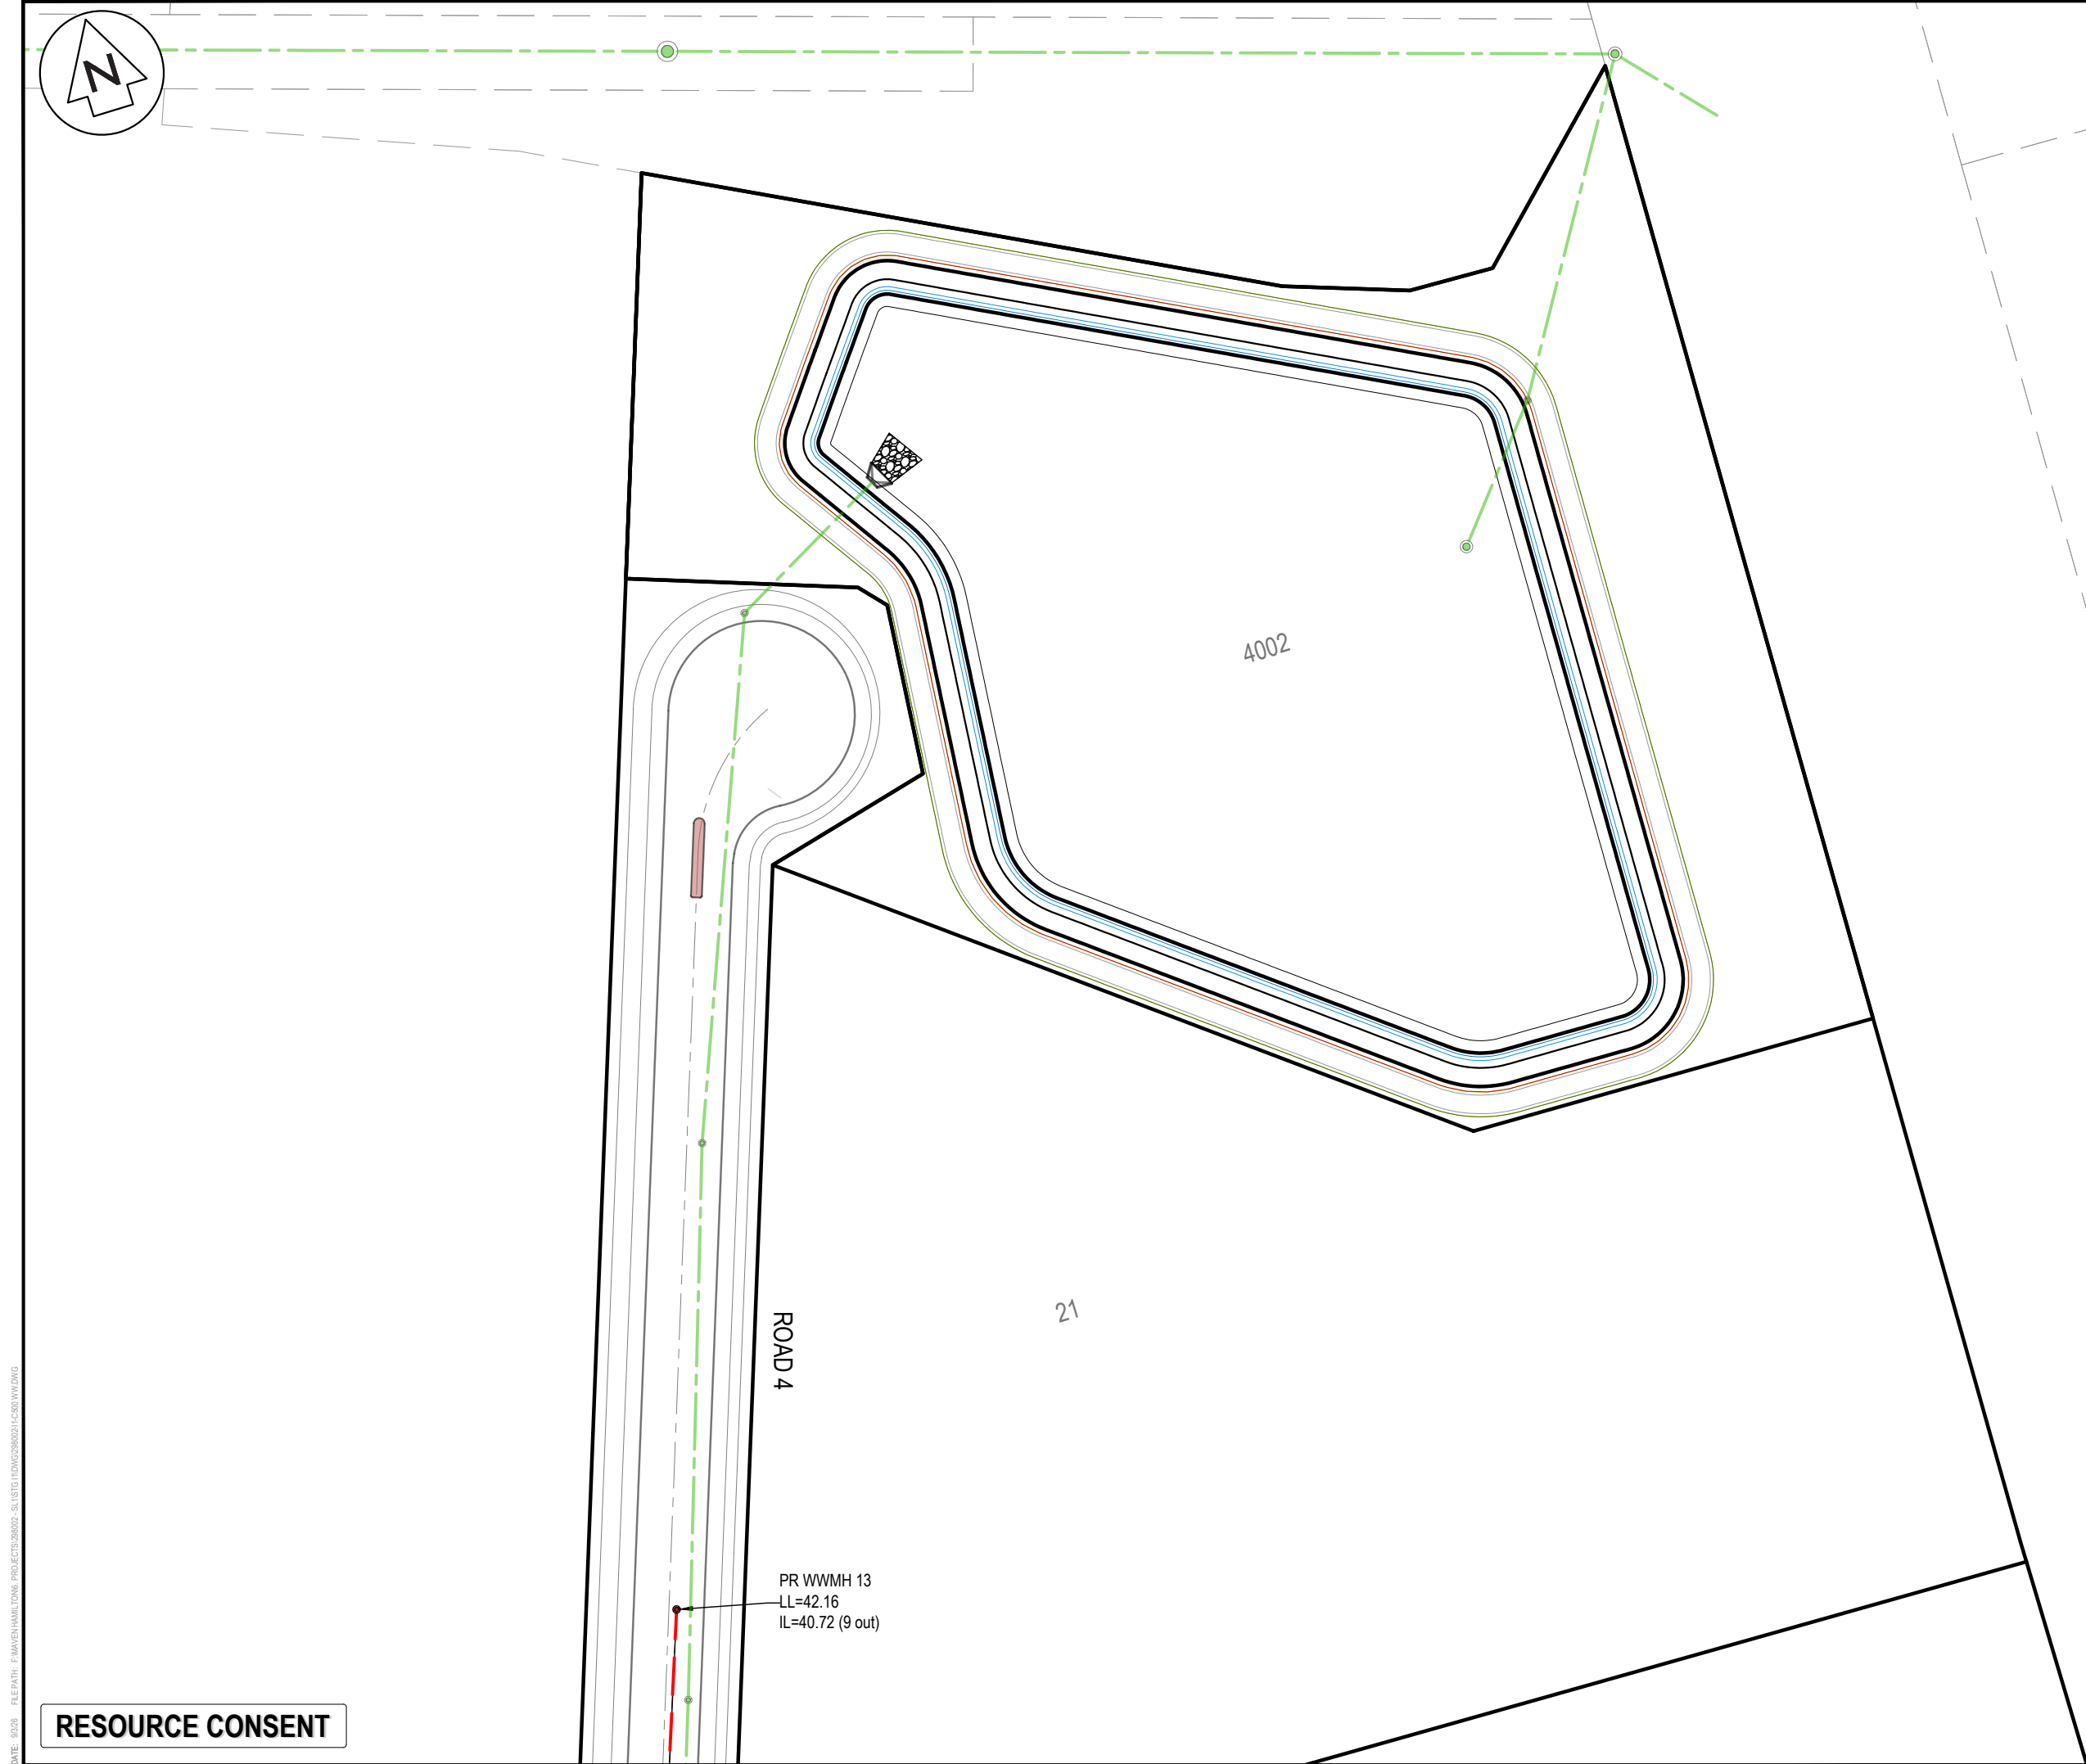

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL ROAD CROSSINGS TO COUNCIL STANDARDS.
 5. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS. ALL MANHOLES SHALL HAVE STAINLESS GRATES INSTALLED.
 6. ALL LINES ARE TO BE 150mmØ PVC CLASS SN16 UNLESS SHOWN OTHERWISE.
 7. 150mmØ PIPES THAT DO NOT TERMINATE IN A MANHOLE MUST BE TERMINATED WITH A 100mmØ ON A 150mmØ LONDON JUNCTION AND BLANK CAP.
 8. MANHOLE DIAMETERS SHOWN ON STRUCTURE LABEL ARE INTERNAL DIAMETER.
 9. MEASUREMENTS SHOWN ON LOT CONNECTIONS ARE DISTANCE TO CENTER OF LOT CONNECTION FROM THE NEAREST DOWNSTREAM MANHOLE.

LEGEND	
	EX BDY
	PROP BDY
	EX WASTEWATER
	PROP WASTEWATER
	PROP RISING MAIN
	EX/PROP WWMH
	PR WW LOT CON
	EX STORMWATER
	PR STORMWATER
	EX/PROP SWMH
	PROP SWCP SINGLE
	PROP SWCP DOUBLE
	PR LOT CONNECTION

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	Survey	MAVEN	05/2025
	Design	MKS	04/2026
	Drawn	MKS	04/2026
	Checked	SM	09/2026



Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project


**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title

**PROPOSED
WASTEWATER
PLAN**

Project no.	298002		
Scale	1:1000 @ A3		
Cad file	298002-I1-C500 WW.DWG		
Drawing no.	I1-C500-3	Rev	A

RESOURCE CONSENT



PR WWMH 17
LL=37.78
IL=35.28 (16 in)
IL=35.18 (18 out)

225mm uPVC SN16 @ 1.45%

PR WWMH 16
LL=38.47
IL=36.48 (15 in)
IL=36.48 (17 out)

ROAD 1

PR WWMH 15
LL=38.76
IL=37.22 (14 in)
IL=37.22 (16 out)

225mm uPVC SN16 @ 1.53%

PR WWMH 14
LL=39.34
IL=37.81 (13 in)
IL=37.81 (15 out)

RISING MAIN
TO BE CONNECTED
TO PROPOSED WWMH

225mm uPVC SN16 @ 0.93%

225mm uPVC SN16 @ 0.96%

PR WWMH 13
LL=39.91
IL=38.47 (14 out)

3011
1491m²

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL ROAD CROSSINGS TO COUNCIL STANDARDS.
 5. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS. ALL MANHOLES SHALL HAVE STAINLESS GRATES INSTALLED.
 6. ALL LINES ARE TO BE 150mmØ PVC CLASS SN16 UNLESS SHOWN OTHERWISE.
 7. 150mmØ PIPES THAT DO NOT TERMINATE IN A MANHOLE MUST BE TERMINATED WITH A 100mmØ ON A 150mmØ LONDON JUNCTION AND BLANK CAP.
 8. MANHOLE DIAMETERS SHOWN ON STRUCTURE LABEL ARE INTERNAL DIAMETER.
 9. MEASUREMENTS SHOWN ON LOT CONNECTIONS ARE DISTANCE TO CENTER OF LOT CONNECTION FROM THE NEAREST DOWNSTREAM MANHOLE.

LEGEND

	EX BDY
	PROP BDY
	EX WASTEWATER
	PROP WASTEWATER
	PROP RISING MAIN
	EX/PROP WWMH
	PR WW LOT CON
	EX STORMWATER
	PR STORMWATER
	EX/PROP SWMH
	PROP SWCP SINGLE
	PROP SWCP DOUBLE
	PR LOT CONNECTION

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
		By	Date
Survey	MAVEN		05/2025
Design	MKS		04/2026
Drawn	MKS		04/2026
Checked	SM		09/2026



Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project


**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title

**PROPOSED
WASTEWATER
PLAN**

Project no.	298002		
Scale	1:1000 @ A3		
Cad file	298002-11-C500 WW.DWG		
Drawing no.	I1-C500-4	Rev	A

RESOURCE CONSENT

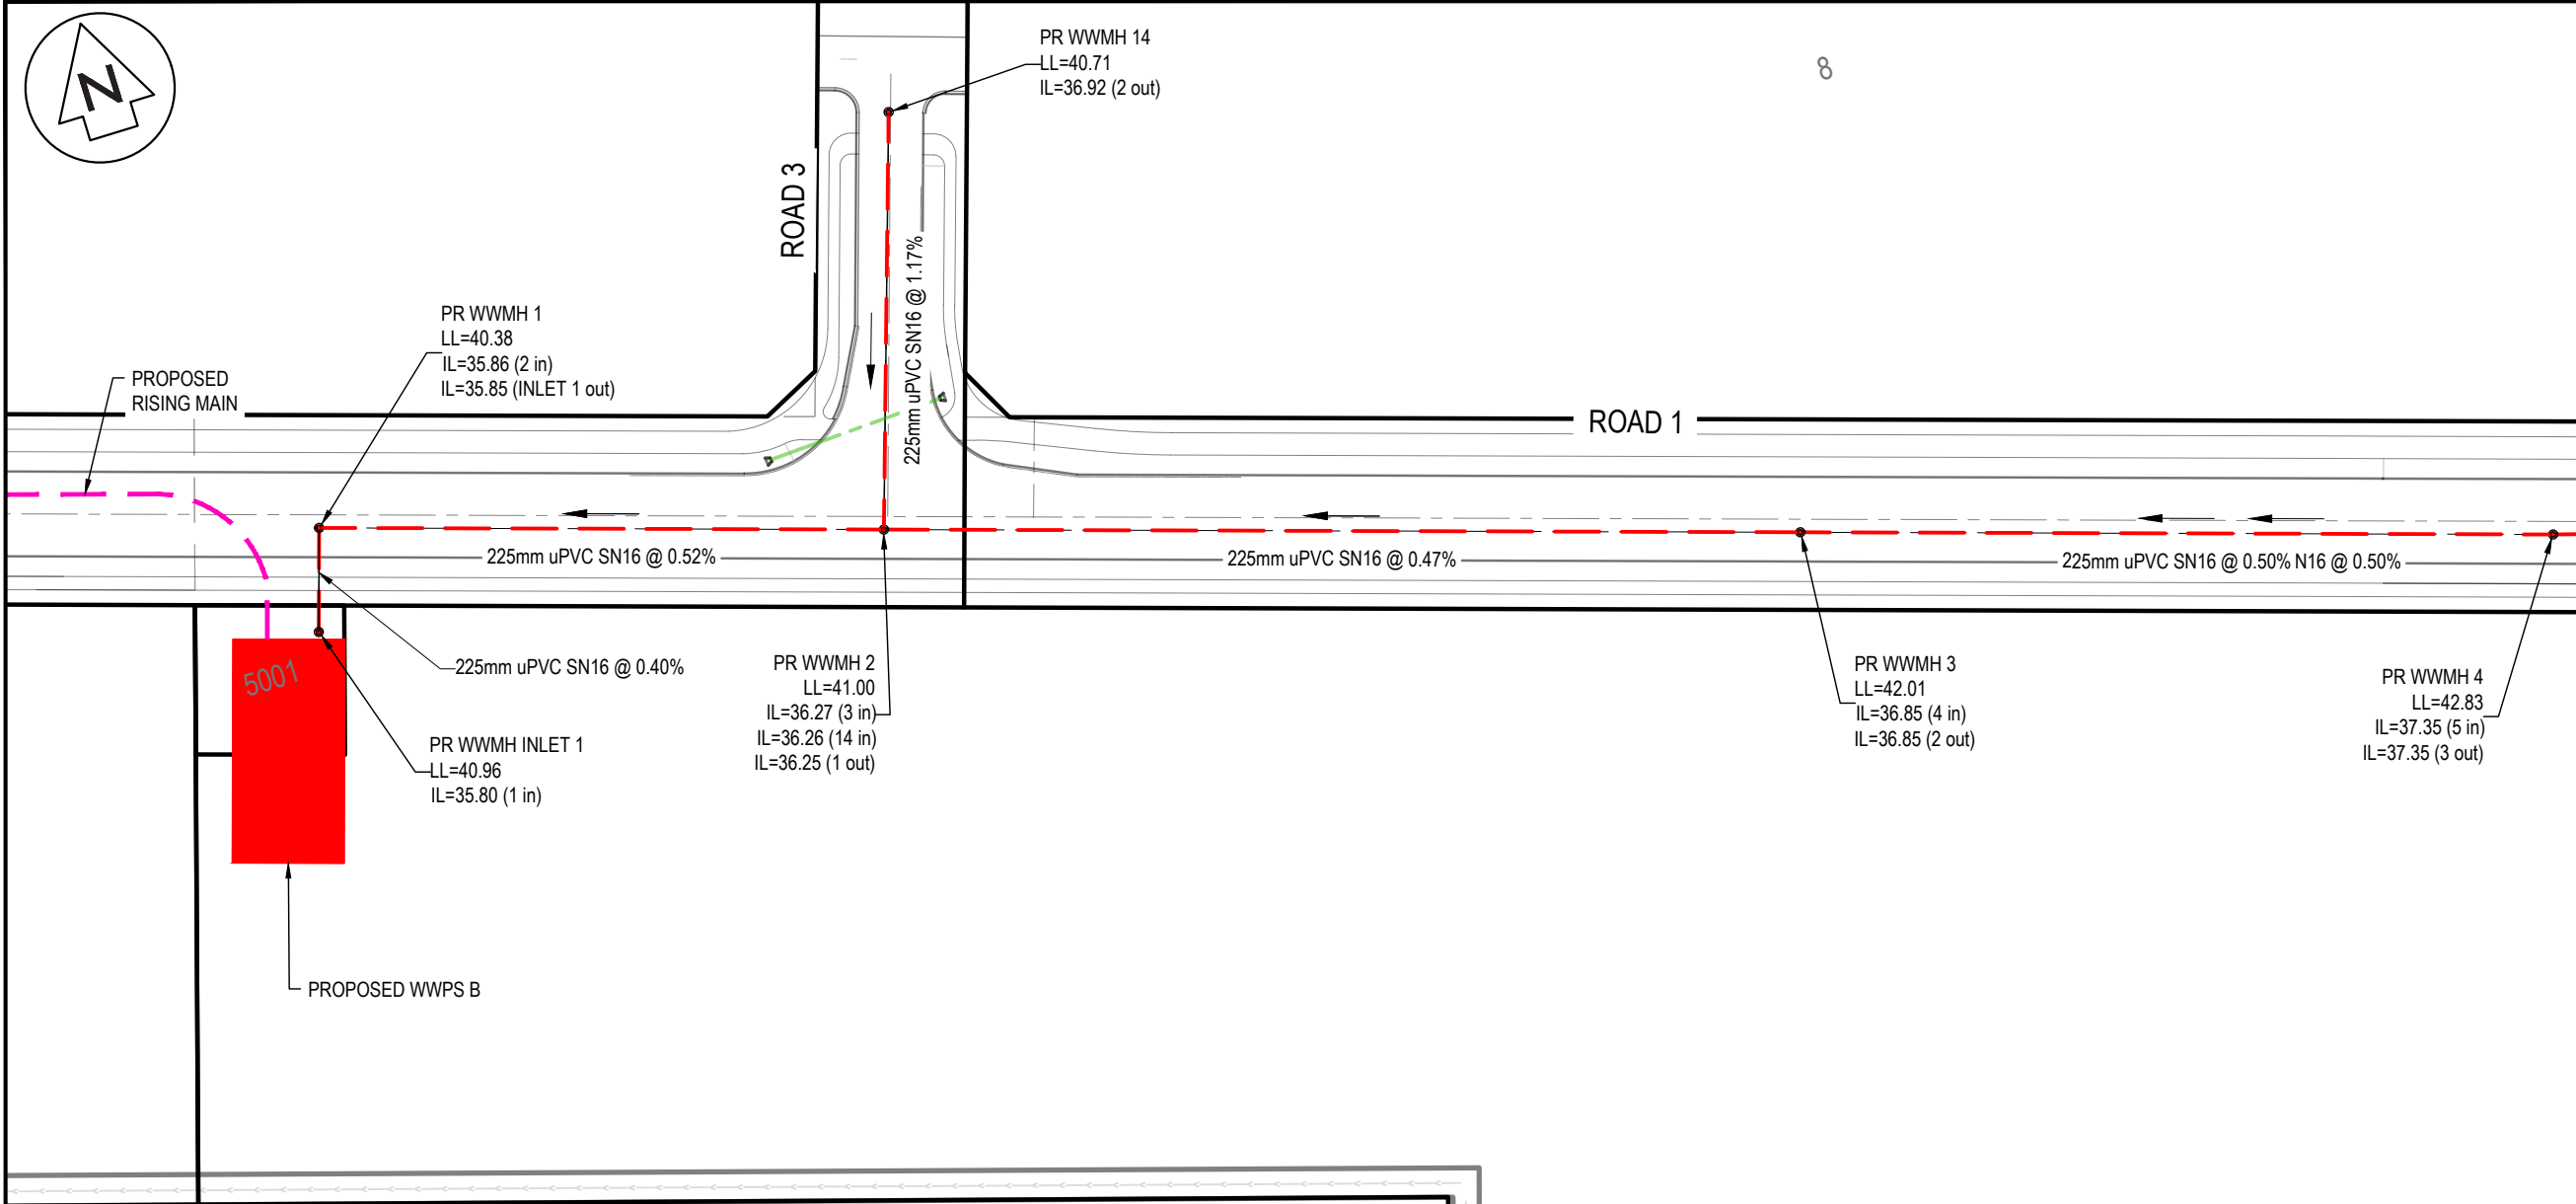

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL ROAD CROSSINGS TO COUNCIL STANDARDS.
 5. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS. ALL MANHOLES SHALL HAVE STAINLESS GRATES INSTALLED.
 6. ALL LINES ARE TO BE 150mmØ PVC CLASS SN16 UNLESS SHOWN OTHERWISE.
 7. 150mmØ PIPES THAT DO NOT TERMINATE IN A MANHOLE MUST BE TERMINATED WITH A 100mmØ ON A 150mmØ LONDON JUNCTION AND BLANK CAP.
 8. MANHOLE DIAMETERS SHOWN ON STRUCTURE LABEL ARE INTERNAL DIAMETER.
 9. MEASUREMENTS SHOWN ON LOT CONNECTIONS ARE DISTANCE TO CENTER OF LOT CONNECTION FROM THE NEAREST DOWNSTREAM MANHOLE.

LEGEND	
	EX BDY
	PROP BDY
	EX WASTEWATER
	PROP WASTEWATER
	PROP RISING MAIN
	EX/PROP WWMH
	PR WW LOT CON
	EX STORMWATER
	PR STORMWATER
	EX/PROP SWMH
	PROP SWCP SINGLE
	PROP SWCP DOUBLE
	PR LOT CONNECTION

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	By	Date	
Survey	MAVEN	05/2025	
Design	MKS	04/2026	
Drawn	MKS	04/2026	
Checked	SM	09/2026	



Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project

SOUTHERN LINKS 1

INDUSTRIAL STAGE 1

HAMILTON, WAIKATO

FOR SL1

NORTHERN CONSORTIUM

Title


PROPOSED

WASTEWATER

PLAN

Project no.	298002		
Scale	1:1000 @ A3		
Cad file	298002-11-C500 WW.DWG		
Drawing no.	I1-C500-5	Rev	A

RESOURCE CONSENT

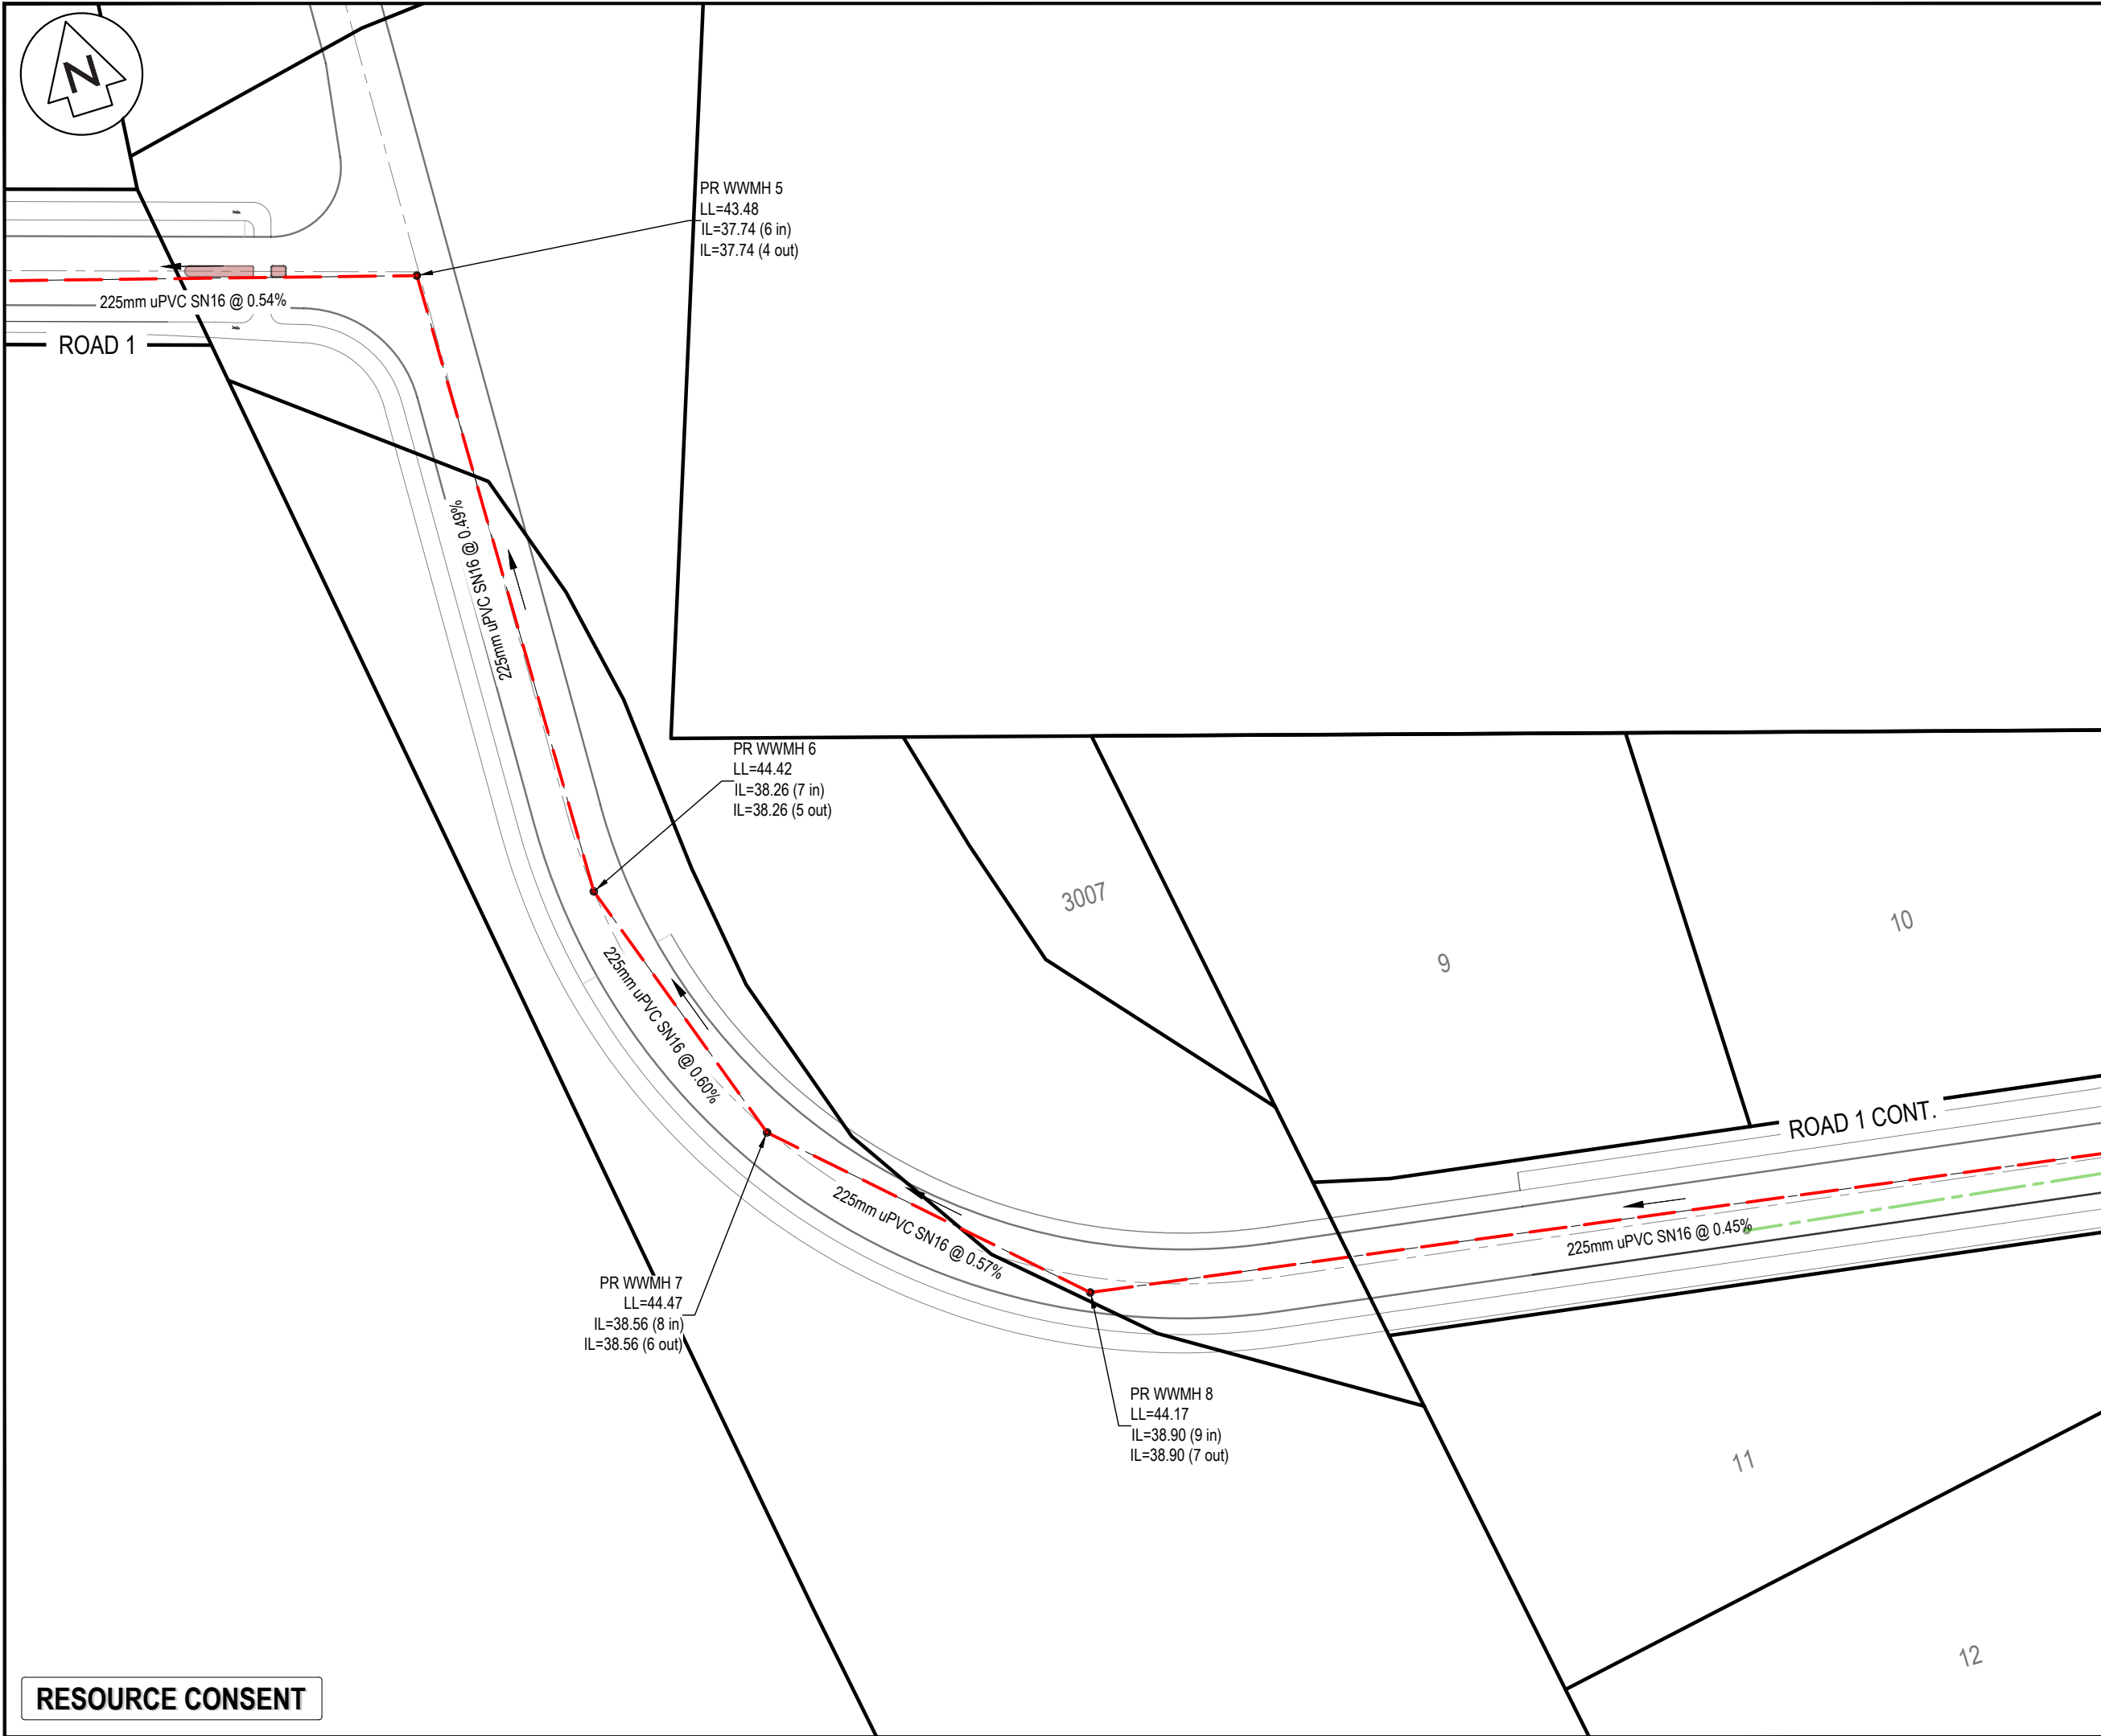

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL ROAD CROSSINGS TO COUNCIL STANDARDS.
 5. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS. ALL MANHOLES SHALL HAVE STAINLESS GRATES INSTALLED.
 6. ALL LINES ARE TO BE 150mmØ PVC CLASS SN16 UNLESS SHOWN OTHERWISE.
 7. 150mmØ PIPES THAT DO NOT TERMINATE IN A MANHOLE MUST BE TERMINATED WITH A 100mmØ ON A 150mmØ LONDON JUNCTION AND BLANK CAP.
 8. MANHOLE DIAMETERS SHOWN ON STRUCTURE LABEL ARE INTERNAL DIAMETER.
 9. MEASUREMENTS SHOWN ON LOT CONNECTIONS ARE DISTANCE TO CENTER OF LOT CONNECTION FROM THE NEAREST DOWNSTREAM MANHOLE.

LEGEND	
	EX BDY
	PROP BDY
	EX WASTEWATER
	PROP WASTEWATER
	PROP RISING MAIN
	EX/PROP WWMH
	PR WW LOT CON
	EX STORMWATER
	PR STORMWATER
	EX/PROP SWMH
	PROP SWCP SINGLE
	PROP SWCP DOUBLE
	PR LOT CONNECTION

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
		By	Date
Survey	MAVEN		05/2025
Design	MKS		04/2026
Drawn	MKS		04/2026
Checked	SM		09/2026




Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project
**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title
**PROPOSED
WASTEWATER
PLAN**

Project no.	298002		
Scale	1:1000 @ A3		
Cad file	298002-11-C500 WW.DWG		
Drawing no.	I1-C500-6	Rev	A

RESOURCE CONSENT



ROAD 4

ROAD 1

ROAD 4

PR WWMH 9
LL=42.90
IL=39.75 (10 in)
IL=39.76 (13 in)
IL=39.75 (8 out)

225mm uPVC SN16 @ 0.50%

225mm uPVC SN16 @ 1.73%

20

19

12

RESOURCE CONSENT

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL ROAD CROSSINGS TO COUNCIL STANDARDS.
 5. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS. ALL MANHOLES SHALL HAVE STAINLESS GRATES INSTALLED.
 6. ALL LINES ARE TO BE 150mmØ PVC CLASS SN16 UNLESS SHOWN OTHERWISE.
 7. 150mmØ PIPES THAT DO NOT TERMINATE IN A MANHOLE MUST BE TERMINATED WITH A 100mmØ ON A 150mmØ LONDON JUNCTION AND BLANK CAP.
 8. MANHOLE DIAMETERS SHOWN ON STRUCTURE LABEL ARE INTERNAL DIAMETER.
 9. MEASUREMENTS SHOWN ON LOT CONNECTIONS ARE DISTANCE TO CENTER OF LOT CONNECTION FROM THE NEAREST DOWNSTREAM MANHOLE.

LEGEND	
	EX BDY
	PROP BDY
	EX WASTEWATER
	PROP WASTEWATER
	PROP RISING MAIN
	EX/PROP WWMH
	PR WW LOT CON
	EX STORMWATER
	PR STORMWATER
	EX/PROP SWMH
	PROP SWCP SINGLE
	PROP SWCP DOUBLE
	PR LOT CONNECTION

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	Survey	MAVEN	05/2025
	Design	MKS	04/2026
	Drawn	MKS	04/2026
	Checked	SM	09/2026



Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand


Project

**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title

**PROPOSED
WASTEWATER
PLAN**

Project no.	298002		
Scale	1:1000 @ A3		
Cad file	298002-11-C500 WW.DWG		
Drawing no.	I1-C500-7	Rev	A



PR WWMH 10
LL=43.41
IL=41.76 (11 in)
IL=41.76 (9 out)

PR WWMH 11
LL=43.71
IL=42.17 (12 in)
IL=42.17 (10 out)

PR WWMH 12
LL=44.08
IL=42.64 (11 out)

225mm uPVC SN16 @ 0.53%

225mm uPVC SN 225mm uPVC SN16 @ 0.51%

ROAD 4

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL ROAD CROSSINGS TO COUNCIL STANDARDS.
 5. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS. ALL MANHOLES SHALL HAVE STAINLESS GRATES INSTALLED.
 6. ALL LINES ARE TO BE 150mmØ PVC CLASS SN16 UNLESS SHOWN OTHERWISE.
 7. 150mmØ PIPES THAT DO NOT TERMINATE IN A MANHOLE MUST BE TERMINATED WITH A 100mmØ ON A 150mmØ LONDON JUNCTION AND BLANK CAP.
 8. MANHOLE DIAMETERS SHOWN ON STRUCTURE LABEL ARE INTERNAL DIAMETER.
 9. MEASUREMENTS SHOWN ON LOT CONNECTIONS ARE DISTANCE TO CENTER OF LOT CONNECTION FROM THE NEAREST DOWNSTREAM MANHOLE.

LEGEND

	EX BDY
	PROP BDY
	EX WASTEWATER
	PROP WASTEWATER
	PROP RISING MAIN
	EX/PROP WWMH
	PR WW LOT CON
	EX STORMWATER
	PR STORMWATER
	EX/PROP SWMH
	PROP SWCP SINGLE
	PROP SWCP DOUBLE
	PR LOT CONNECTION

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
		By	Date
Survey	MAVEN		05/2025
Design	MKS		04/2026
Drawn	MKS		04/2026
Checked	SM		09/2026



Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project


**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title

**PROPOSED
WASTEWATER
PLAN**

Project no.	298002		
Scale	1:1000 @ A3		
Cad file	298002-11-C500 WW.DWG		
Drawing no.	I1-C500-8	Rev	A

RESOURCE CONSENT

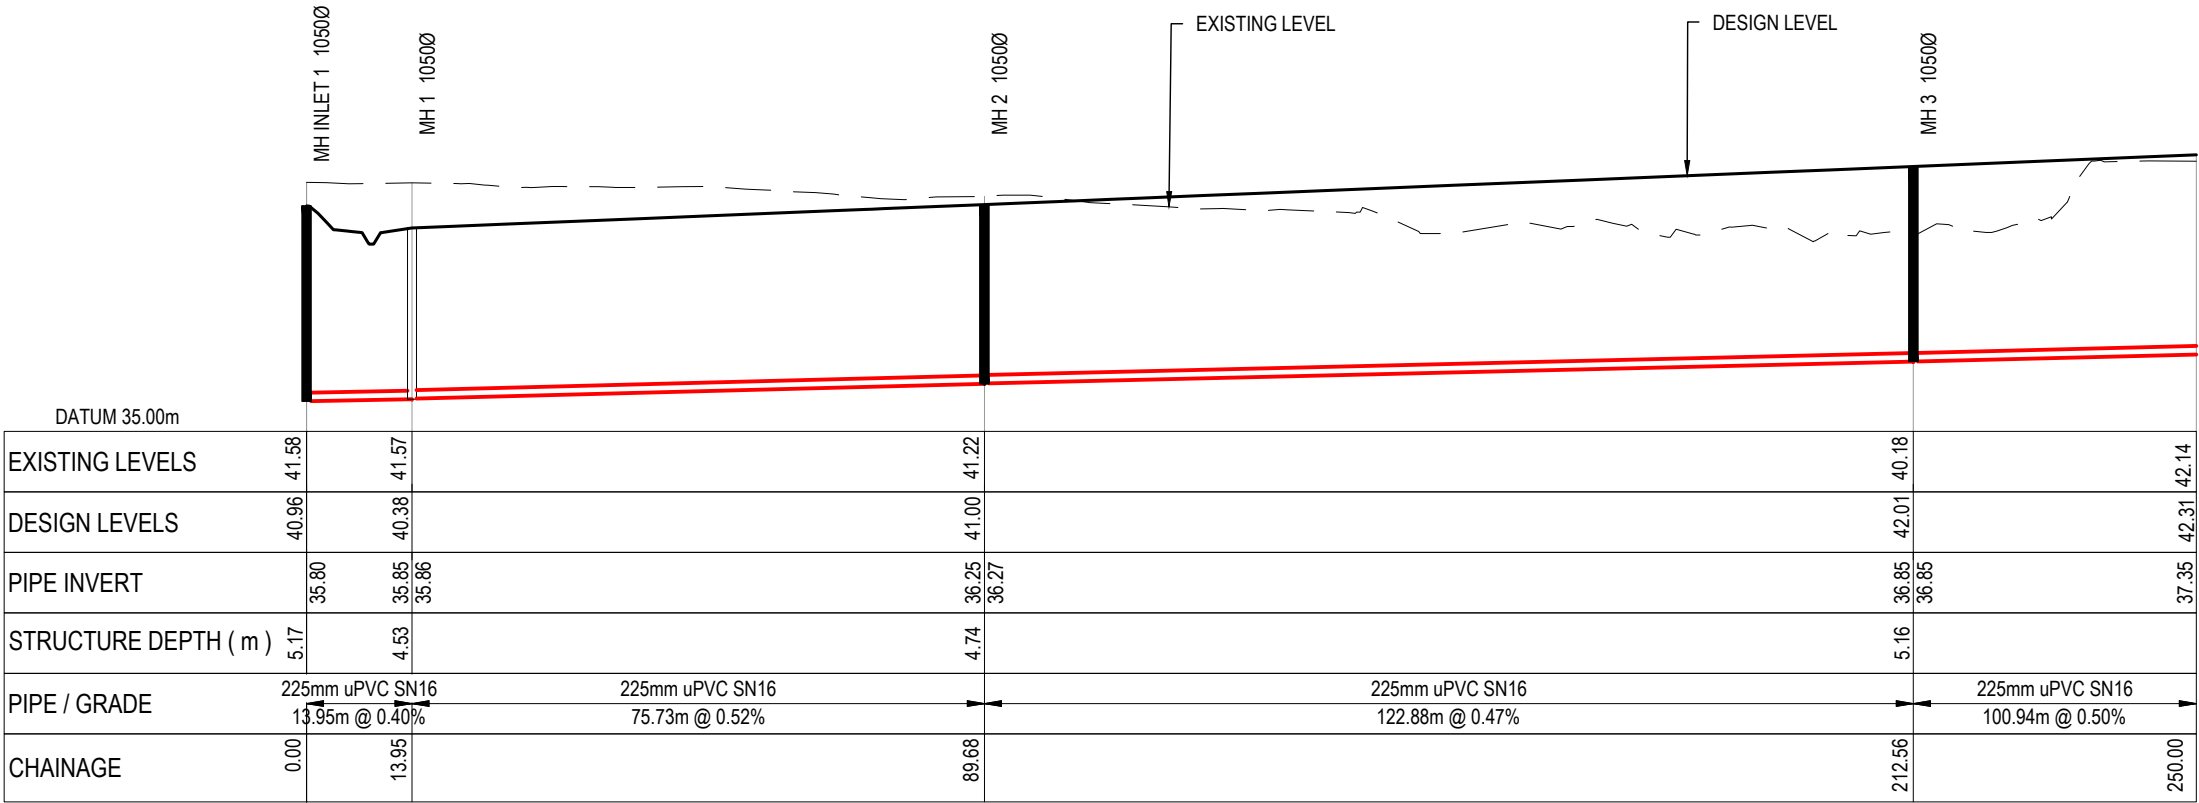


- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL ROAD CROSSINGS TO COUNCIL STANDARDS.
 5. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS. ALL MANHOLES SHALL HAVE STAINLESS GRATES INSTALLED.
 6. ALL LINES ARE TO BE 150mmØ PVC CLASS SN16 UNLESS SHOWN OTHERWISE.
 7. 150mmØ PIPES THAT DO NOT TERMINATE IN A MANHOLE MUST BE TERMINATED WITH A 100mmØ ON A 150mmØ LONDON JUNCTION AND BLANK CAP.
 8. MANHOLE DIAMETERS SHOWN ON STRUCTURE LABEL ARE INTERNAL DIAMETER.
 9. MEASUREMENTS SHOWN ON LOT CONNECTIONS ARE DISTANCE TO CENTER OF LOT CONNECTION FROM THE NEAREST DOWNSTREAM MANHOLE.

Legend

EX GROUND LEVEL

PROP GROUND LEVEL

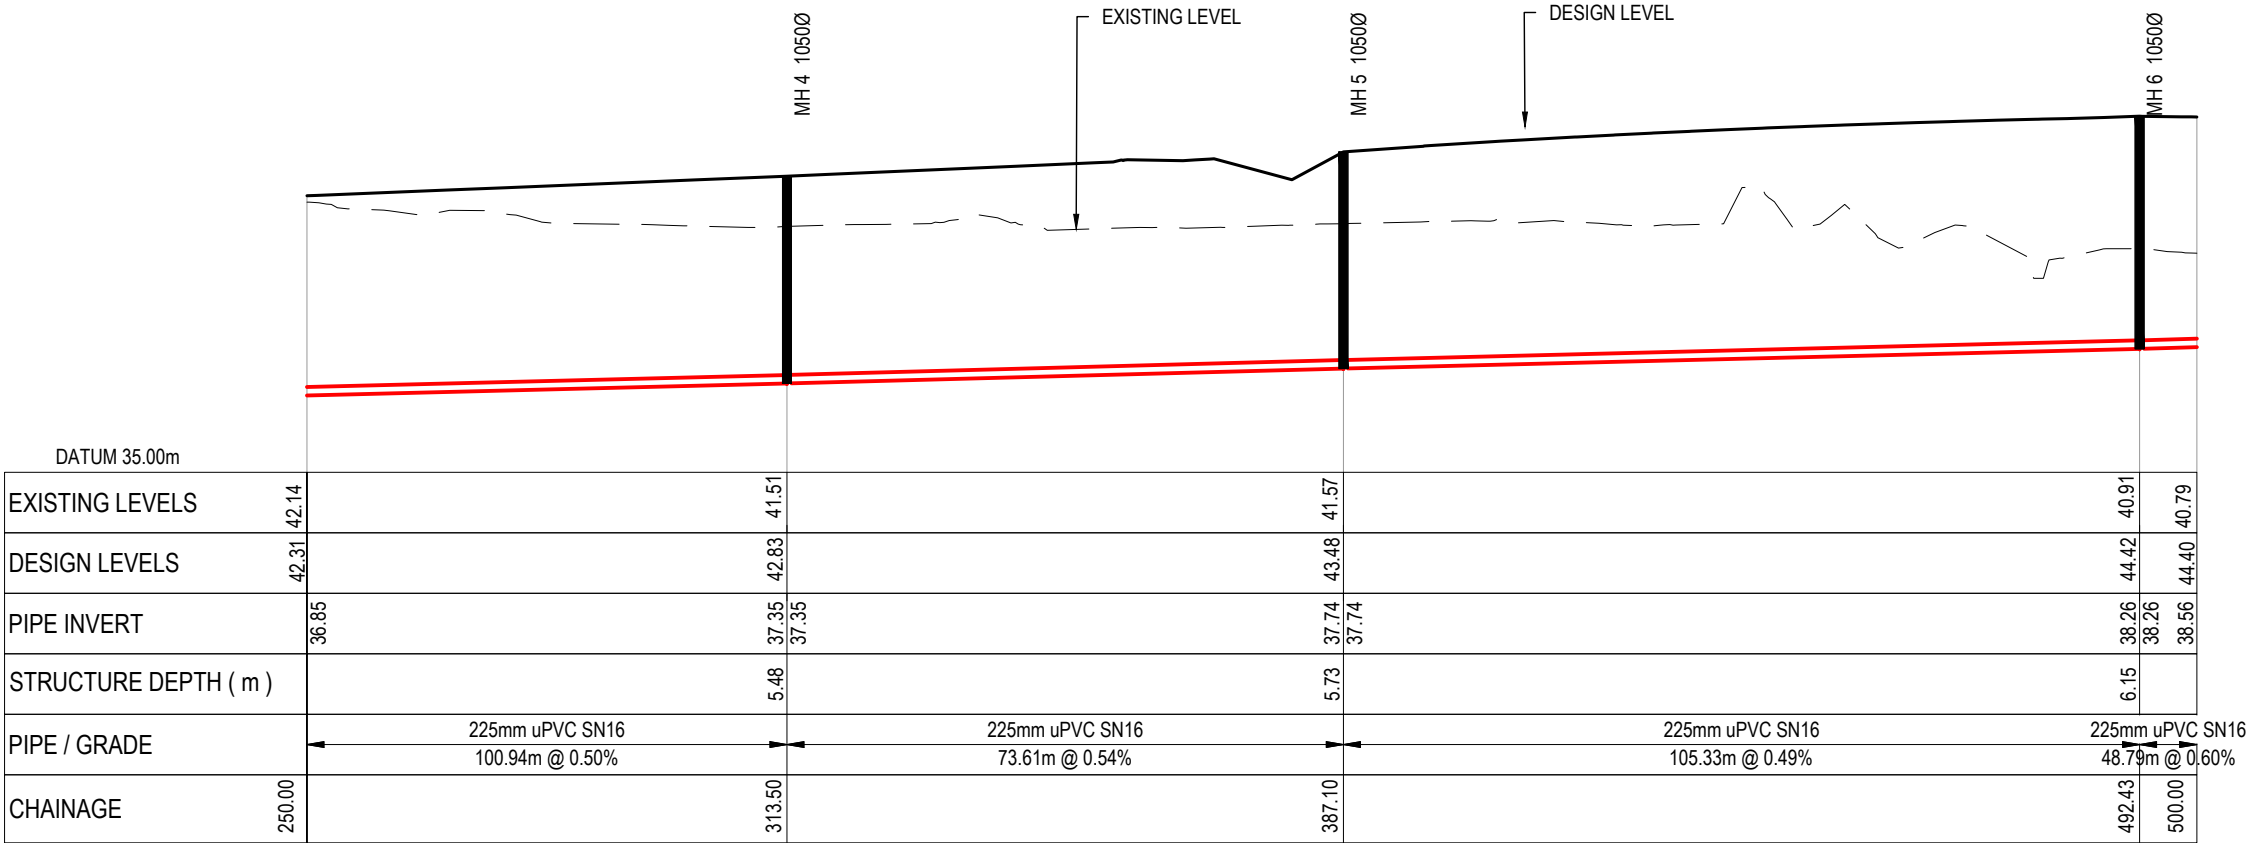

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
		By	Date
Survey	MAVEN		05/2025
Design	MKS		04/2026
Drawn	MKS		04/2026
Checked	SM		09/2026



Project

SOUTHERN LINKS 1

INDUSTRIAL STAGE 1

HAMILTON, WAIKATO

FOR SL1

NORTHERN CONSORTIUM

Title

PROPOSED

WASTEWATER


LONGSECTION

Project no.	298002
Scale	AS SHOWN
Cad file	298002-11-C500 WW.DWG
Drawing no.	I1-C520-1
Rev	A

RESOURCE CONSENT

LONGSECTION - CATCHMENT WW 1 CONT.

SCALE 1:1000 HORI & 1:200 VERTICAL @ A3

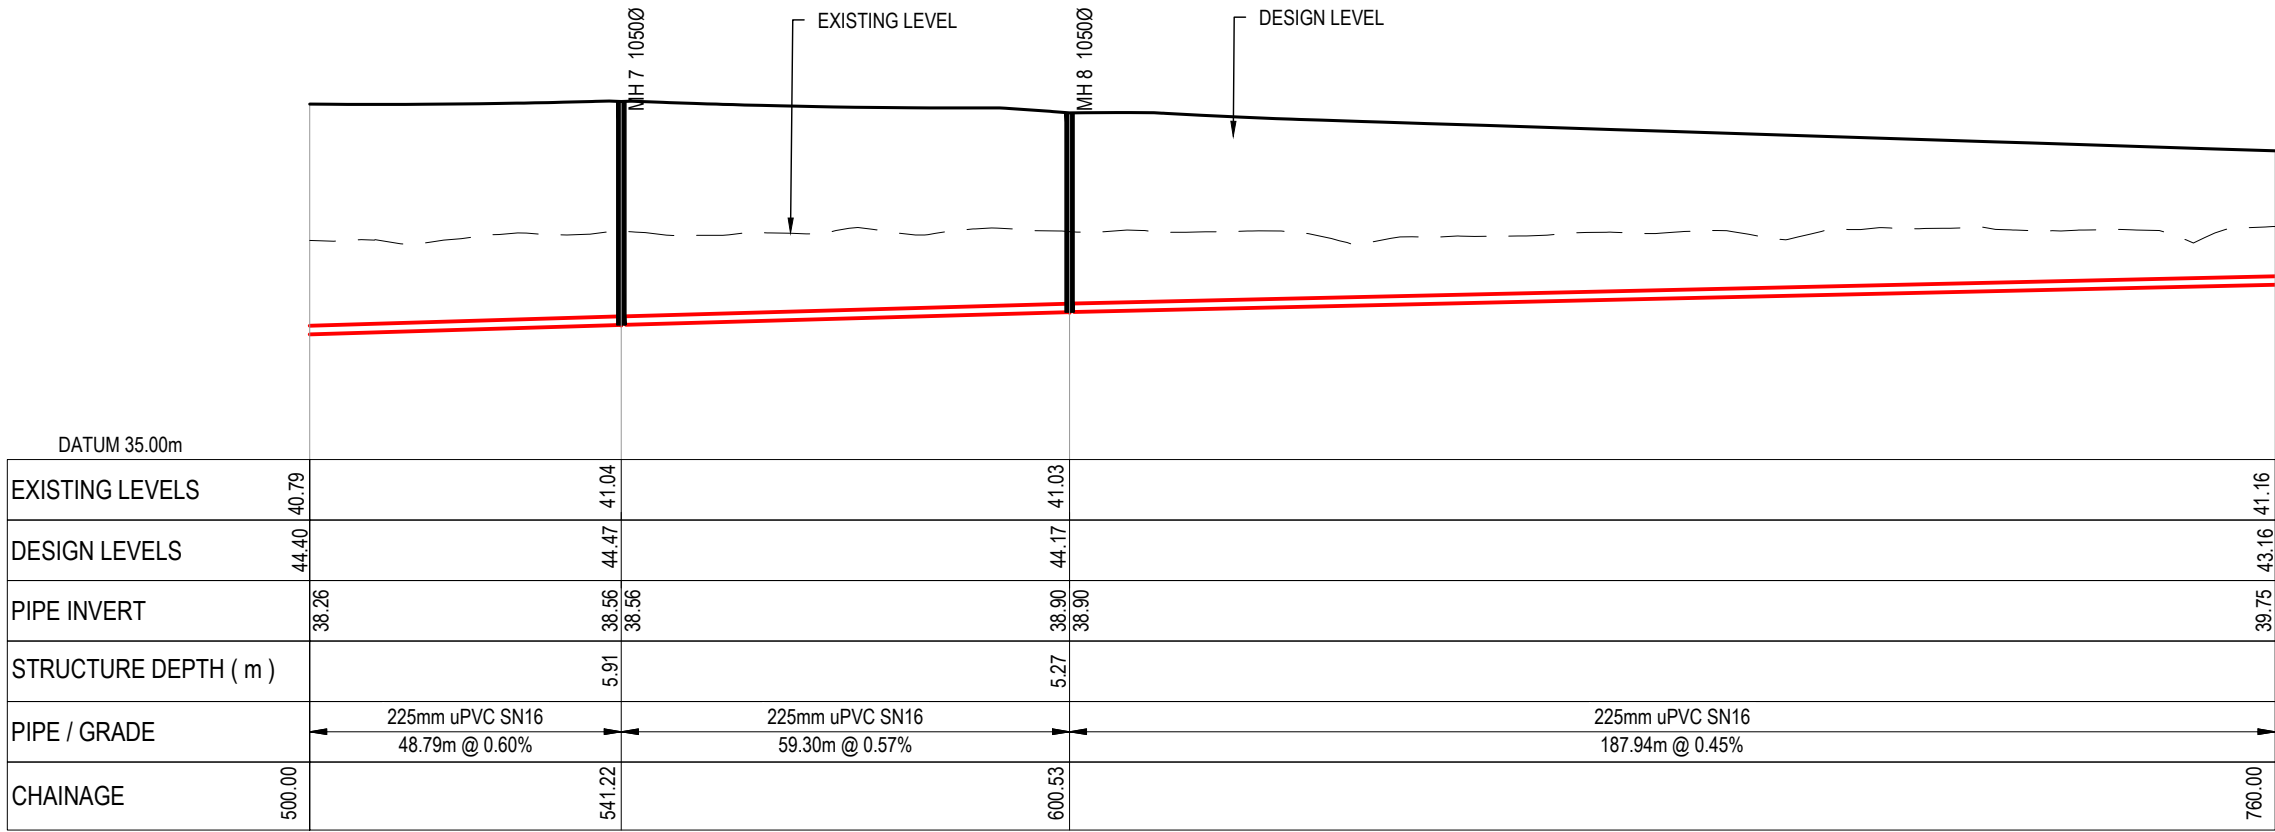


LONGSECTION - CATCHMENT WW 1 CONT.
SCALE 1:1000 HORI & 1:200 VERTICAL @ A3

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL ROAD CROSSINGS TO COUNCIL STANDARDS.
 5. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS. ALL MANHOLES SHALL HAVE STAINLESS GRATES INSTALLED.
 6. ALL LINES ARE TO BE 150mmØ PVC CLASS SN16 UNLESS SHOWN OTHERWISE.
 7. 150mmØ PIPES THAT DO NOT TERMINATE IN A MANHOLE MUST BE TERMINATED WITH A 100mmØ ON A 150mmØ LONDON JUNCTION AND BLANK CAP.
 8. MANHOLE DIAMETERS SHOWN ON STRUCTURE LABEL ARE INTERNAL DIAMETER.
 9. MEASUREMENTS SHOWN ON LOT CONNECTIONS ARE DISTANCE TO CENTER OF LOT CONNECTION FROM THE NEAREST DOWNSTREAM MANHOLE.

Legend

EX GROUND LEVEL

PROP GROUND LEVEL

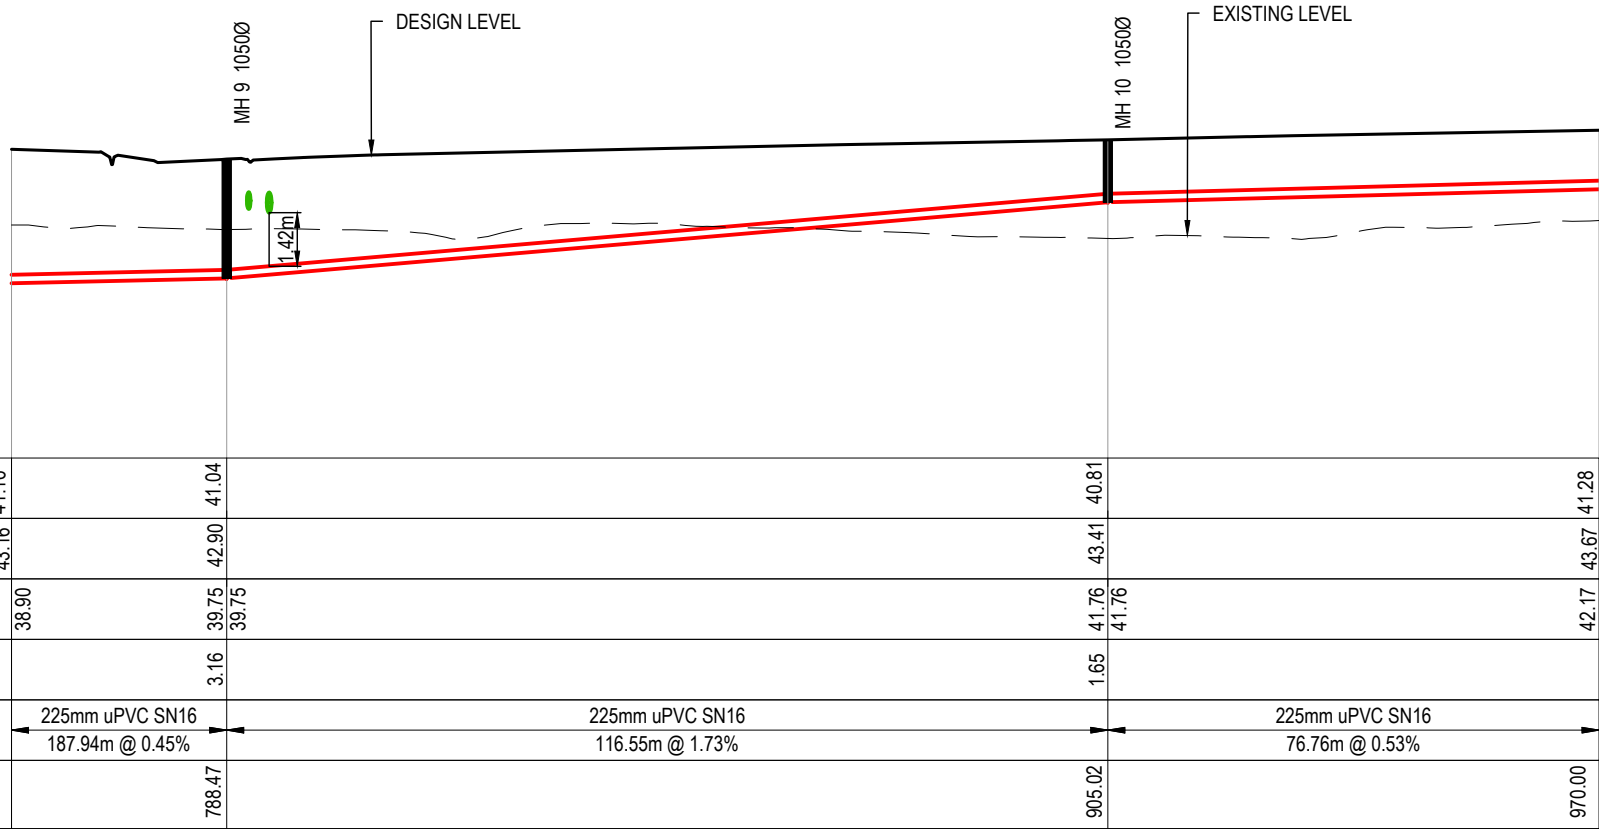

LONGSECTION - CATCHMENT WW 1 CONT.
SCALE 1:1000 HORI & 1:200 VERTICAL @ A3

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
		By	Date
Survey	MAVEN		05/2025
Design	MKS		04/2026
Drawn	MKS		04/2026
Checked	SM		09/2026



Project

SOUTHERN LINKS 1

INDUSTRIAL STAGE 1

HAMILTON, WAIKATO

FOR SL1

NORTHERN CONSORTIUM

Title

PROPOSED


WASTEWATER

LONGSECTION

Project no.	298002		
Scale	AS SHOWN		
Cad file	298002-11-C500 WW.DWG		
Drawing no.	I1-C520-2	Rev	A

RESOURCE CONSENT


DATE: 9/2/25 FILEPATH: F:\MAVEN\HAMILTON\6 PROJECTS\298002 - SUSTG\11\WG298002-H-C500 WW.DWG

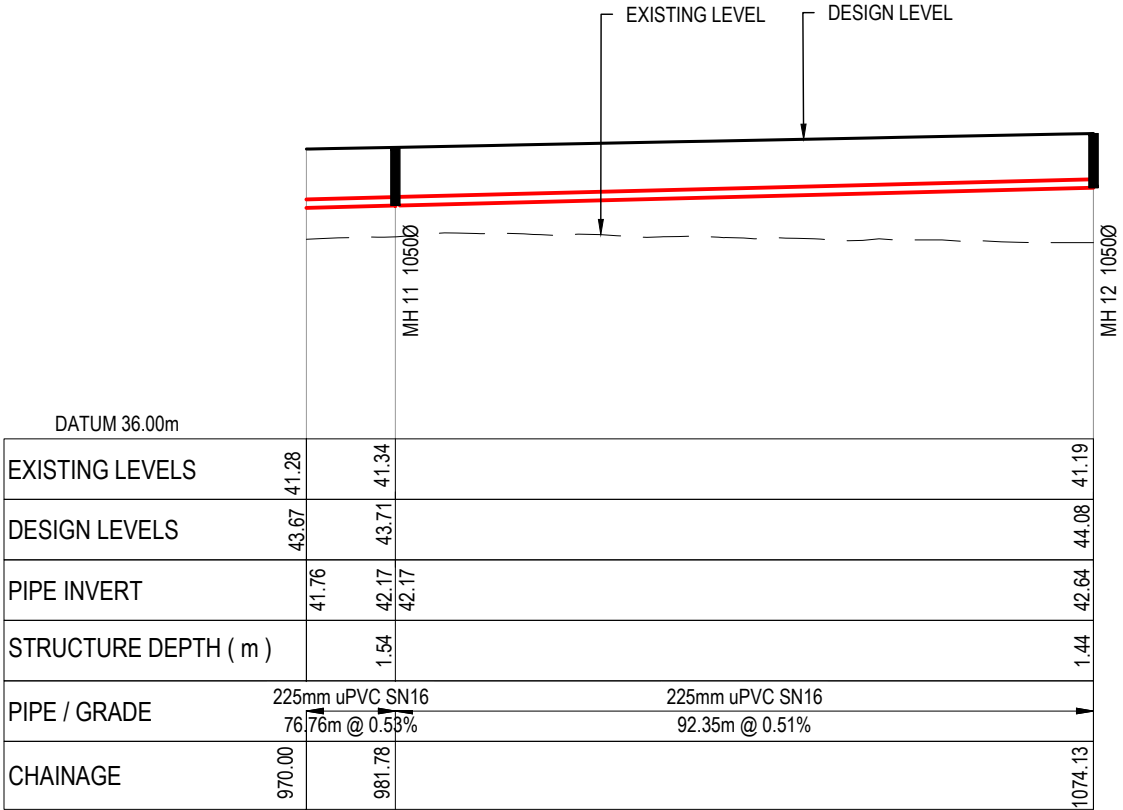

LONGSECTION - CATCHMENT WW 1 CONT.
SCALE 1:1000 HORI & 1:200 VERTICAL @ A3

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL ROAD CROSSINGS TO COUNCIL STANDARDS.
 5. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS. ALL MANHOLES SHALL HAVE STAINLESS GRATES INSTALLED.
 6. ALL LINES ARE TO BE 150mmØ PVC CLASS SN16 UNLESS SHOWN OTHERWISE.
 7. 150mmØ PIPES THAT DO NOT TERMINATE IN A MANHOLE MUST BE TERMINATED WITH A 100mmØ ON A 150mmØ LONDON JUNCTION AND BLANK CAP.
 8. MANHOLE DIAMETERS SHOWN ON STRUCTURE LABEL ARE INTERNAL DIAMETER.
 9. MEASUREMENTS SHOWN ON LOT CONNECTIONS ARE DISTANCE TO CENTER OF LOT CONNECTION FROM THE NEAREST DOWNSTREAM MANHOLE.

Legend
EX GROUND LEVEL
PROP GROUND LEVEL

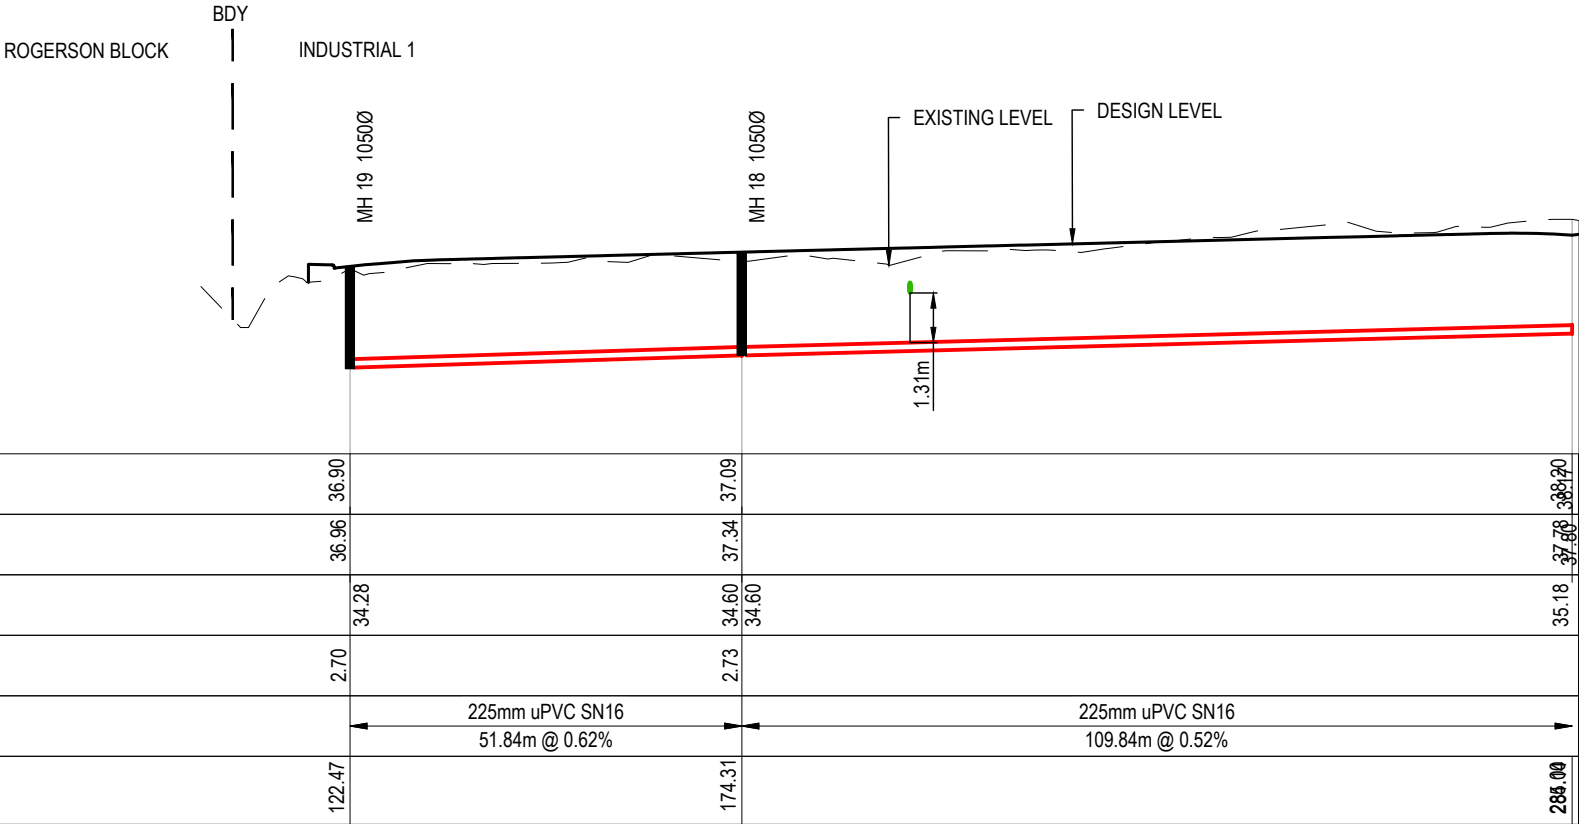

LONGSECTION - CATCHMENT WW 2
SCALE 1:1000 HORI & 1:200 VERTICAL @ A3

RESOURCE CONSENT

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
		By	Date
Survey	MAVEN		05/2025
Design	MKS		04/2026
Drawn	MKS		04/2026
Checked	SM		09/2026




Project
**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title
**PROPOSED
WASTEWATER
LONGSECTION**


Project no.	298002		
Scale	AS SHOWN		
Cad file	298002-11-C500 WW.DWG		
Drawing no.	I1-C520-3	Rev	A

DATE: 9/2/26 FILEPATH: F:\MAVEN\HAMILTON\6. PROJECTS\298002 - SUSTG\11\DWG\298002-11-C500 WW.DWG

RESOURCE CONSENT

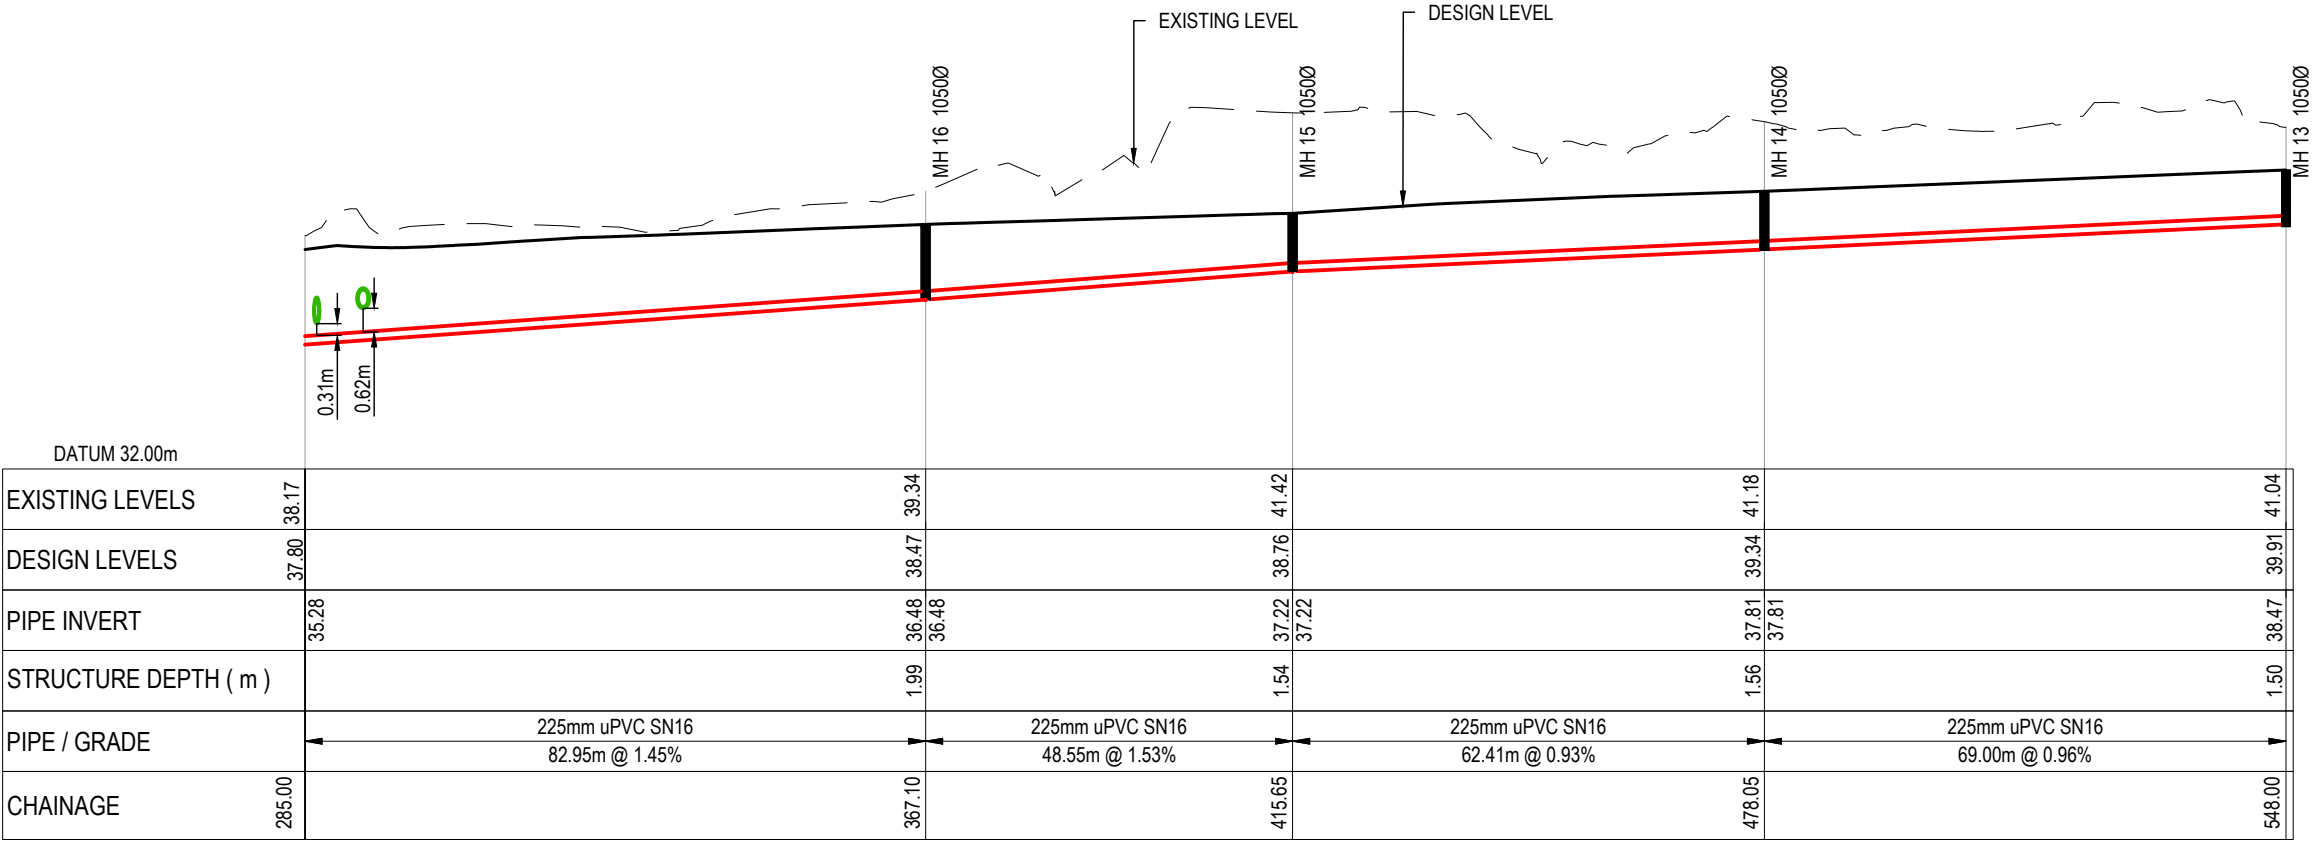

LONGSECTION - CATCHMENT WW 2 CONT.
SCALE 1:1000 HORI & 1:200 VERTICAL @ A3

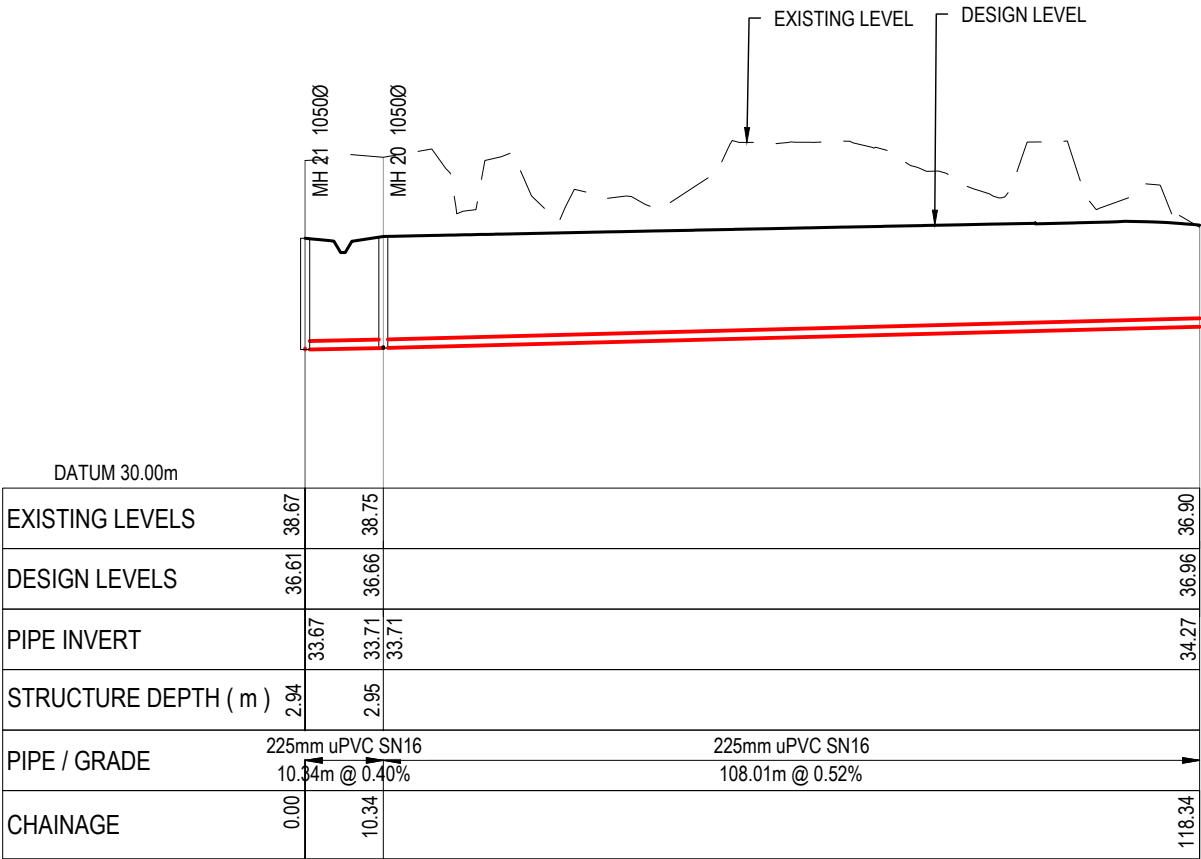

LONGSECTION - CATCHMENT WW 3
SCALE 1:1000 HORI & 1:200 VERTICAL @ A3

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL ROAD CROSSINGS TO COUNCIL STANDARDS.
 5. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS. ALL MANHOLES SHALL HAVE STAINLESS GRATES INSTALLED.
 6. ALL LINES ARE TO BE 150mmØ PVC CLASS SN16 UNLESS SHOWN OTHERWISE.
 7. 150mmØ PIPES THAT DO NOT TERMINATE IN A MANHOLE MUST BE TERMINATED WITH A 100mmØ ON A 150mmØ LONDON JUNCTION AND BLANK CAP.
 8. MANHOLE DIAMETERS SHOWN ON STRUCTURE LABEL ARE INTERNAL DIAMETER.
 9. MEASUREMENTS SHOWN ON LOT CONNECTIONS ARE DISTANCE TO CENTER OF LOT CONNECTION FROM THE NEAREST DOWNSTREAM MANHOLE.

Legend
EX GROUND LEVEL
PROP GROUND LEVEL

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
		By	Date
Survey	MAVEN		05/2025
Design	MKS		04/2026
Drawn	MKS		04/2026
Checked	SM		09/2026




Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project
**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title
**PROPOSED
WASTEWATER
LONGSECTION**

Project no.	298002
Scale	AS SHOWN
Cad file	298002-11-C500 WW.DWG
Drawing no.	I1-C520-4
Rev	A

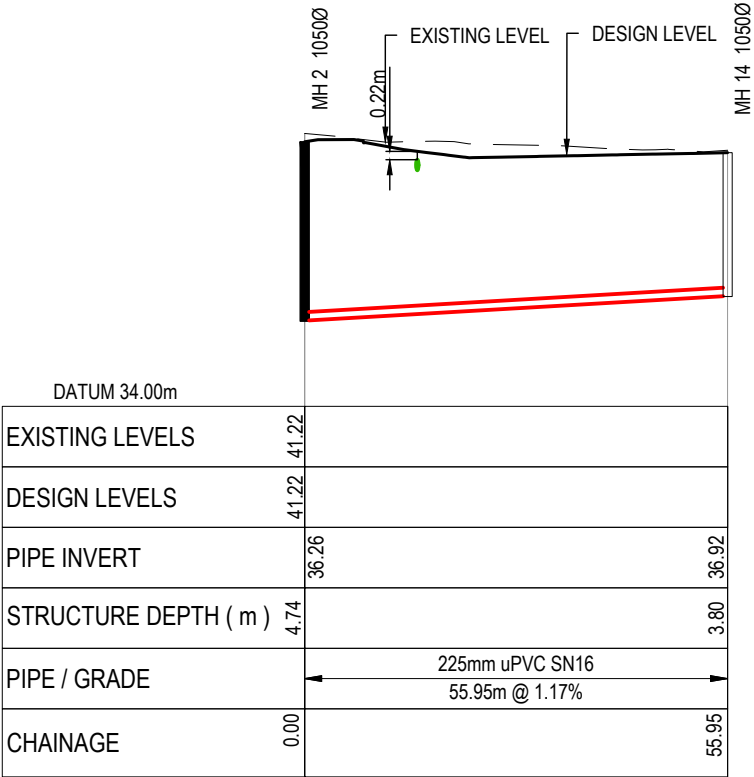

LONGSECTION - CATCHMENT WW 4
SCALE 1:1000 HORI & 1:200 VERTICAL @ A3

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL ROAD CROSSINGS TO COUNCIL STANDARDS.
 5. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS, ALL MANHOLES SHALL HAVE STAINLESS GRATES INSTALLED.
 6. ALL LINES ARE TO BE 150mmØ PVC CLASS SN16 UNLESS SHOWN OTHERWISE.
 7. 150mmØ PIPES THAT DO NOT TERMINATE IN A MANHOLE MUST BE TERMINATED WITH A 100mmØ ON A 150mmØ LONDON JUNCTION AND BLANK CAP.
 8. MANHOLE DIAMETERS SHOWN ON STRUCTURE LABEL ARE INTERNAL DIAMETER.
 9. MEASUREMENTS SHOWN ON LOT CONNECTIONS ARE DISTANCE TO CENTER OF LOT CONNECTION FROM THE NEAREST DOWNSTREAM MANHOLE.

Legend

EX GROUND LEVEL

PROP GROUND LEVEL

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	By	Date	
Survey	MAVEN	05/2025	
Design	MKS	04/2026	
Drawn	MKS	04/2026	
Checked	SM	09/2026	

M

MAVEN

Maven Waikato

07 242 0601

info@maven.co.nz

www.maven.co.nz

Level 1 286 Victoria Street, Hamilton

New Zealand

Project

SOUTHERN LINKS 1

INDUSTRIAL STAGE 1

HAMILTON, WAIKATO

FOR SL1

NORTHERN CONSORTIUM

Title

PROPOSED

WASTEWATER


LONGSECTION

Project no.	298002		
Scale	AS SHOWN		
Cad file	298002-11-C500 WW.DWG		
Drawing no.	I1-C520-5	Rev	A

RESOURCE CONSENT

DATE: 9/2/26 FILEPATH: F:\MAVEN\HAMILTON\6 PROJECTS\298002 - SUSTAINABLE WASTE\298002-11-C500 WW.DWG

RESOURCE CONSENT

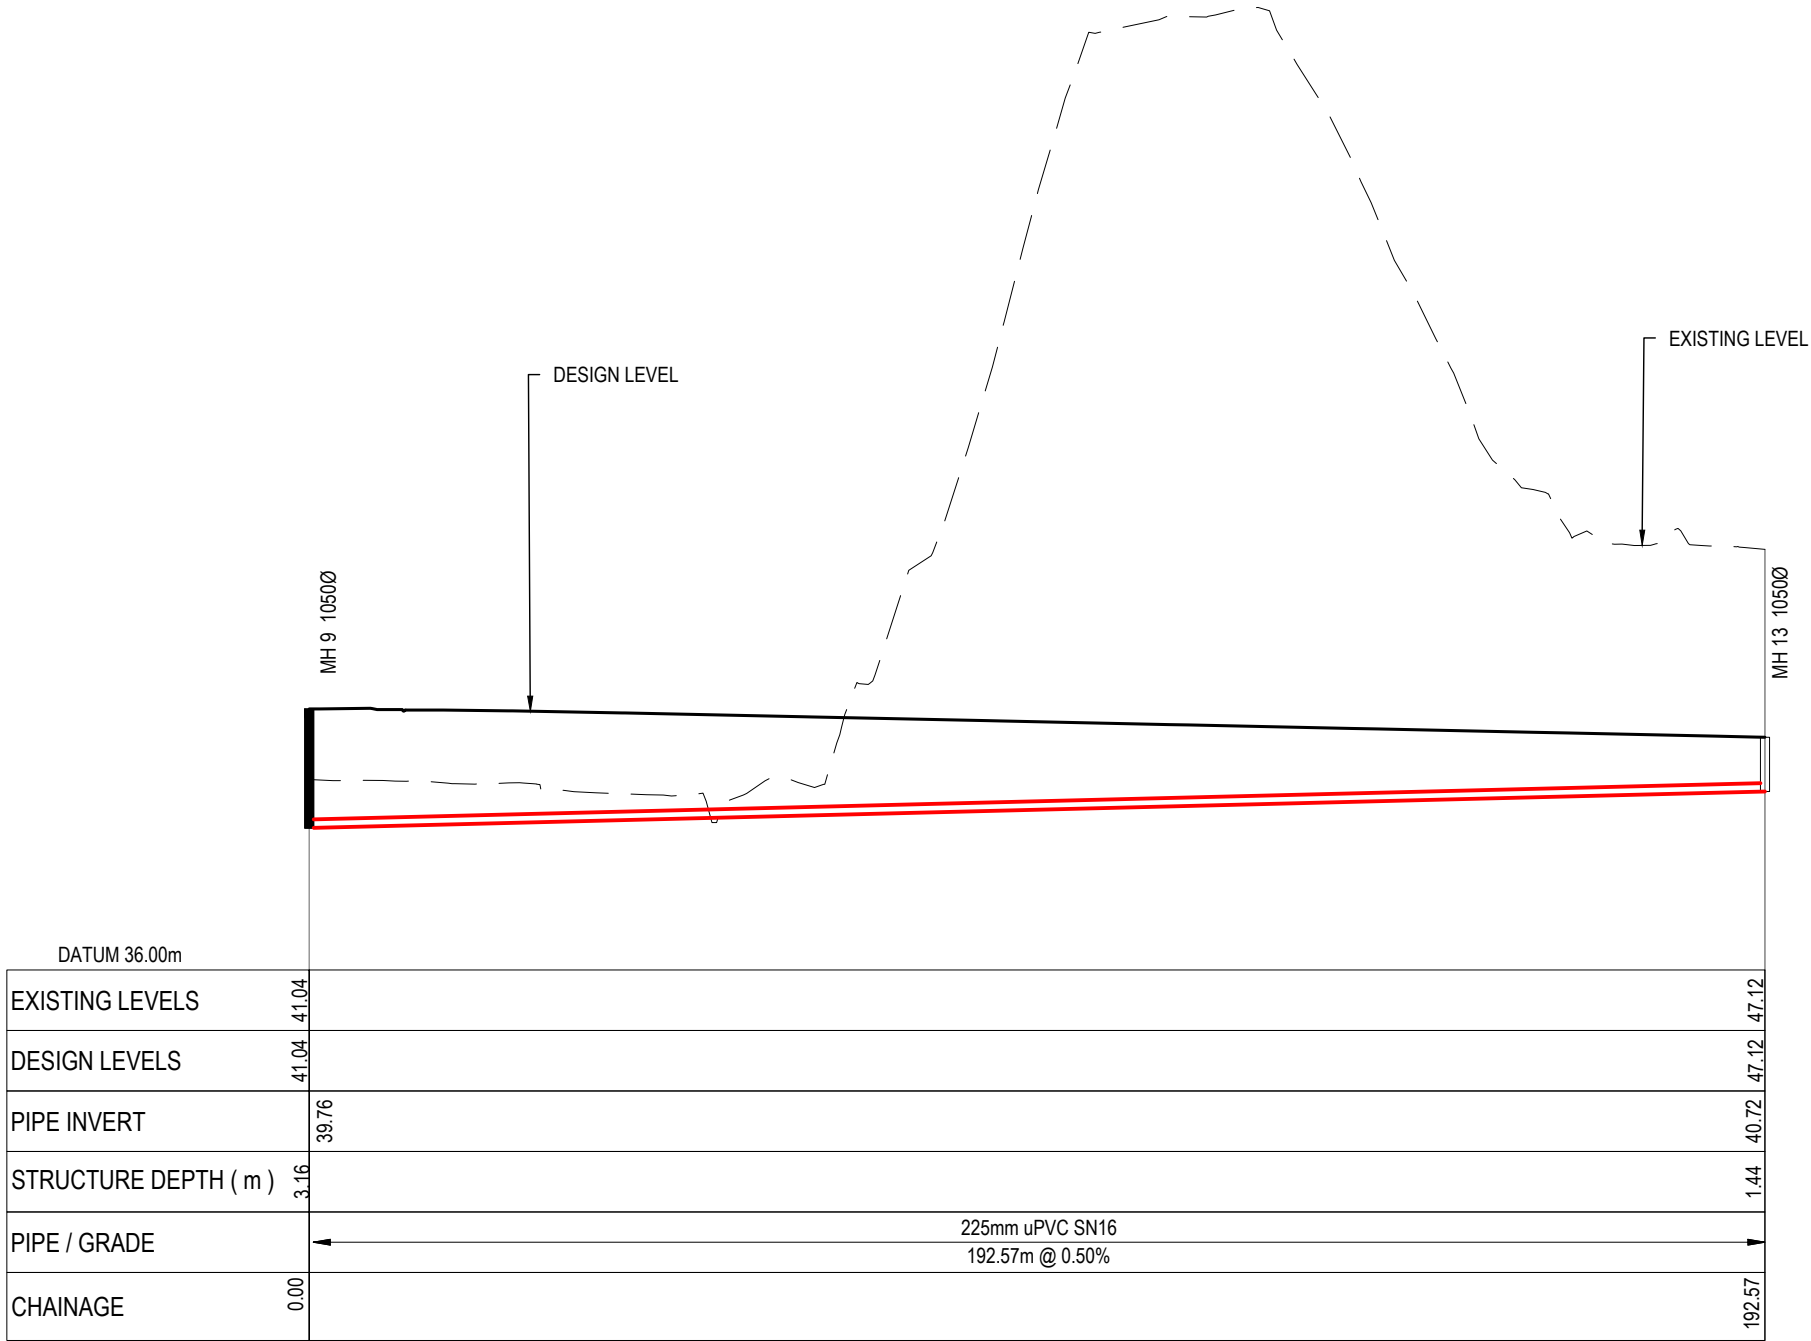

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL ROAD CROSSINGS TO COUNCIL STANDARDS.
 5. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS. ALL MANHOLES SHALL HAVE STAINLESS GRATES INSTALLED.
 6. ALL LINES ARE TO BE 150mmØ PVC CLASS SN16 UNLESS SHOWN OTHERWISE.
 7. 150mmØ PIPES THAT DO NOT TERMINATE IN A MANHOLE MUST BE TERMINATED WITH A 100mmØ ON A 150mmØ LONDON JUNCTION AND BLANK CAP.
 8. MANHOLE DIAMETERS SHOWN ON STRUCTURE LABEL ARE INTERNAL DIAMETER.
 9. MEASUREMENTS SHOWN ON LOT CONNECTIONS ARE DISTANCE TO CENTER OF LOT CONNECTION FROM THE NEAREST DOWNSTREAM MANHOLE.

Legend

EX GROUND LEVEL

PROP GROUND LEVEL

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
		By	Date
Survey	MAVEN		05/2025
Design	MKS		04/2026
Drawn	MKS		04/2026
Checked	SM		09/2026



Project

SOUTHERN LINKS 1

INDUSTRIAL STAGE 1

HAMILTON, WAIKATO

FOR SL1

NORTHERN CONSORTIUM


Title

PROPOSED


WASTEWATER

LONGSECTION

Project no.	298002		
Scale	AS SHOWN		
Cad file	298002-11-C500 WW.DWG		
Drawing no.	I1-C520-6	Rev	A

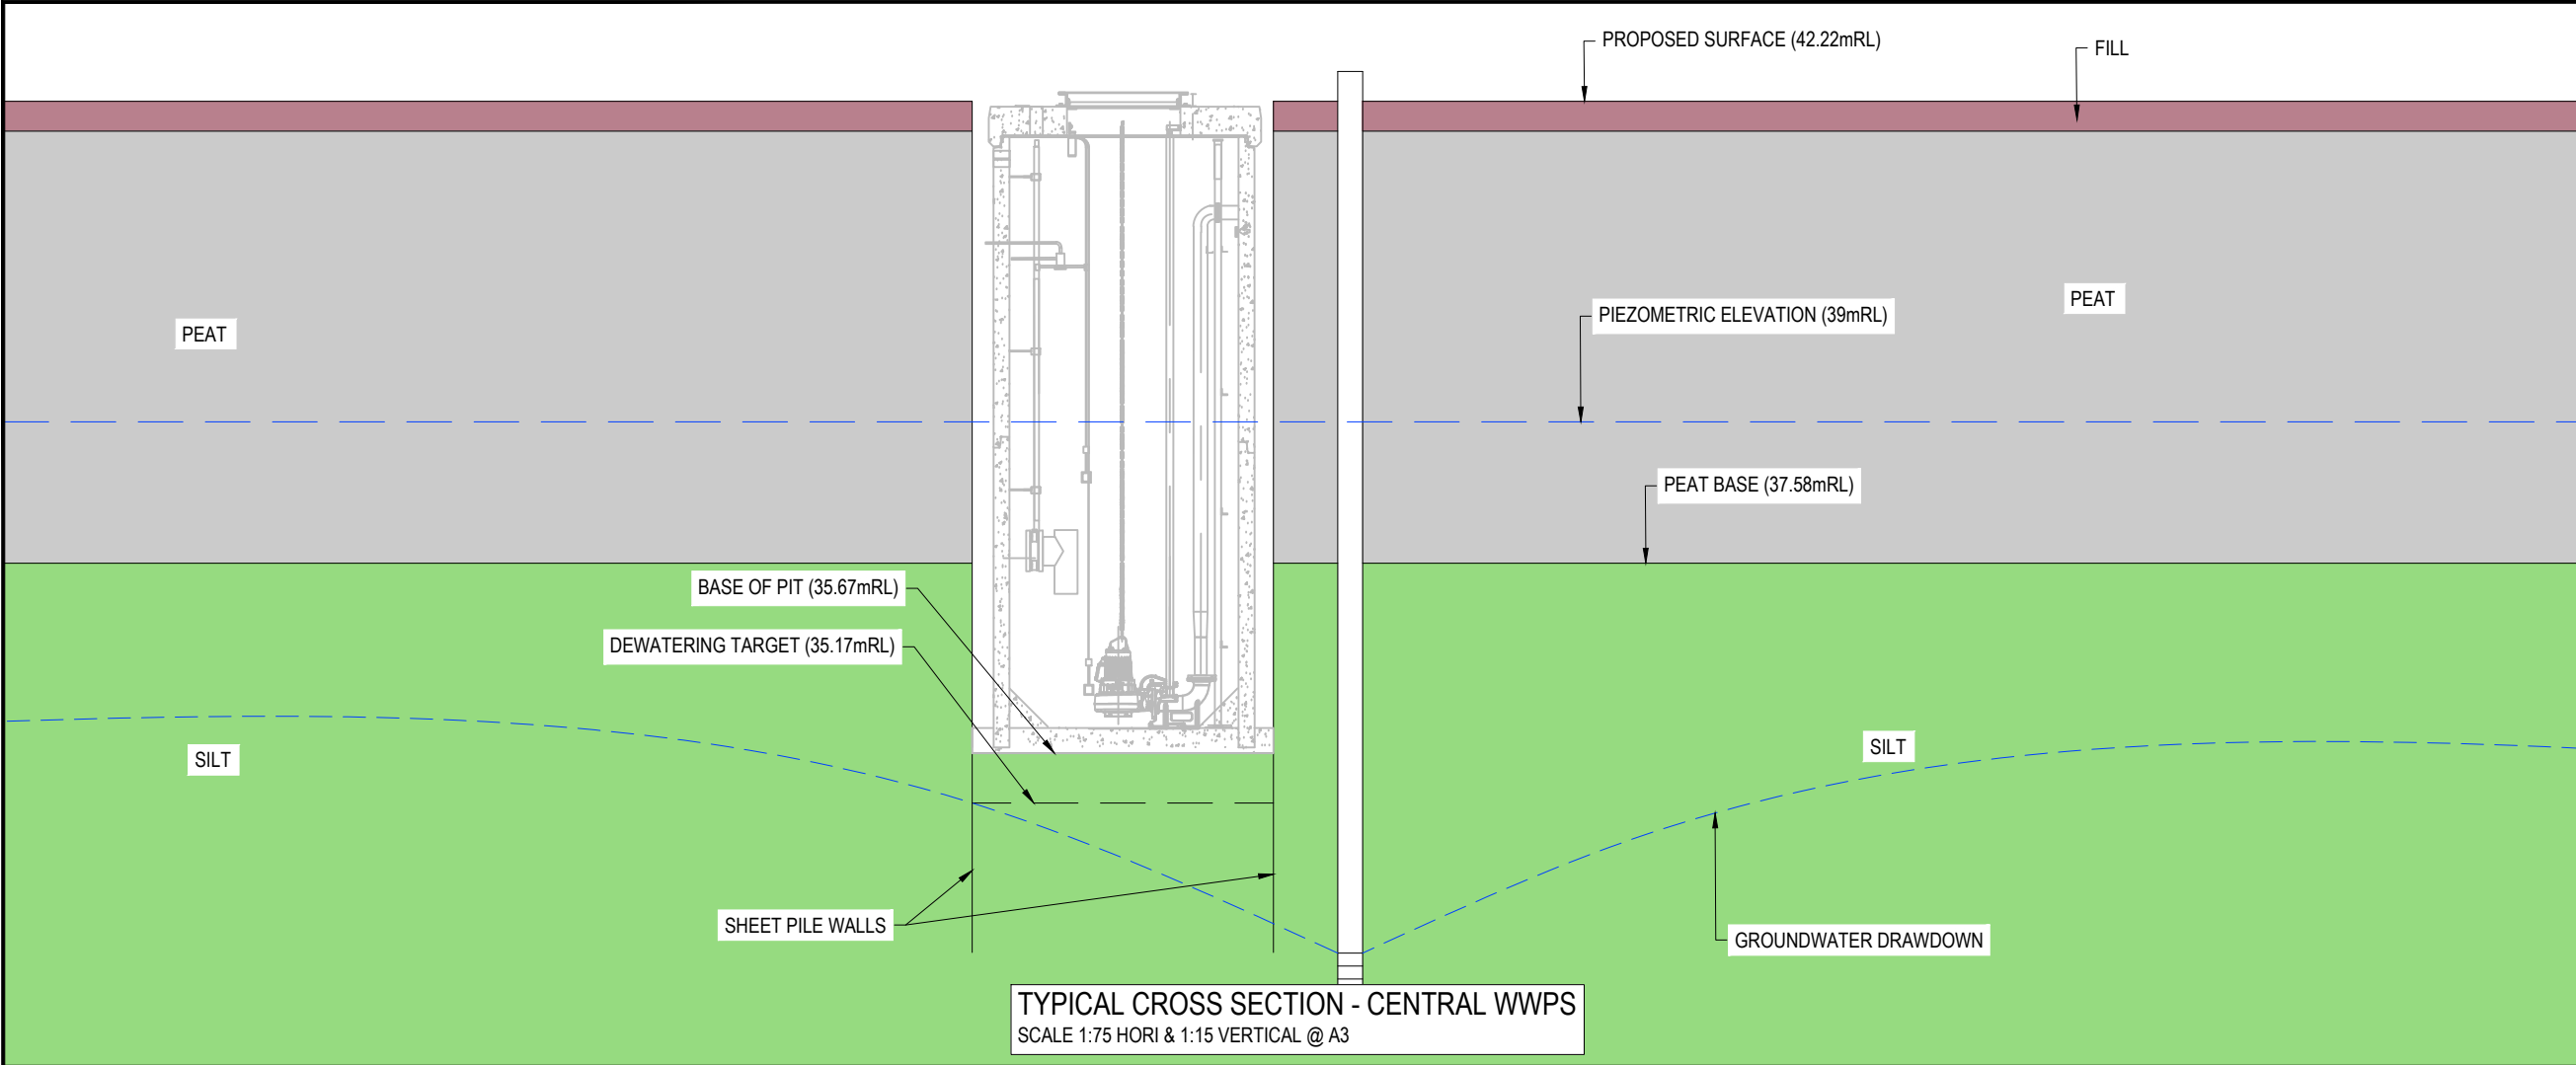

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000.
 3. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016.
 4. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 5. ALL CONCRETE SW PIPE TO BE INSTALLED IN ACCORDANCE WITH AS/NZS 3725:2007 FOR BURIED CONCRETE PIPES AND AS/NZ 4058:2007 FOR PRECAST CONCRETE PIPES (PRESSURE AND NON-PRESSURE) AS STIPULATED IN THE RITS 2018
 6. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL STORMWATER LINES WITHIN THE ROAD RESERVE.
 7. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS.
 8. ALL CESSPIT LEADS SHALL HAVE MIN COVER 0.9m.
 9. ALL LINES ARE TO BE CLASS4 RCRRJ UNLESS SHOWN OTHERWISE.
 10. ALL LINES TO BE ABANDONED SHALL BE SEALED AT EACH END. TIMING OF ALL SEALING TO BE COORDINATED WITH COUNCIL STAFF.

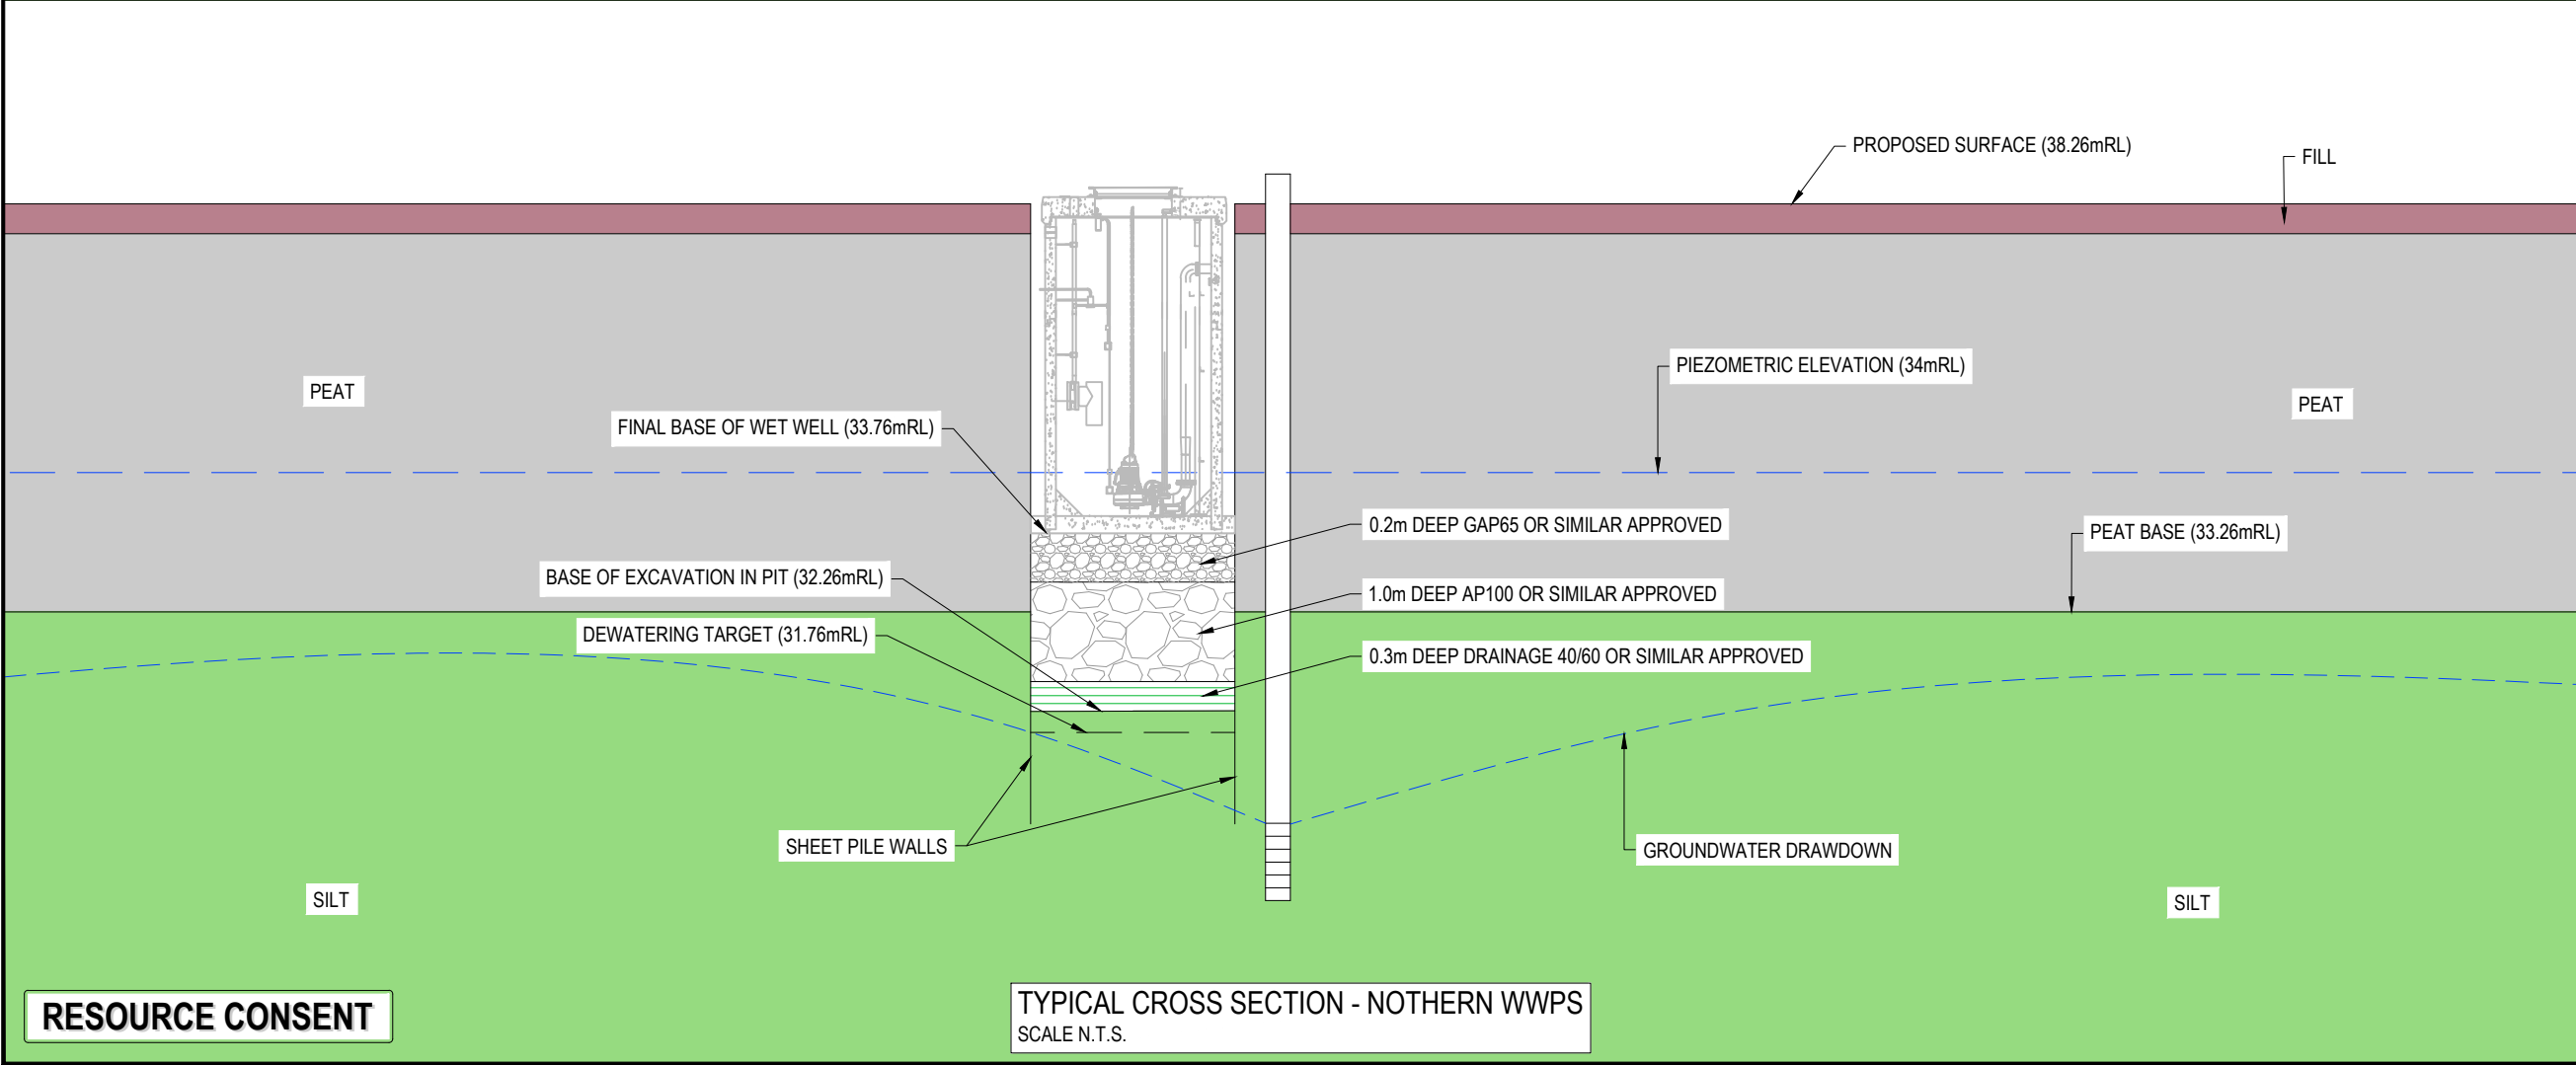

A	FAST TRACK APP	MKS	09/2026
Rev	Description	By	Date
		By	Date
Survey	MAVEN		05/2025
Design	MKS		06/2026
Drawn	MKS		06/2026
Checked	SM		09/2026



Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand



Project
**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title
**PROPOSED
WWPS TYPICAL
CROSS SECTIONS**



Project no.	298002-11 SL1		
Scale	AS SHOWN		
Cad file	298002-11-C550 WWPS TYPICAL XS.DWG		
Drawing no.	I1-C550-1	Rev	A

DATE: 9/1/26 FILE PATH: \\MAVEN\MAVEN\CONSULTING\CO NZ\SHARE\CURRENT\WAIKATO\PROJECTS\298002-11 SL1\11-C550 WWPS TYPICAL XS.DWG

DATE: 8/21/26 FILE PATH: F:\MVEN\HAMILTON\6. PROJECTS\298002 - S1\STG1\11\W298002-R1-C580 WW STANDARD DETAILS.DWG

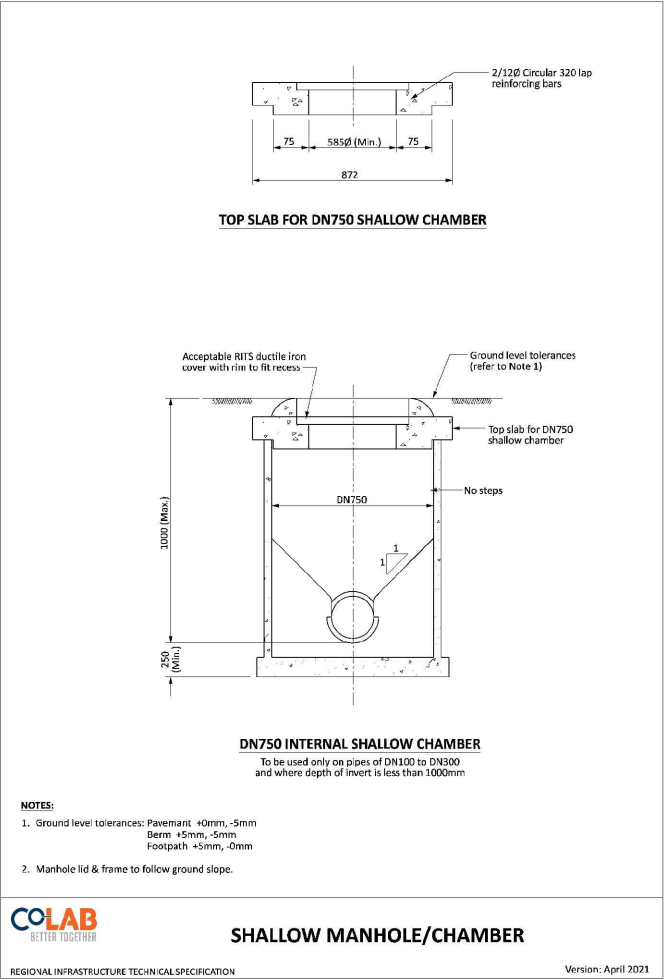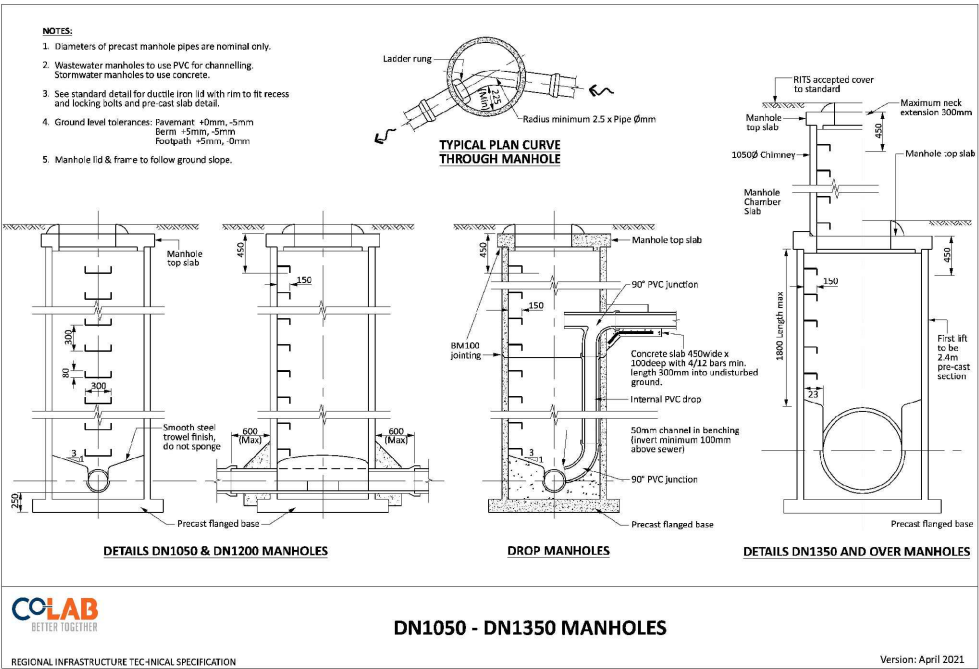

- NOTES
- ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 - CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 777m.
 - IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 - ALL CONCRETE SW PIPE TO BE INSTALLED IN ACCORDANCE WITH AS/NZS 3725:2007 FOR BURIED CONCRETE PIPES AND AS/NZ 4058:2007 FOR PRECAST CONCRETE PIPES (PRESSURE AND NON-PRESSURE) AS STIPULATED IN THE RITS 2018
 - APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL STORMWATER LINES WITHIN THE ROAD RESERVE.
 - HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS.
 - ALL CESSPIT LEADS SHALL HAVE MIN COVER 0.9m.
 - ALL LINES ARE TO BE CLASS4 RCRRJ UNLESS SHOWN OTHERWISE.
 - ALL LINES TO BE ABANDONED SHALL BE SEALED AT EACH END. TIMING OF ALL SEALING TO BE COORDINATED WITH COUNCIL STAFF.

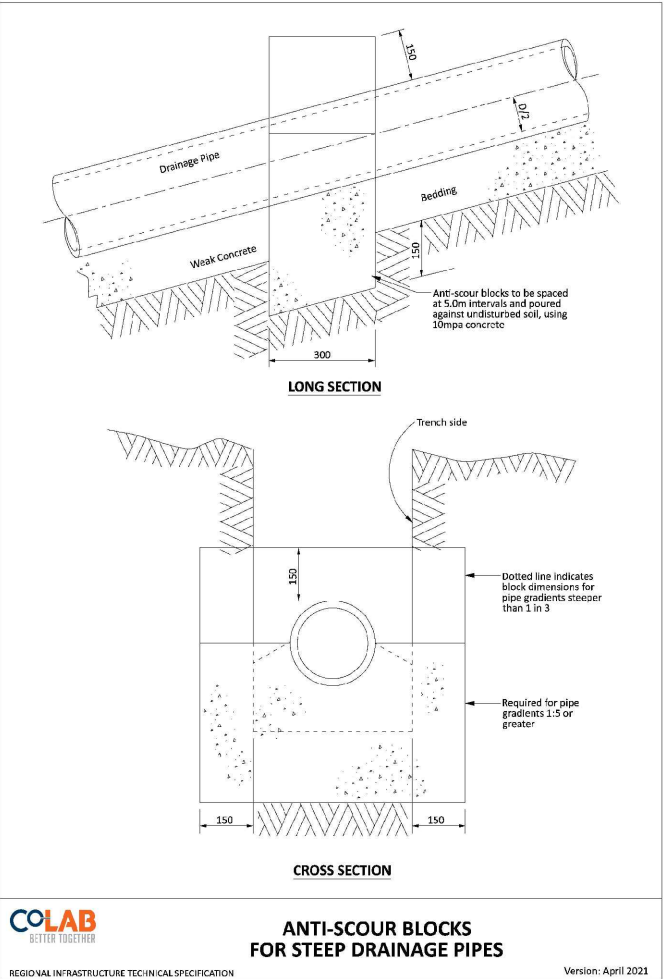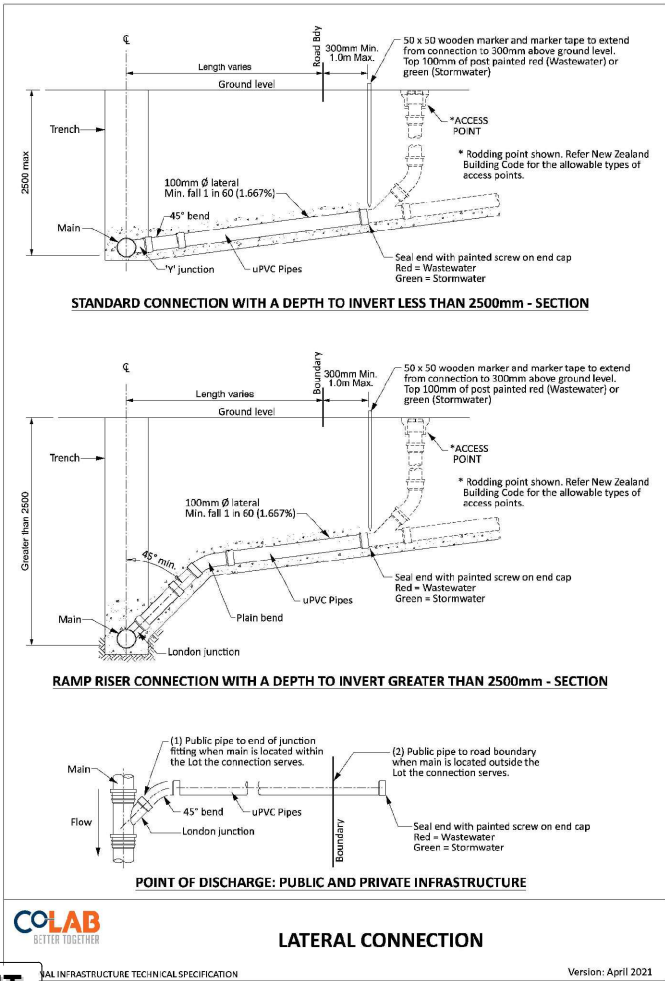


RESOURCE CONSENT

A	FAST TRACK APP	MKS	09/2026
Rev	Description	By	Date
Survey	-- / --	-- / --	
Design	MKS	05/2026	
Drawn	MKS	05/2026	
Checked	SM	09/2026	
M Maven Waikato 07 242 0601 info@maven.co.nz www.maven.co.nz Level 1 286 Victoria Street, Hamilton New Zealand			
Project SOUTHERN LINKS 1 RESIDENTIAL STAGE 1 HAMILTON, WAIKATO FOR SL1 NORTHERN CONSORTIUM			
Title PROPOSED WASTEWATER STANDARD DETAILS			
Project no.	298001-R1 SL1		
Scale	1:2.5 @ A3		
Cad file	298002-11-C580 WW STANDARD DETAILS.DWG		
Drawing no.	I1-C580-1	Rev	A

DATE: 8/31/26 FILE PATH: F:\M\VEN\HAMILTON\6 PROJECTS\298002 - S1\STG\11\DWG\298002-11-C580 WW STANDARD DETAILS.DWG

RESOURCE CONSENT

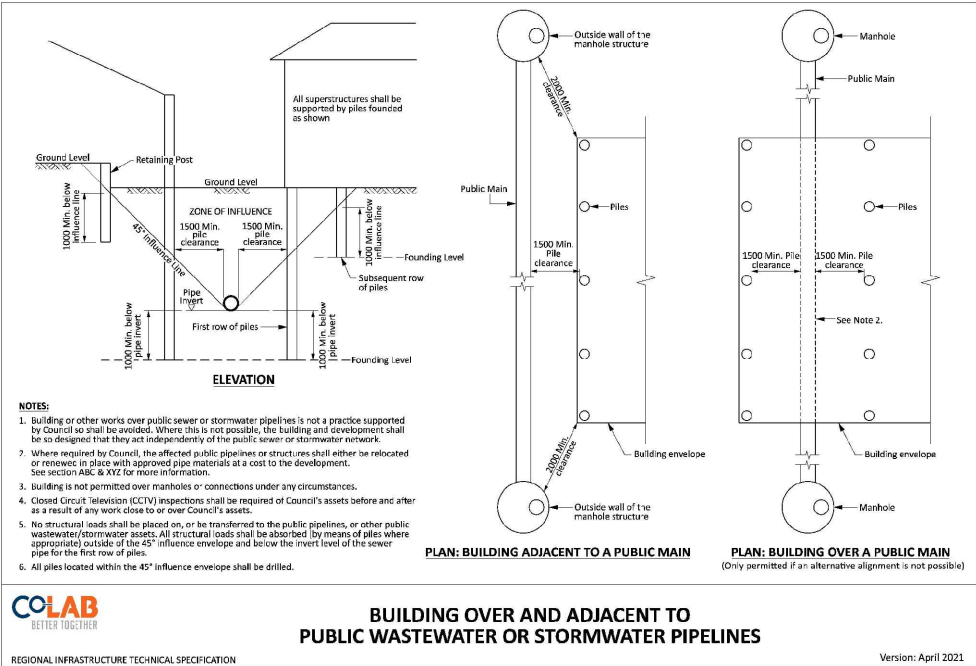

- NOTES
- ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 - CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 777m.
 - IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 - ALL CONCRETE SW PIPE TO BE INSTALLED IN ACCORDANCE WITH AS/NZS 3725:2007 FOR BURIED CONCRETE PIPES AND AS/NZ 4058:2007 FOR PRECAST CONCRETE PIPES (PRESSURE AND NON-PRESSURE) AS STIPULATED IN THE RITS 2018
 - APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL STORMWATER LINES WITHIN THE ROAD RESERVE.
 - HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS.
 - ALL CESSPIT LEADS SHALL HAVE MIN COVER 0.9m.
 - ALL LINES ARE TO BE CLASS4 RCRRJ UNLESS SHOWN OTHERWISE.
 - ALL LINES TO BE ABANDONED SHALL BE SEALED AT EACH END. TIMING OF ALL SEALING TO BE COORDINATED WITH COUNCIL STAFF.

A	FAST TRACK APP	MKS	09/2026
Rev	Description	By	Date
	By	Date	
Survey	-- / --	-- / --	
Design	MKS	05/2026	
Drawn	MKS	05/2026	
Checked	SM	09/2026	


M
M A V E N

Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project
**SOUTHERN LINKS 1
RESIDENTIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title
**PROPOSED
WASTEWATER
STANDARD DETAILS**

Project no.	298001-R1 SL1		
Scale	1:2.5 @ A3		
Cad file	298002-11-C580 WW STANDARD DETAILS.DWG		
Drawing no.	I1-C580-2	Rev	A

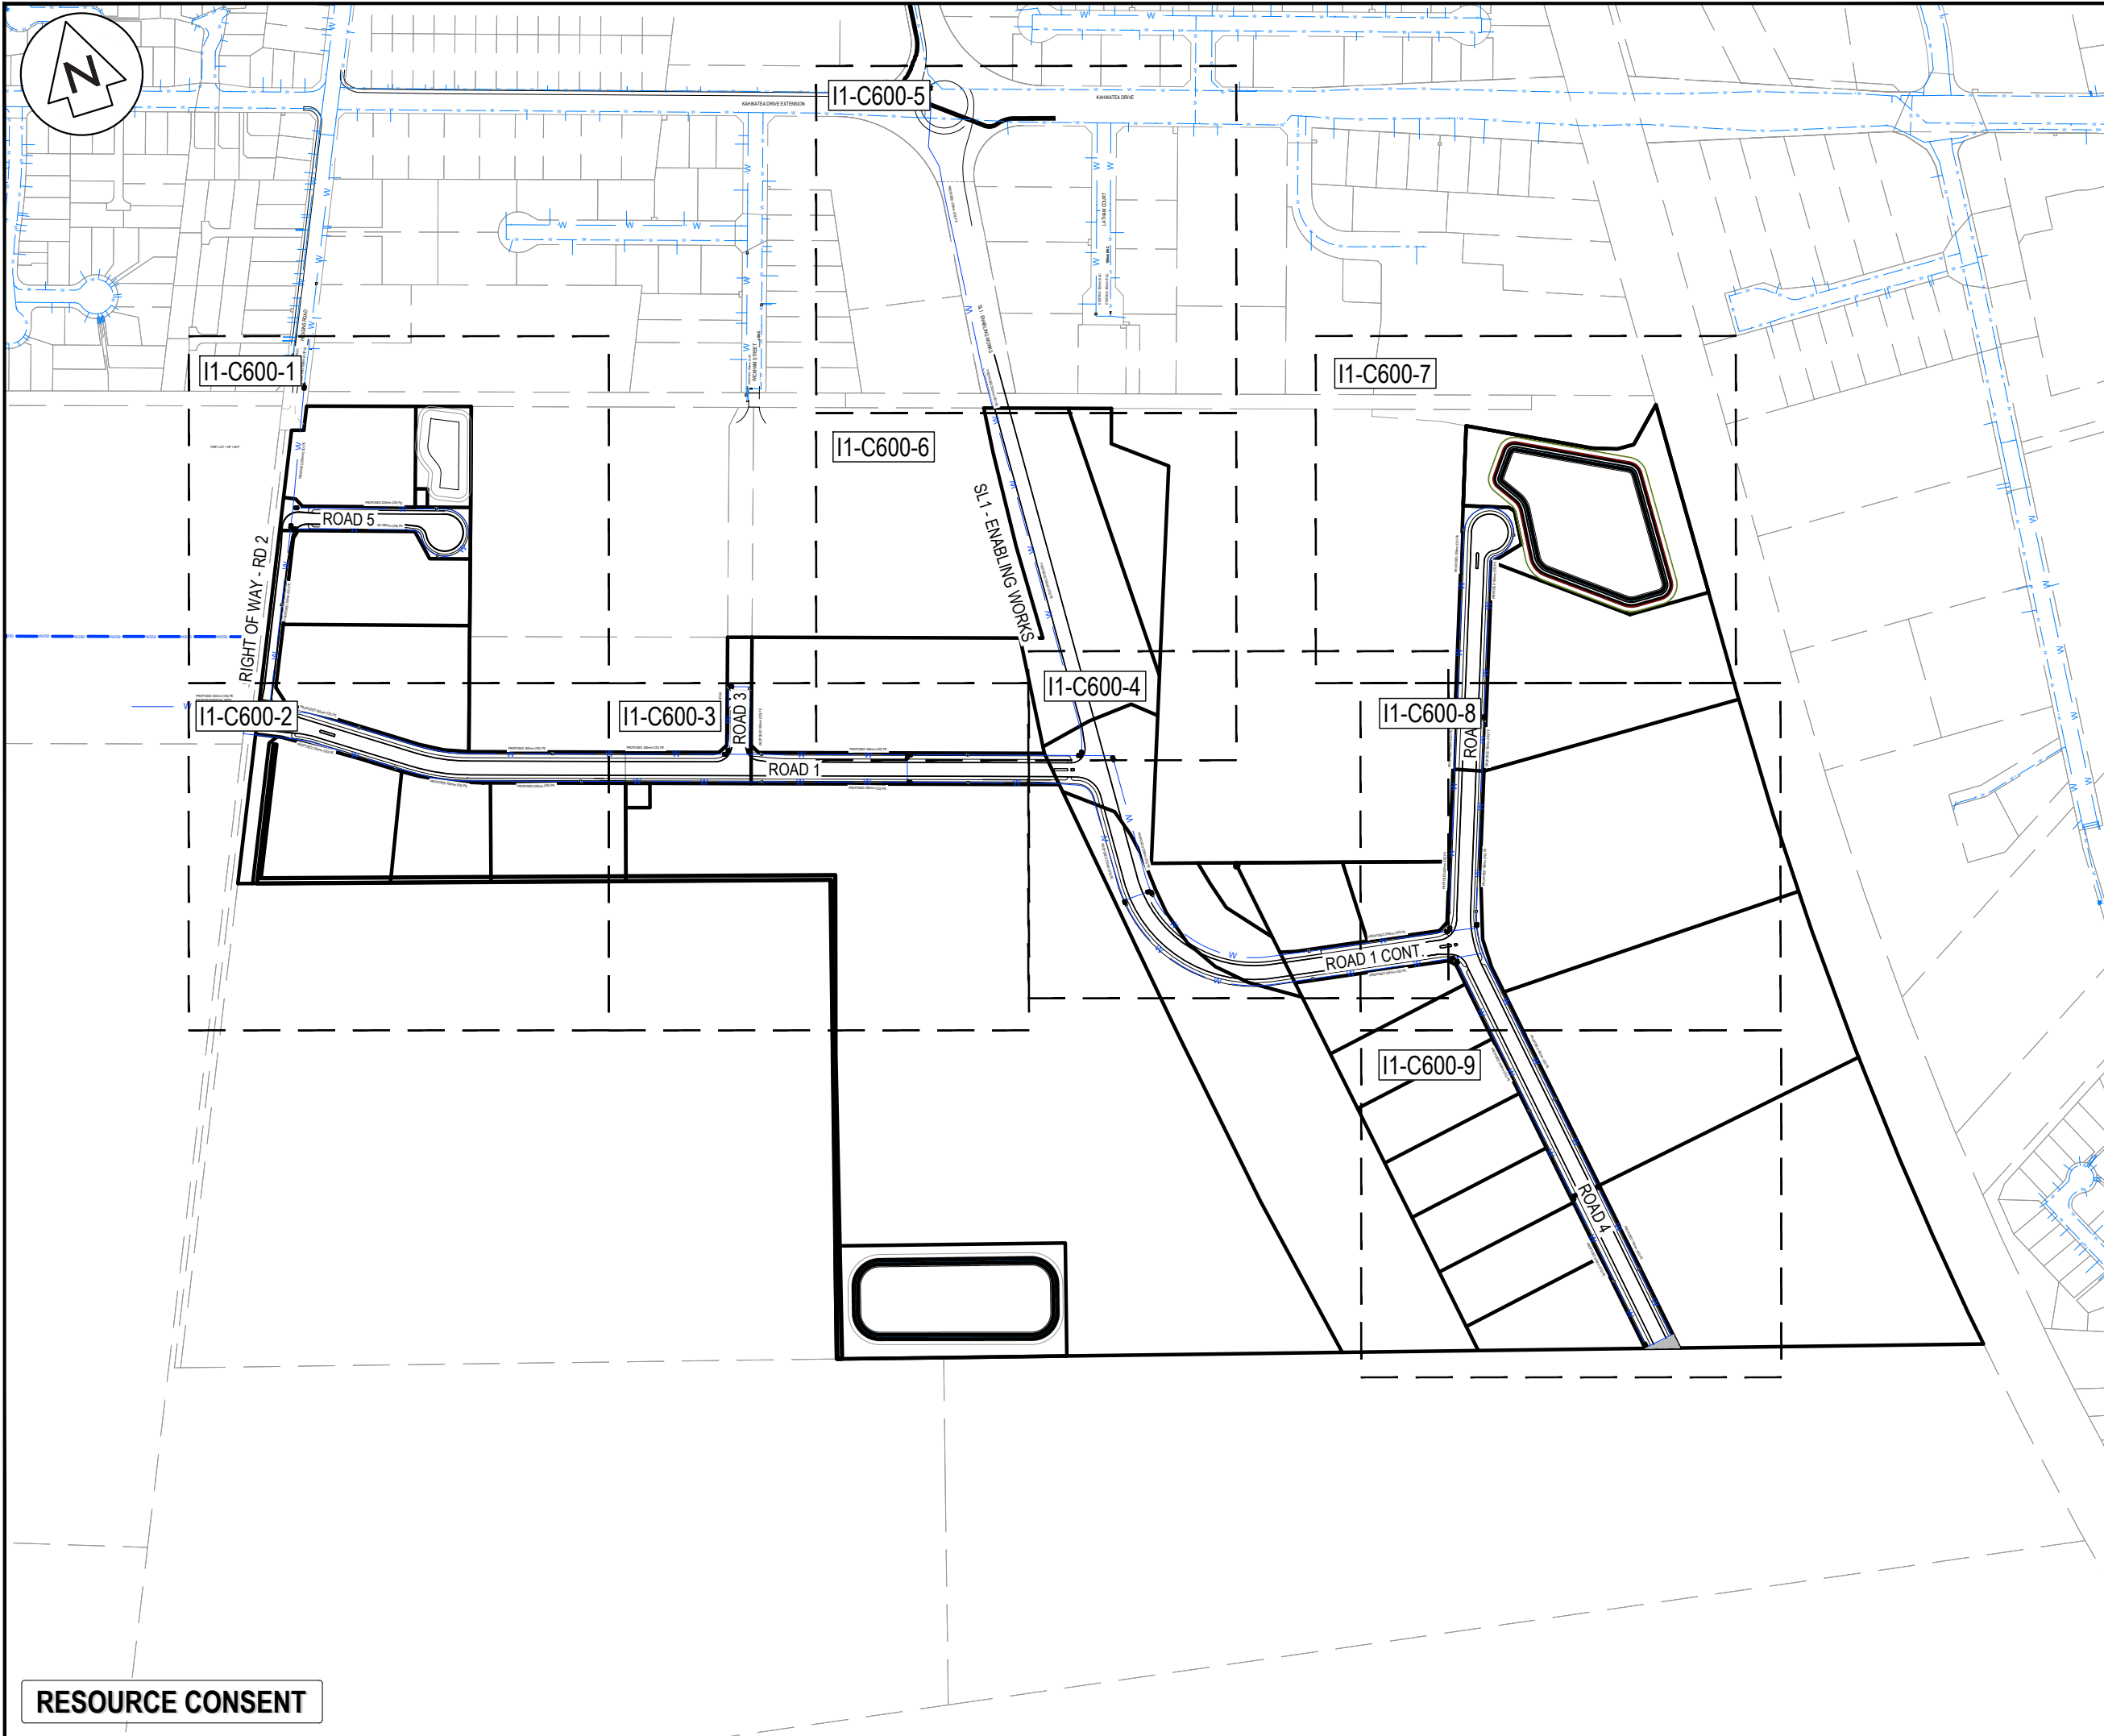

NOTES

- ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
- CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016.
- IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
- MINIMUM COVER SHALL BE:
ROADS AND FRONTIM OF BERM: 900MM
BERMS 600MM
SERVICE CONNECTIONS: 450MM
- WATERMAINS LAID ACROSS ROADS SHALL BE BACKFILLED WITH HARDFILL COMPACTED IN 200MM LAYERS ABOVE THE EMBEDMENT MATERIAL.
- ALL UPVC PIPE SHALL BE PN12 MINIMUM PRESSURE RATED WITH SPIGNOT AND SOCKET RUBBER RING JOINTS.
- ALL PE PIPE SHALL BE PN12.5 MINIMUM PRESSURE RATED WITH BUTT-WELDED. WELD BEADS SHALL BE REMOVED TO PROVIDE A SMOOTH BORE.
- ALL NON-METALIC PIPES ARE TO HAVE TRACER WIRE FITTED TO COUNCIL STANDARDS.
- PIPES SHALL BE BEDDED AND SURROUNDED TO 150MM ABOVE THE PIPE SOFFIT WITH SAND OR AP20.
- METAL DETECTOR TAPE PRINTED WITH 'WATER PIPE BELOW' SHALL BE LAID 150MM ABOVE ALL WATERMAINS.
- A YELLOW ISOSCELES TRIANGLE WITH CATS EYE POINTING TO FH SHALL BE PAINTED IN THE CENTRE OF ALL SEALED ROADS.
- ALL VALVES TO BE MARKED WITH SAWCUT KERB AND BLUE PAINT.
- ALL FLANGE JOINTS TO BE PROTECTED WITH DENSO TAPE OR SIMILAR APPROVED BY THE ENGINEER.

LEGEND

---	EX BDY
---	PROP BDY
---	EX WATERMAIN
---	PROP WATERMAIN
---	PR WATER PRIVATE
FH	EX/PROP HYDRANT
WM	EX/PROP METER
X	EX SLUICE VALVE
X	EX PEET VALVE
X	PROP SLUICE VALVE
X	PROP PEET VALVE
X	PROP REDUCER

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
		By	Date
Survey	MAVEN		05/2025
Design	JPK		06/2026
Drawn	JPK		06/2026
Checked	SM		09/2026



Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project



**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title

**PROPOSED
WATER SUPPLY
OVERVIEW PLAN**

Project no.	298002-IND SL1		
Scale	1:5000 @ A3		
Cad file	298002-I1-C600 WS.DWG		
Drawing no.	I1-C600	Rev	A

RESOURCE CONSENT

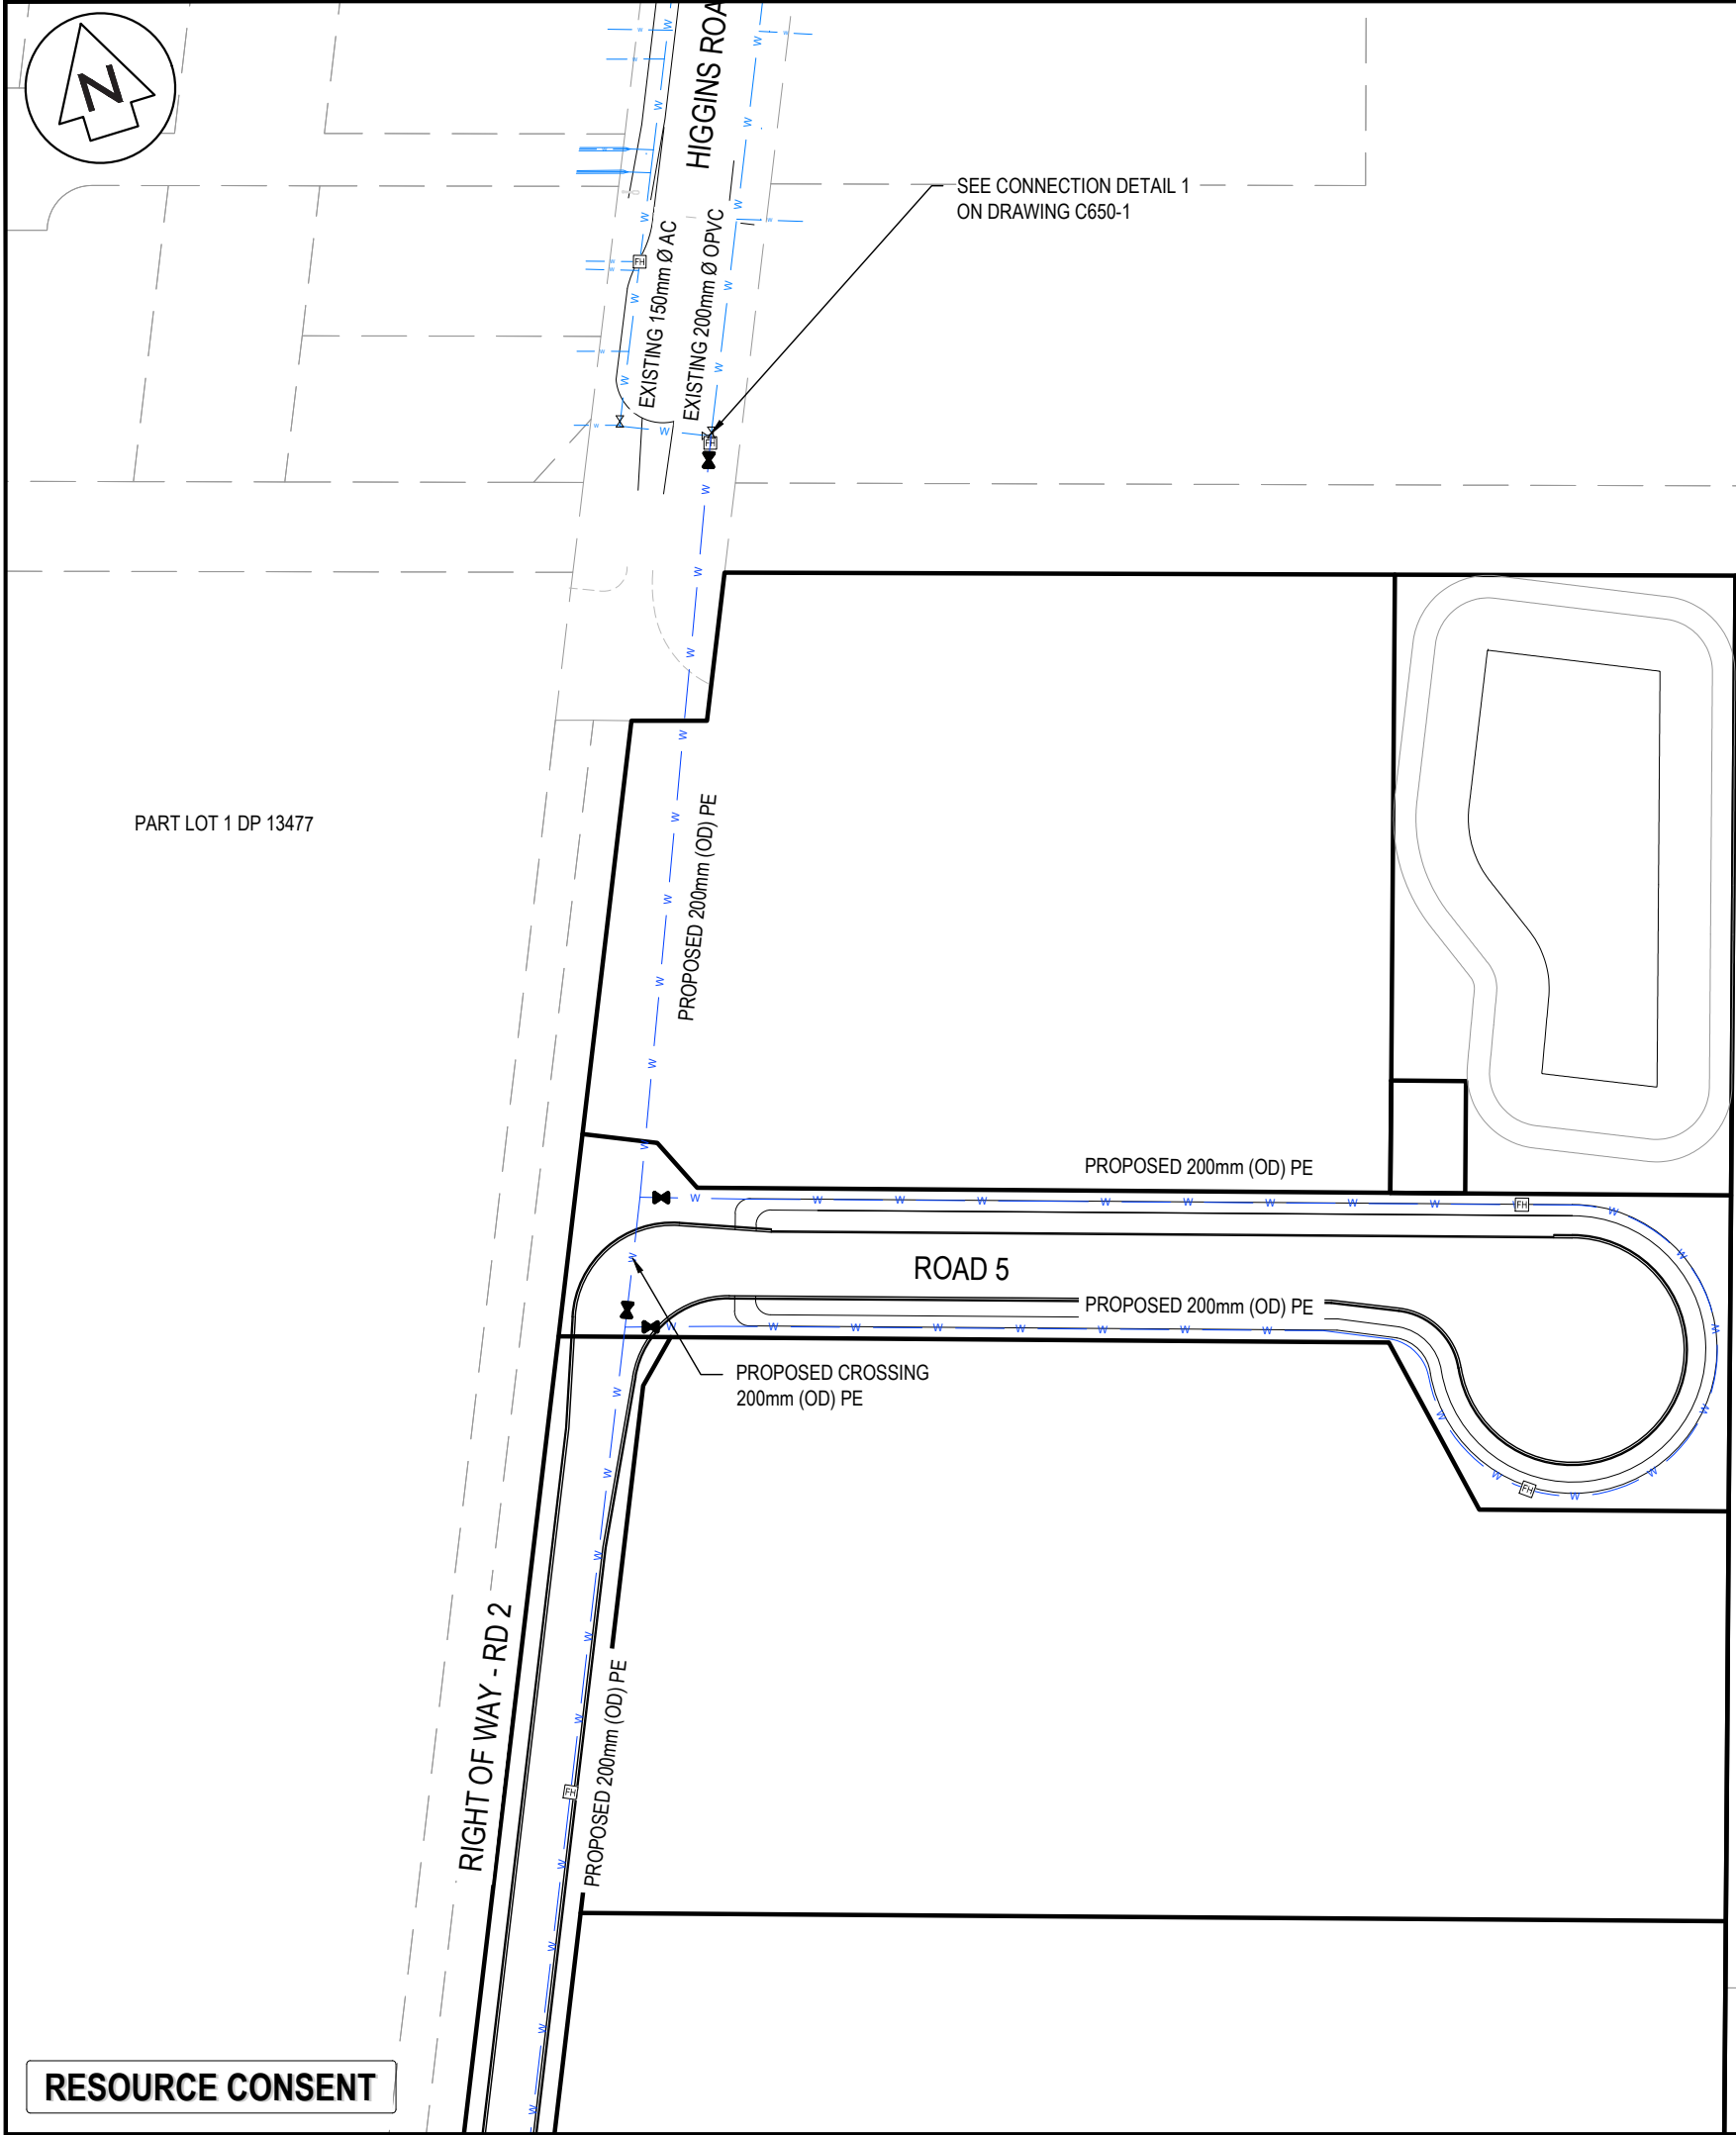

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016.
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
 4. MINIMUM COVER SHALL BE:
ROADS AND FRONTIM OF BERM: 900MM
BERMS 600MM
SERVICE CONNECTIONS: 450MM
 5. WATERMAINS LAID ACROSS ROADS SHALL BE BACKFILLED WITH HARDFILL COMPACTED IN 200MM LAYERS ABOVE THE EMBEDMENT MATERIAL.
 6. ALL UPVC PIPE SHALL BE PN12 MINIMUM PRESSURE RATED WITH SPIGNOT AND SOCKET RUBBER RING JOINTS.
 7. ALL PE PIPE SHALL BE PN12.5 MINIMUM PRESSURE RATED WITH BUTT-WELDED. WELD BEADS SHALL BE REMOVED TO PROVIDE A SMOOTH BORE.
 8. ALL NON-METALIC PIPES ARE TO HAVE TRACER WIRE FITTED TO COUNCIL STANDARDS.
 9. PIPES SHALL BE BEDDED AND SURROUNDED TO 150MM ABOVE THE PIPE SOFFIT WITH SAND OR AP20.
 10. METAL DETECTOR TAPE PRINTED WITH 'WATER PIPE BELOW' SHALL BE LAID 150MM ABOVE ALL WATERMAINS.
 11. A YELLOW ISOSCELES TRIANGLE WITH CATS EYE POINTING TO FH SHALL BE PAINTED IN THE CENTRE OF ALL SEALED ROADS.
 12. ALL VALVES TO BE MARKED WITH SAWCUT KERB AND BLUE PAINT.
 13. ALL FLANGE JOINTS TO BE PROTECTED WITH DENSO TAPE OR SIMILAR APPROVED BY THE ENGINEER.

LEGEND

	EX BDY
	PROP BDY
	EX WATERMAIN
	PROP WATERMAIN
	PR WATER PRIVATE
	EX/PROP HYDRANT
	EX/PROP METER
	EX SLUICE VALVE
	EX PEET VALVE
	PROP SLUICE VALVE
	PROP PEET VALVE
	PROP REDUCER

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
		By	Date
Survey	MAVEN		05/2025
Design	JKP		06/2026
Drawn	JKP		06/2026
Checked	SM		09/2026

Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project


**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title

**PROPOSED
WATER SUPPLY
PLAN**

Project no.	298002-IND SL1		
Scale	1:1000 @ A3		
Cad file	298002-11-C600 WS.DWG		
Drawing no.	I1-C600-1	Rev	A

RESOURCE CONSENT



PROPOSED 250mm (OD) PE
FROM RESIDENTIAL AREA

SEE CONNECTION DETAIL 2
ON DRAWING C650-1

PROPOSED CROSSING
350mm (OD) PE

PROPOSED 350mm (OD) PE

PROPOSED 200mm (OD) PE

PROPOSED CROSSING
200mm (OD) PE

PROPOSED 200mm (OD) PE

PROPOSED 350mm (OD) PE

PROPOSED 200mm (OD) PE

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016.
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
 4. MINIMUM COVER SHALL BE:
ROADS AND FRONTM OF BERM: 900MM
BERMS 600MM
SERVICE CONNECTIONS: 450MM
 5. WATERMAINS LAID ACROSS ROADS SHALL BE BACKFILLED WITH HARDFILL COMPACTED IN 200MM LAYERS ABOVE THE EMBEDMENT MATERIAL.
 6. ALL UPVC PIPE SHALL BE PN12 MINIMUM PRESSURE RATED WITH SPIGNOT AND SOCKET RUBBER RING JOINTS.
 7. ALL PE PIPE SHALL BE PN12.5 MINIMUM PRESSURE RATED WITH BUTT-WELDED. WELD BEADS SHALL BE REMOVED TO PROVIDE A SMOOTH BORE.
 8. ALL NON-METALIC PIPES ARE TO HAVE TRACER WIRE FITTED TO COUNCIL STANDARDS.
 9. PIPES SHALL BE BEDDED AND SURROUNDED TO 150MM ABOVE THE PIPE SOFFIT WITH SAND OR AP20.
 10. METAL DETECTOR TAPE PRINTED WITH 'WATER PIPE BELOW' SHALL BE LAID 150MM ABOVE ALL WATERMAINS.
 11. A YELLOW ISOSCELES TRIANGLE WITH CATS EYE POINTING TO FH SHALL BE PAINTED IN THE CENTRE OF ALL SEALED ROADS.
 12. ALL VALVES TO BE MARKED WITH SAWCUT KERB AND BLUE PAINT.
 13. ALL FLANGE JOINTS TO BE PROTECTED WITH DENSO TAPE OR SIMILAR APPROVED BY THE ENGINEER.

LEGEND

	EX BDY
	PROP BDY
	EX WATERMAIN
	PROP WATERMAIN
	PR WATER PRIVATE
	EX/PROP HYDRANT
	EX/PROP METER
	EX SLUICE VALVE
	EX PEET VALVE
	PROP SLUICE VALVE
	PROP PEET VALVE
	PROP REDUCER

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	By	Date	
Survey	MAVEN	05/2025	
Design	JPK	06/2026	
Drawn	JPK	06/2026	
Checked	SM	09/2026	



Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project
**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title
**PROPOSED
WATER SUPPLY
PLAN**

Project no.	298002-IND SL1		
Scale	1:1000 @ A3		
Cad file	298002-11-C600 WS.DWG		
Drawing no.	11-C600-2	Rev	A

RESOURCE CONSENT

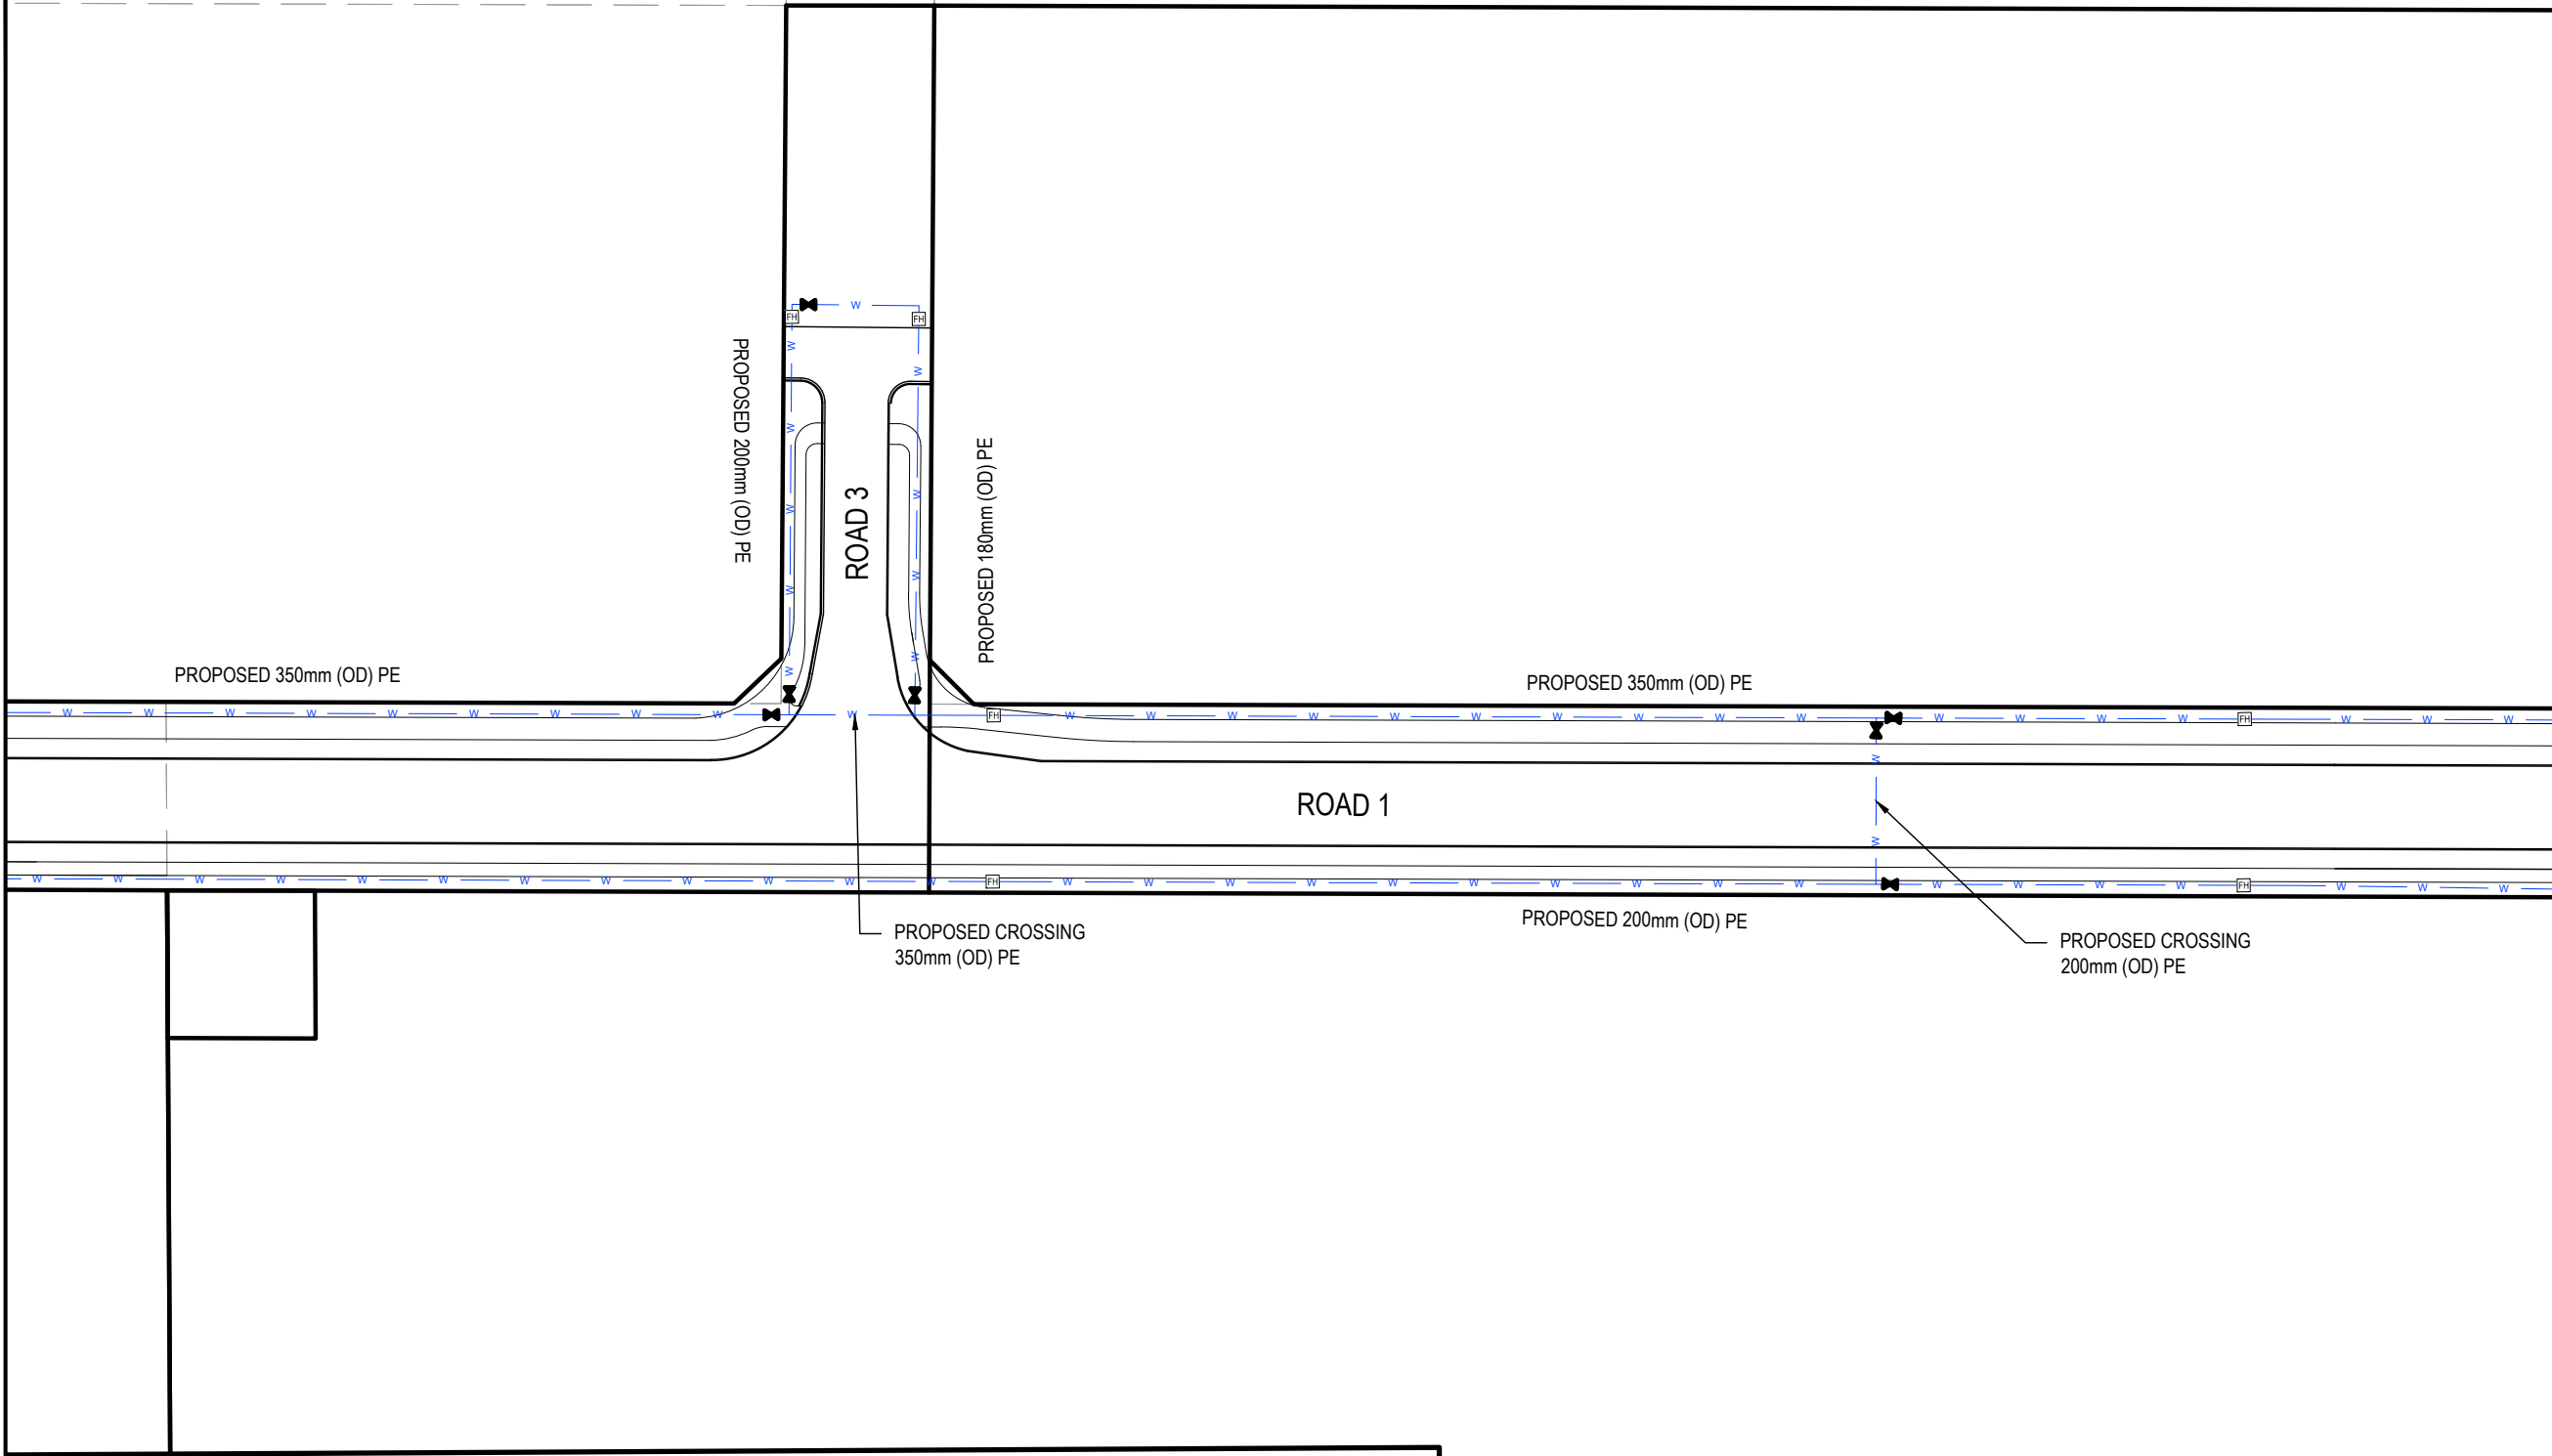

NOTES

- ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
- CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016.
- IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
- MINIMUM COVER SHALL BE:
ROADS AND FRONTIM OF BERM: 900MM
BERMS 600MM
SERVICE CONNECTIONS: 450MM
- WATERMAINS LAID ACROSS ROADS SHALL BE BACKFILLED WITH HARDFILL COMPACTED IN 200MM LAYERS ABOVE THE EMBEDMENT MATERIAL.
- ALL UPVC PIPE SHALL BE PN12 MINIMUM PRESSURE RATED WITH SPIGNOT AND SOCKET RUBBER RING JOINTS.
- ALL PE PIPE SHALL BE PN12.5 MINIMUM PRESSURE RATED WITH BUTT-WELDED. WELD BEADS SHALL BE REMOVED TO PROVIDE A SMOOTH BORE.
- ALL NON-METALIC PIPES ARE TO HAVE TRACER WIRE FITTED TO COUNCIL STANDARDS.
- PIPES SHALL BE BEDDED AND SURROUNDED TO 150MM ABOVE THE PIPE SOFFIT WITH SAND OR AP20.
- METAL DETECTOR TAPE PRINTED WITH 'WATER PIPE BELOW' SHALL BE LAID 150MM ABOVE ALL WATERMAINS.
- A YELLOW ISOSCELES TRIANGLE WITH CATS EYE POINTING TO FH SHALL BE PAINTED IN THE CENTRE OF ALL SEALED ROADS.
- ALL VALVES TO BE MARKED WITH SAWCUT KERB AND BLUE PAINT.
- ALL FLANGE JOINTS TO BE PROTECTED WITH DENSO TAPE OR SIMILAR APPROVED BY THE ENGINEER.

LEGEND

	EX BDY
	PROP BDY
	EX WATERMAIN
	PROP WATERMAIN
	PR WATER PRIVATE
	EX/PROP METER
	EX SLUICE VALVE
	EX PEET VALVE
	PROP SLUICE VALVE
	PROP PEET VALVE
	PROP REDUCER

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	By	Date	
Survey	MAVEN	05/2025	
Design	JPK	06/2026	
Drawn	JPK	06/2026	
Checked	SM	09/2026	

Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project



**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title

**PROPOSED
WATER SUPPLY
PLAN**

Project no.	298002-IND SL1		
Scale	1:1000 @ A3		
Cad file	298002-11-C600 WS.DWG		
Drawing no.	I1-C600-3	Rev	A

RESOURCE CONSENT

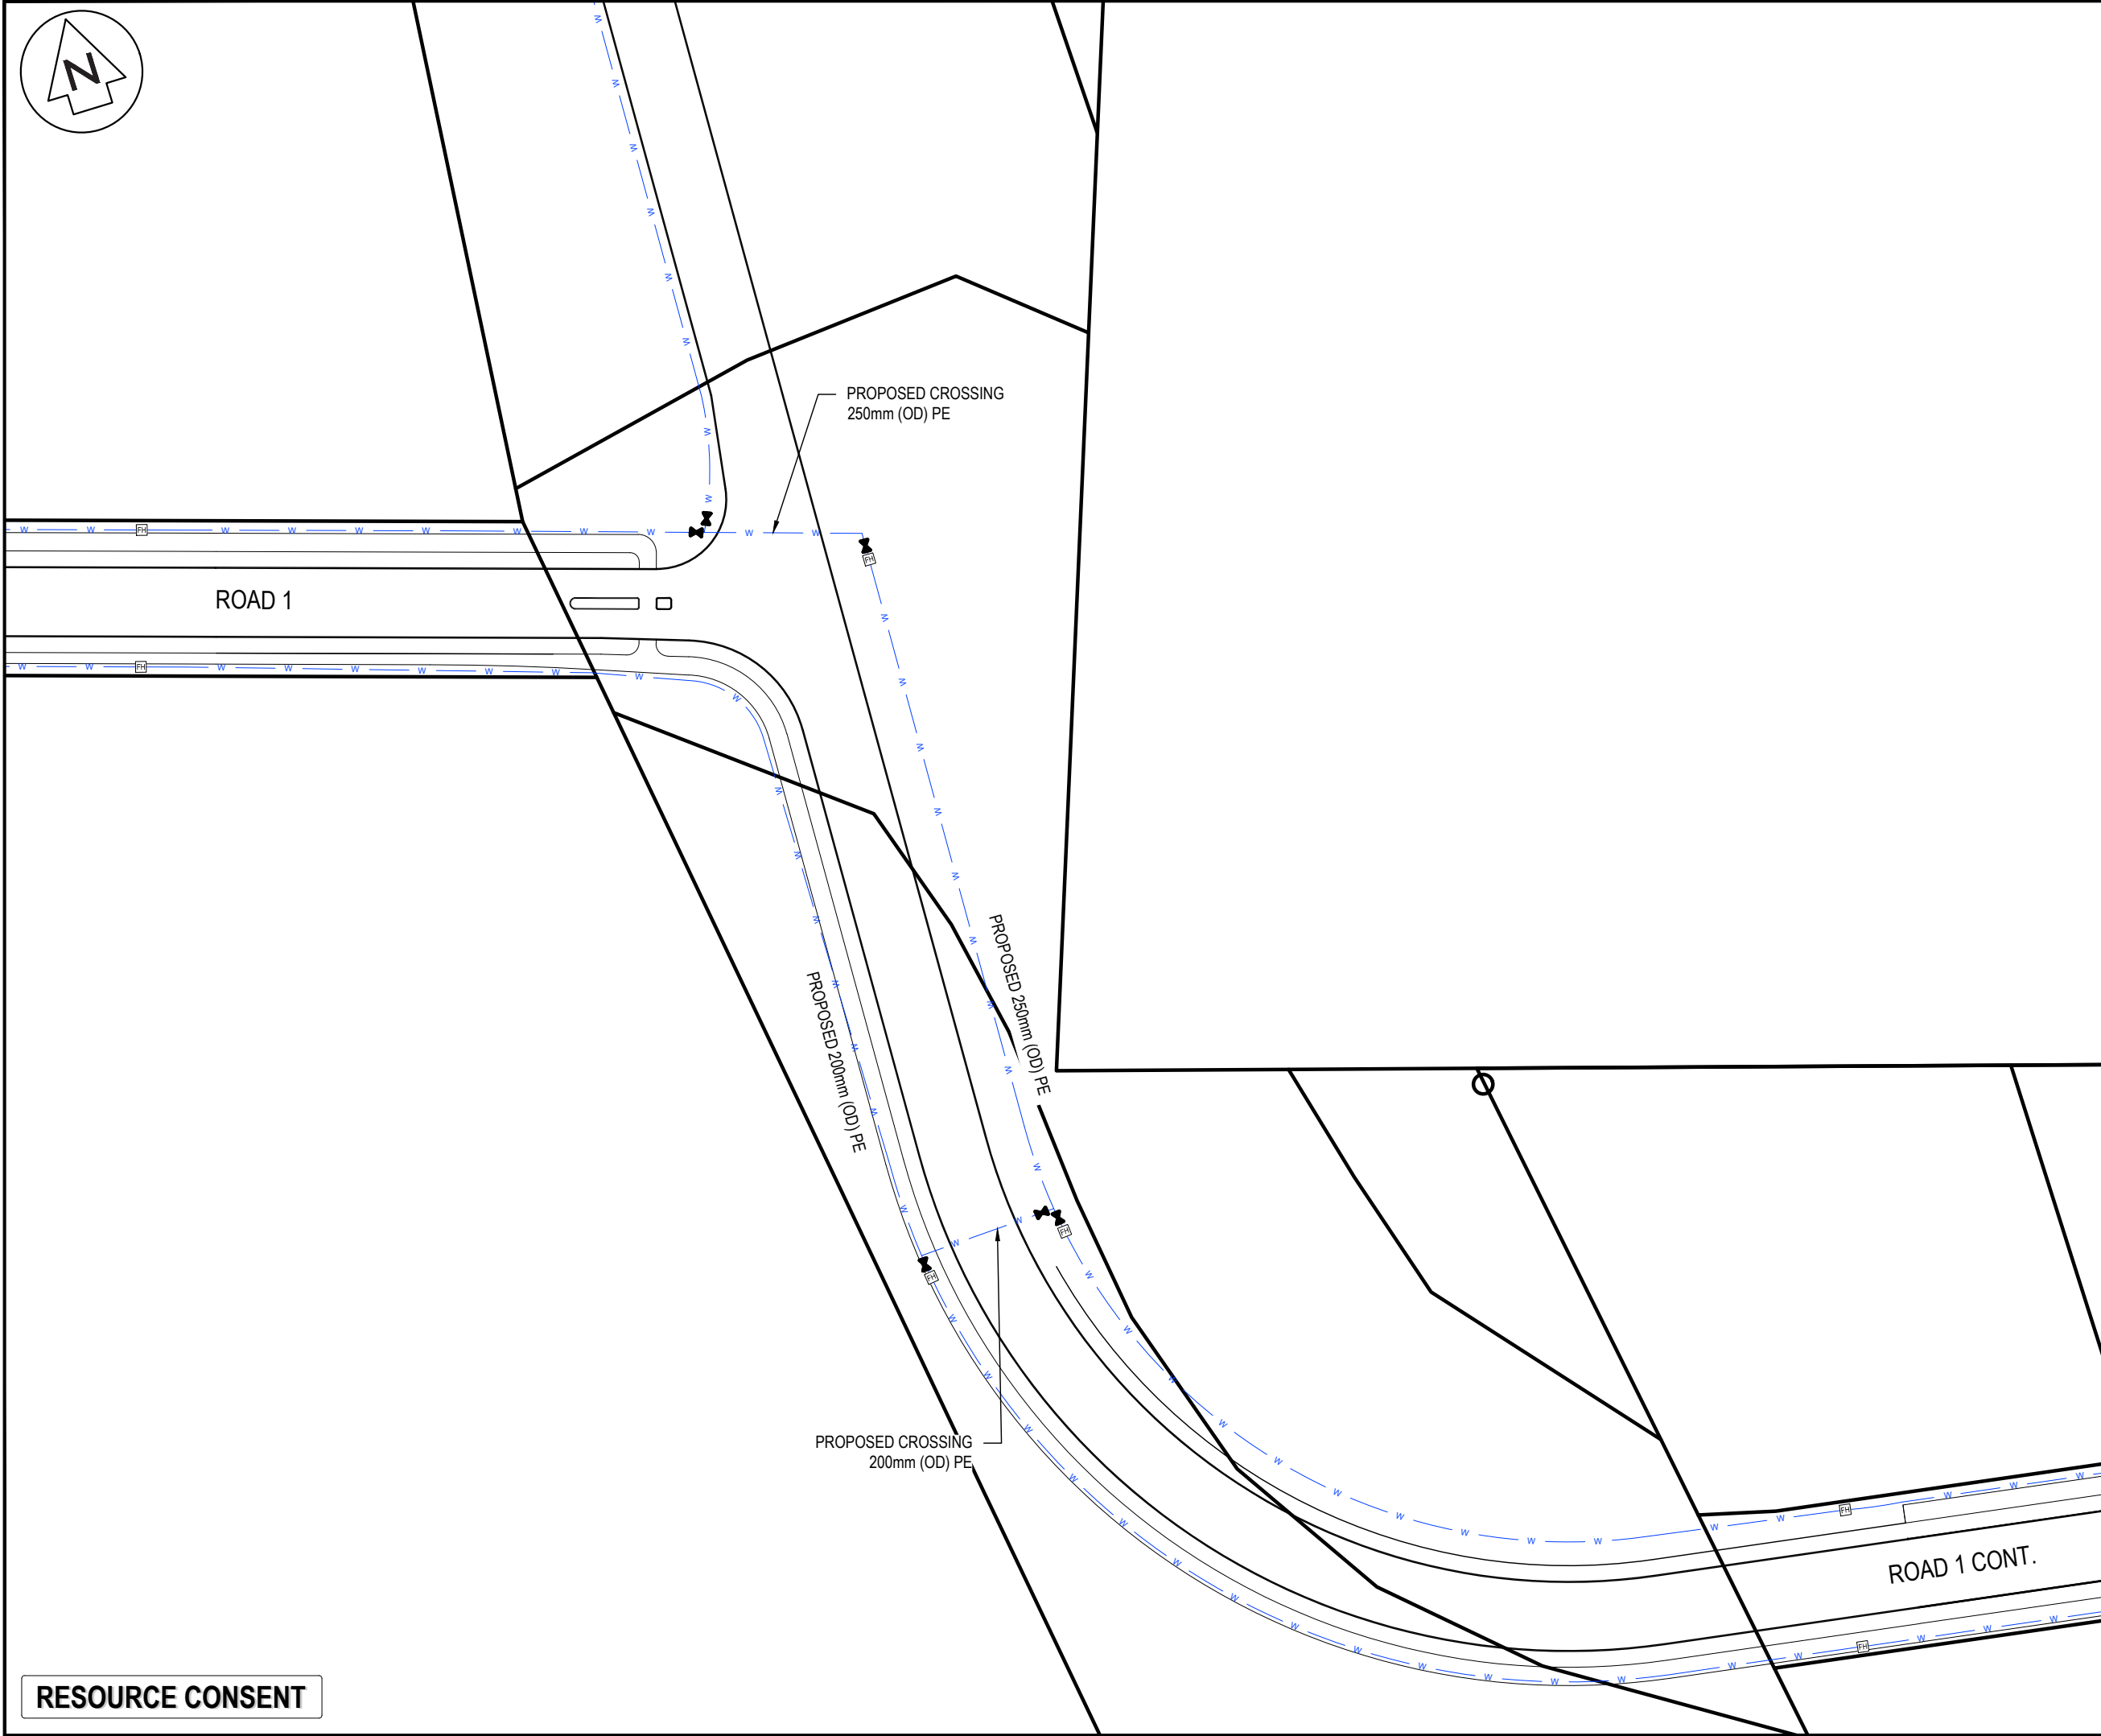

NOTES

- ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
- CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016.
- IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
- MINIMUM COVER SHALL BE:
ROADS AND FRONTIM OF BERM: 900MM
BERMS 600MM
SERVICE CONNECTIONS: 450MM
- WATERMAINS LAID ACROSS ROADS SHALL BE BACKFILLED WITH HARDFILL COMPACTED IN 200MM LAYERS ABOVE THE EMBEDMENT MATERIAL.
- ALL UPVC PIPE SHALL BE PN12 MINIMUM PRESSURE RATED WITH SPIGNOT AND SOCKET RUBBER RING JOINTS.
- ALL PE PIPE SHALL BE PN12.5 MINIMUM PRESSURE RATED WITH BUTT-WELDED. WELD BEADS SHALL BE REMOVED TO PROVIDE A SMOOTH BORE.
- ALL NON-METALIC PIPES ARE TO HAVE TRACER WIRE FITTED TO COUNCIL STANDARDS.
- PIPES SHALL BE BEDDED AND SURROUNDED TO 150MM ABOVE THE PIPE SOFFIT WITH SAND OR AP20.
- METAL DETECTOR TAPE PRINTED WITH 'WATER PIPE BELOW' SHALL BE LAID 150MM ABOVE ALL WATERMAINS.
- A YELLOW ISOSCELES TRIANGLE WITH CATS EYE POINTING TO FH SHALL BE PAINTED IN THE CENTRE OF ALL SEALED ROADS.
- ALL VALVES TO BE MARKED WITH SAWCUT KERB AND BLUE PAINT.
- ALL FLANGE JOINTS TO BE PROTECTED WITH DENSO TAPE OR SIMILAR APPROVED BY THE ENGINEER.

LEGEND

	EX BDY
	PROP BDY
	EX WATERMAIN
	PROP WATERMAIN
	PR WATER PRIVATE
	EX/PROP HYDRANT
	EX/PROP METER
	EX SLUICE VALVE
	EX PEET VALVE
	PROP SLUICE VALVE
	PROP PEET VALVE
	PROP REDUCER

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	Survey	MAVEN	05/2025
	Design	JPK	06/2026
	Drawn	JPK	06/2026
	Checked	SM	09/2026

Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand


Project

**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title

**PROPOSED
WATER SUPPLY
PLAN**

Project no.	298002-IND SL1		
Scale	1:1000 @ A3		
Cad file	298002-11-C600 WS.DWG		
Drawing no.	11-C600-4	Rev	A

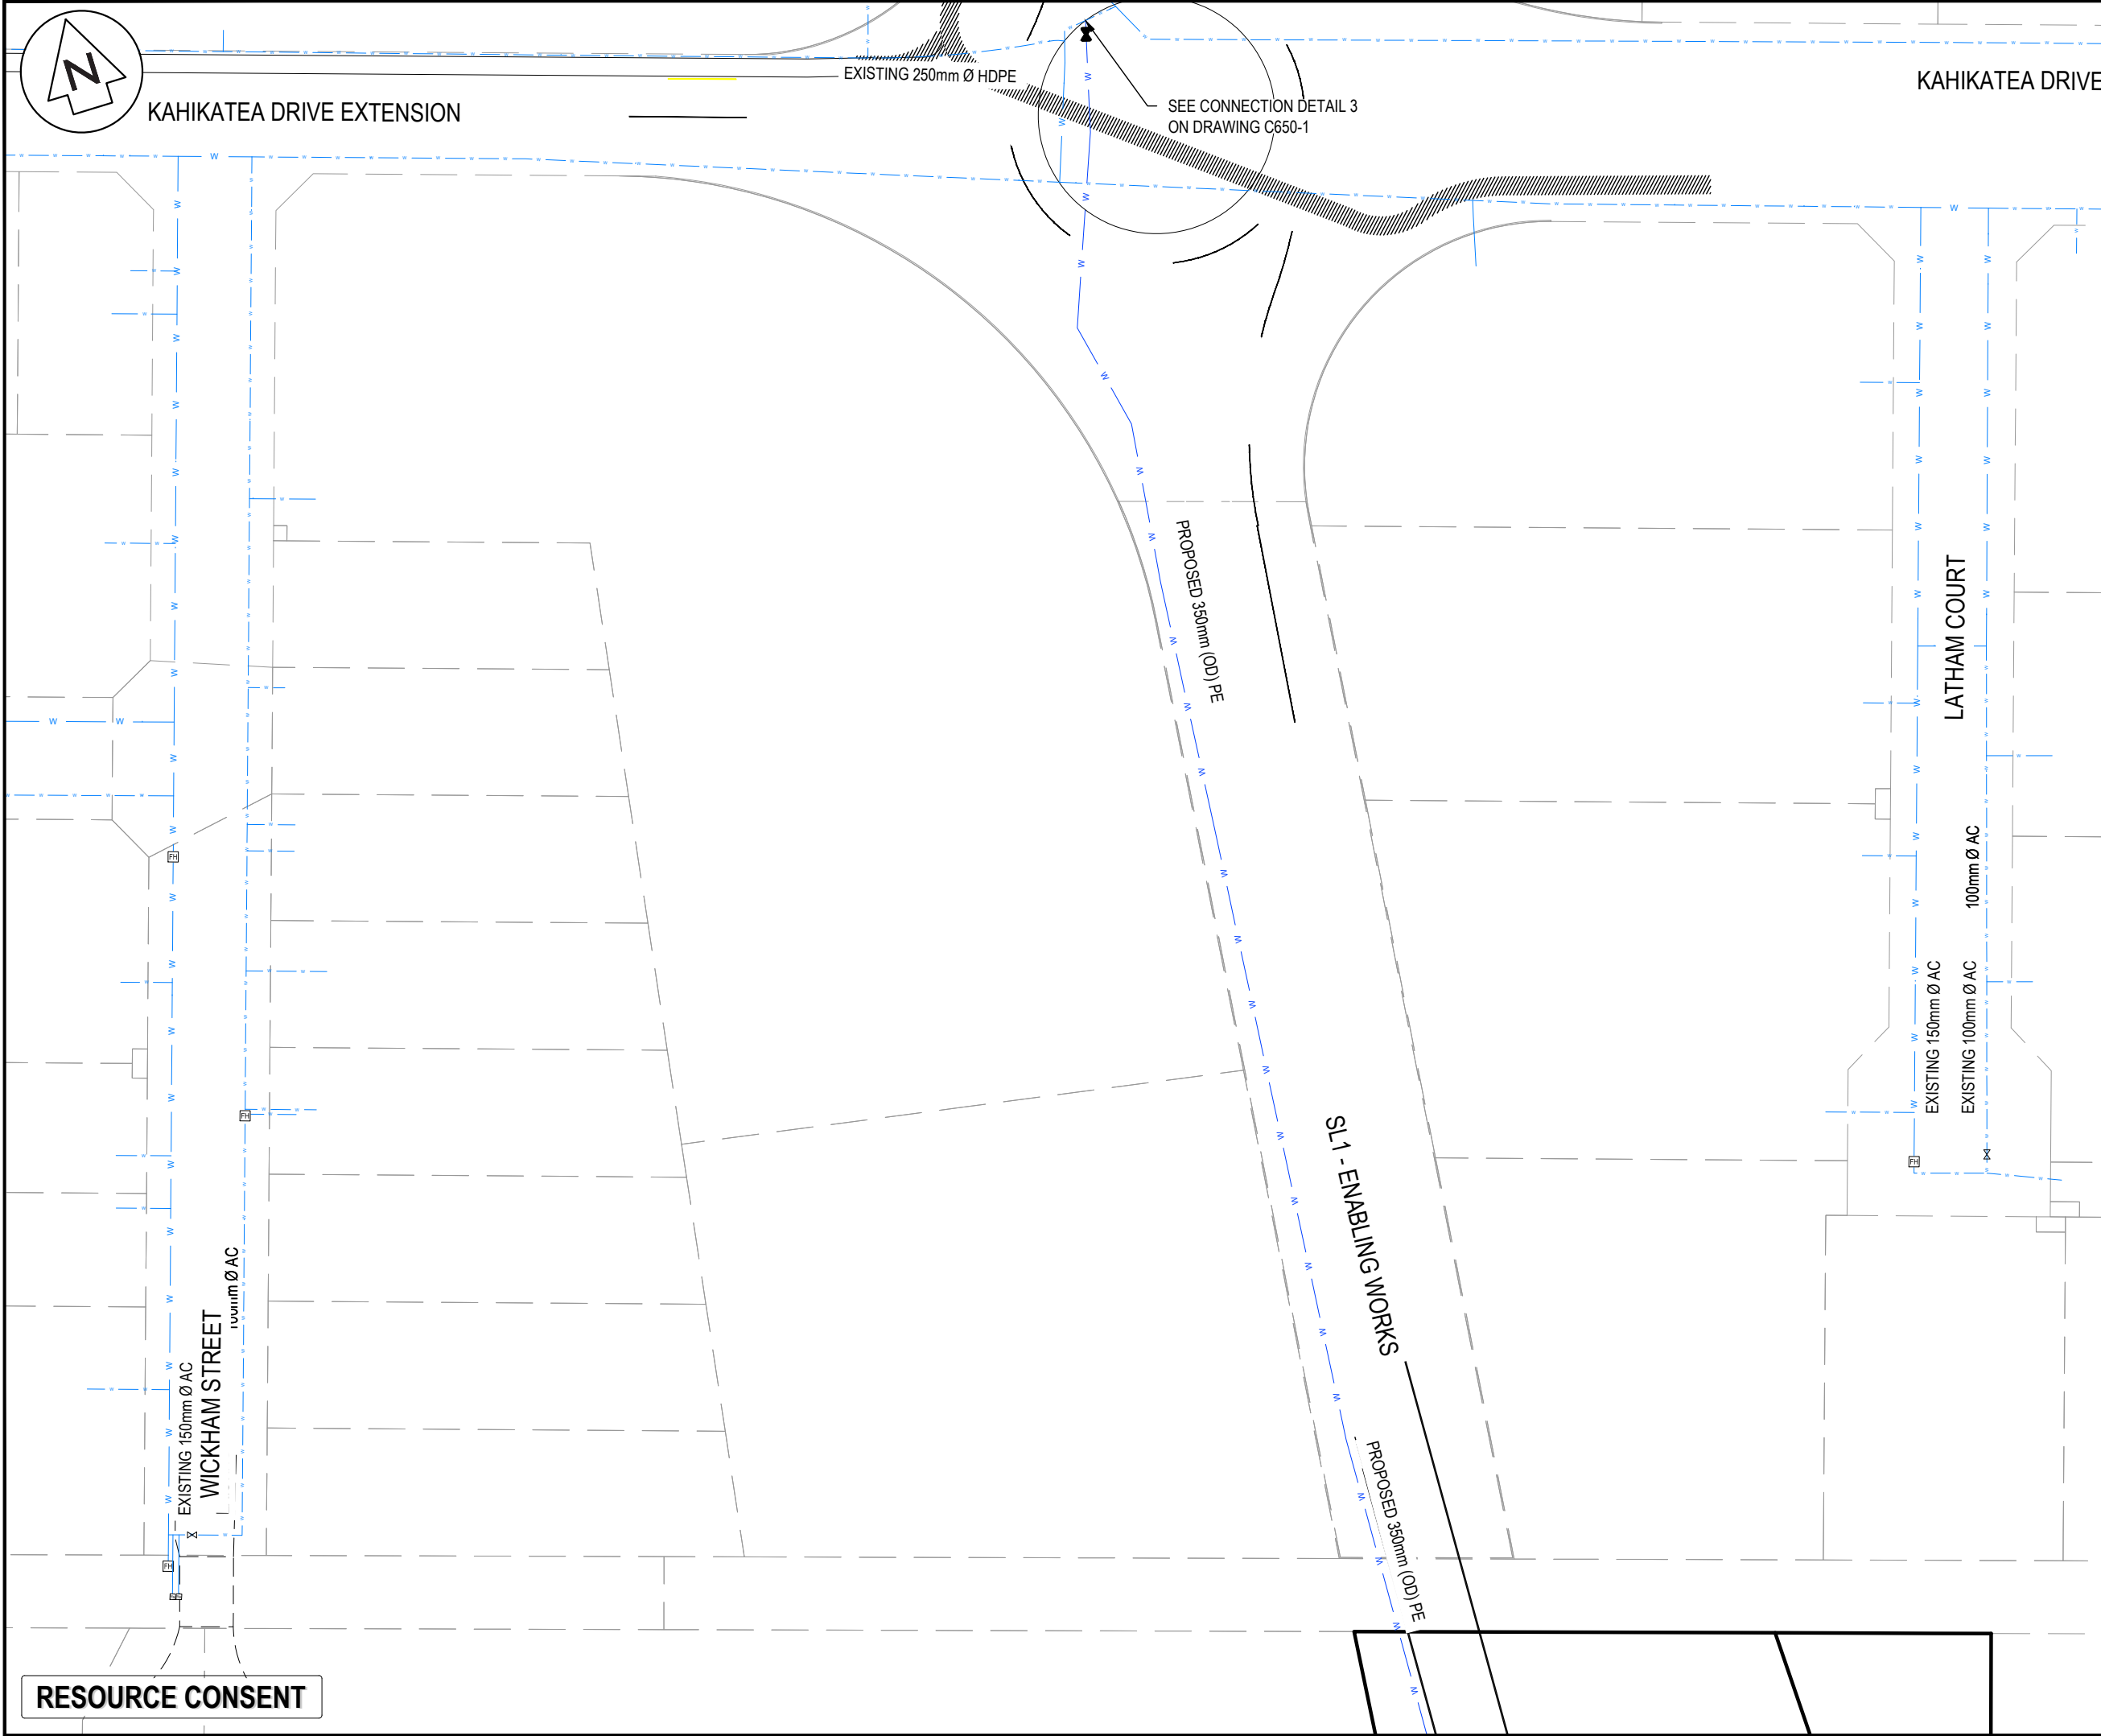

NOTES

- ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
- CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016.
- IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
- MINIMUM COVER SHALL BE:
ROADS AND FRONTIM OF BERM: 900MM
BERMS 600MM
SERVICE CONNECTIONS: 450MM
- WATERMAINS LAID ACROSS ROADS SHALL BE BACKFILLED WITH HARDFILL COMPACTED IN 200MM LAYERS ABOVE THE EMBEDMENT MATERIAL.
- ALL UPVC PIPE SHALL BE PN12 MINIMUM PRESSURE RATED WITH SPIGNOT AND SOCKET RUBBER RING JOINTS.
- ALL PE PIPE SHALL BE PN12.5 MINIMUM PRESSURE RATED WITH BUTT-WELDED. WELD BEADS SHALL BE REMOVED TO PROVIDE A SMOOTH BORE.
- ALL NON-METALIC PIPES ARE TO HAVE TRACER WIRE FITTED TO COUNCIL STANDARDS.
- PIPES SHALL BE BEDDED AND SURROUNDED TO 150MM ABOVE THE PIPE SOFFIT WITH SAND OR AP20.
- METAL DETECTOR TAPE PRINTED WITH 'WATER PIPE BELOW' SHALL BE LAID 150MM ABOVE ALL WATERMAINS.
- A YELLOW ISOSCELES TRIANGLE WITH CATS EYE POINTING TO FH SHALL BE PAINTED IN THE CENTRE OF ALL SEALED ROADS.
- ALL VALVES TO BE MARKED WITH SAWCUT KERB AND BLUE PAINT.
- ALL FLANGE JOINTS TO BE PROTECTED WITH DENSO TAPE OR SIMILAR APPROVED BY THE ENGINEER.

LEGEND

	EX BDY
	PROP BDY
	EX WATERMAIN
	PROP WATERMAIN
	PR WATER PRIVATE
	EX/PROP HYDRANT
	EX/PROP METER
	EX SLUICE VALVE
	EX PEET VALVE
	PROP SLUICE VALVE
	PROP PEET VALVE
	PROP REDUCER

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	Survey	MAVEN	05/2025
	Design	JKP	06/2026
	Drawn	JKP	06/2026
	Checked	SM	09/2026

Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project

**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title

**PROPOSED
WATER SUPPLY
PLAN**

Project no.	298002-IND SL1		
Scale	1:1000 @ A3		
Cad file	298002-11-C600 WS.DWG		
Drawing no.	I1-C600-5	Rev	A

RESOURCE CONSENT



- | LEGEND | |
|---|-------------------|
|  | EX BDY |
|  | PROP BDY |
|  | EX WATERMAIN |
|  | PROP WATERMAIN |
|  | PR WATER PRIVATE |
|  | EX/PROP HYDRANT |
|  | EX/PROP METER |
|  | EX SLUICE VALVE |
|  | EX PEET VALVE |
|  | PROP SLUICE VALVE |
|  | PROP PEET VALVE |
|  | PROP REDUCER |

M
M A N

Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand


Title PROPOSED WATER SUPPLY PLAN	
--	--

Project no.	298002-IND SL1		
Scale	1:1000 @ A3		
Cad file	298002-I1-C600 WS.DWG		
Drawing no.	I1-C600-6	Rev	A



DATE: 9/26 FILEPATH: F:\MAVEN\HAMILTON\6 PROJECTS\298002-SL1\STG 1\DWG\298002-11-C600 WS.DWG

RESOURCE CONSENT

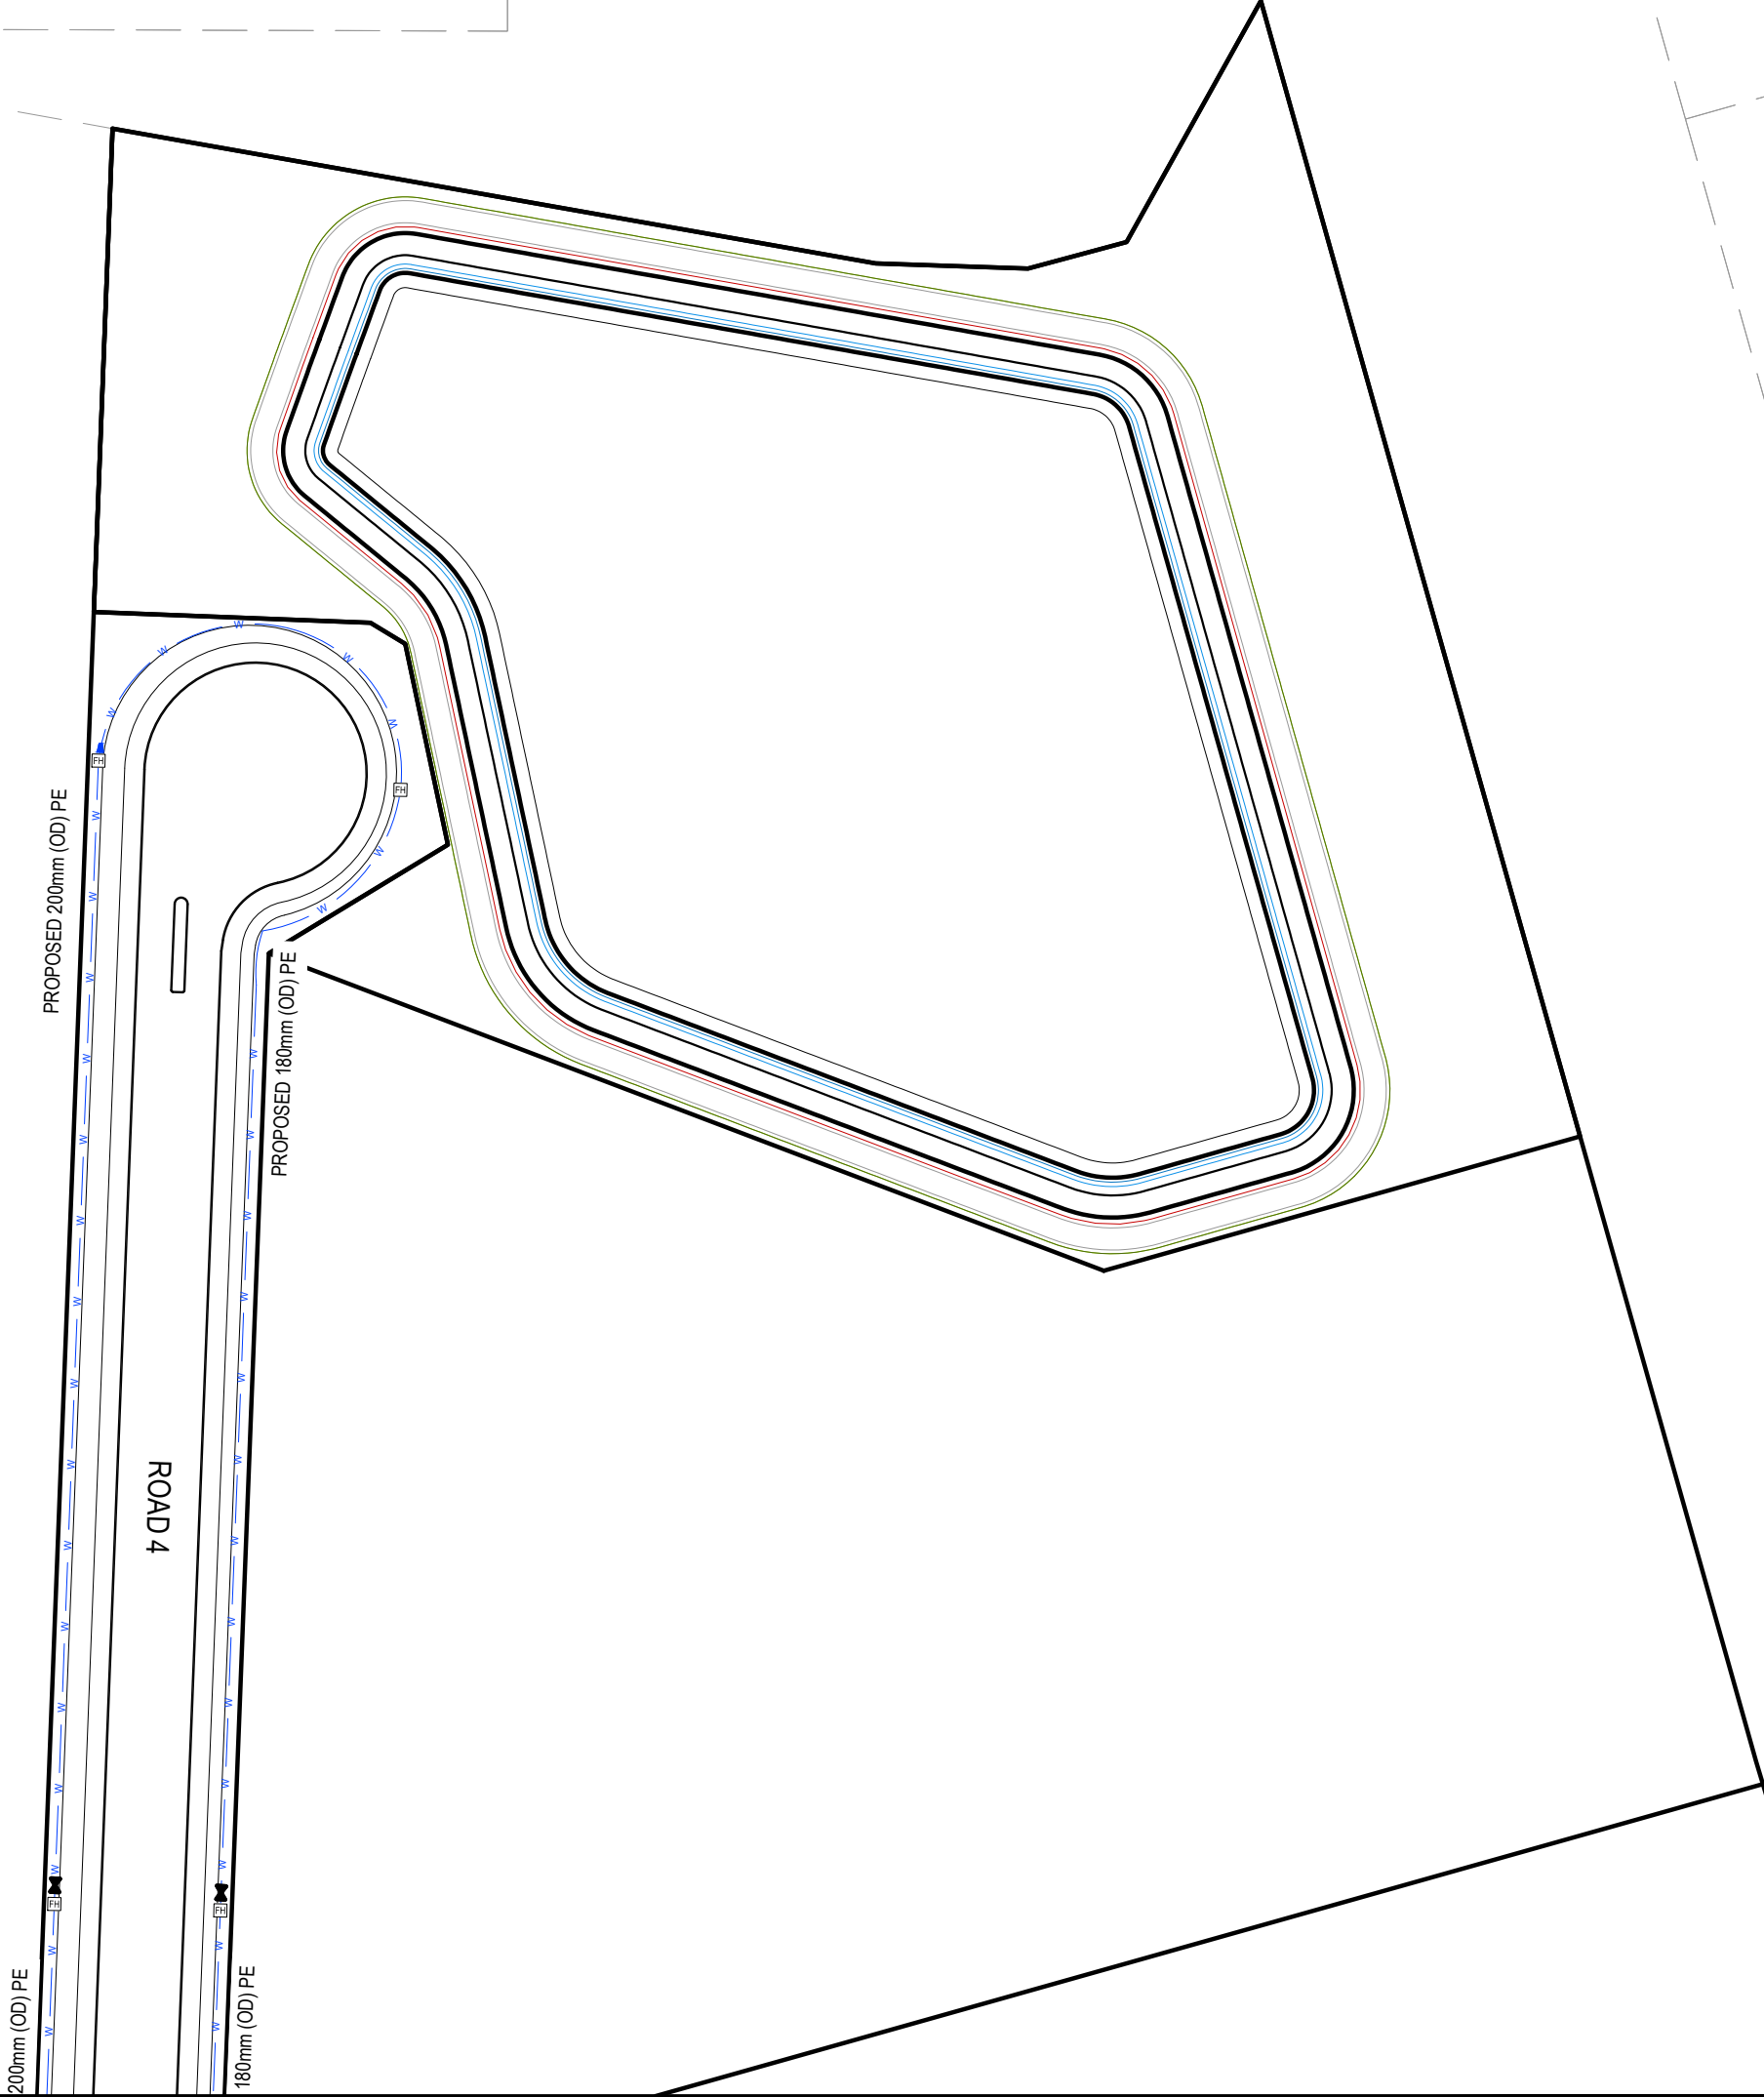

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016.
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
 4. MINIMUM COVER SHALL BE:
ROADS AND FRONTIM OF BERM: 900MM
BERMS 600MM
SERVICE CONNECTIONS: 450MM
 5. WATERMAINS LAID ACROSS ROADS SHALL BE BACKFILLED WITH HARDFILL COMPACTED IN 200MM LAYERS ABOVE THE EMBEDMENT MATERIAL.
 6. ALL UPVC PIPE SHALL BE PN12 MINIMUM PRESSURE RATED WITH SPIGNOT AND SOCKET RUBBER RING JOINTS.
 7. ALL PE PIPE SHALL BE PN12.5 MINIMUM PRESSURE RATED WITH BUTT-WELDED. WELD BEADS SHALL BE REMOVED TO PROVIDE A SMOOTH BORE.
 8. ALL NON-METALIC PIPES ARE TO HAVE TRACER WIRE FITTED TO COUNCIL STANDARDS.
 9. PIPES SHALL BE BEDDED AND SURROUNDED TO 150MM ABOVE THE PIPE SOFFIT WITH SAND OR AP20.
 10. METAL DETECTOR TAPE PRINTED WITH 'WATER PIPE BELOW' SHALL BE LAID 150MM ABOVE ALL WATERMAINS.
 11. A YELLOW ISOSCELES TRIANGLE WITH CATS EYE POINTING TO FH SHALL BE PAINTED IN THE CENTRE OF ALL SEALED ROADS.
 12. ALL VALVES TO BE MARKED WITH SAWCUT KERB AND BLUE PAINT.
 13. ALL FLANGE JOINTS TO BE PROTECTED WITH DENSO TAPE OR SIMILAR APPROVED BY THE ENGINEER.

—	EX BDY
—	PROP BDY
— w —	EX WATERMAIN
— w —	PROP WATERMAIN
- - -	PR WATER PRIVATE
	EX/PROP HYDRANT
	EX/PROP METER
	EX SLUICE VALVE
	EX PEET VALVE
	PROP SLUICE VALVE
	PROP PEET VALVE
	PROP REDUCER

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	By	Date	
Survey	MAVEN	05/2025	
Design	JPK	06/2026	
Drawn	JPK	06/2026	
Checked	SM	09/2026	



Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project

SOUTHERN LINKS 1

INDUSTRIAL STAGE 1

HAMILTON, WAIKATO

FOR SL1

NORTHERN CONSORTIUM



Title

PROPOSED

WATER SUPPLY

PLAN

Project no.	298002-IND SL1		
Scale	1:1000 @ A3		
Cad file	298002-11-C600 WS.DWG		
Drawing no.	11-C600-7	Rev	A

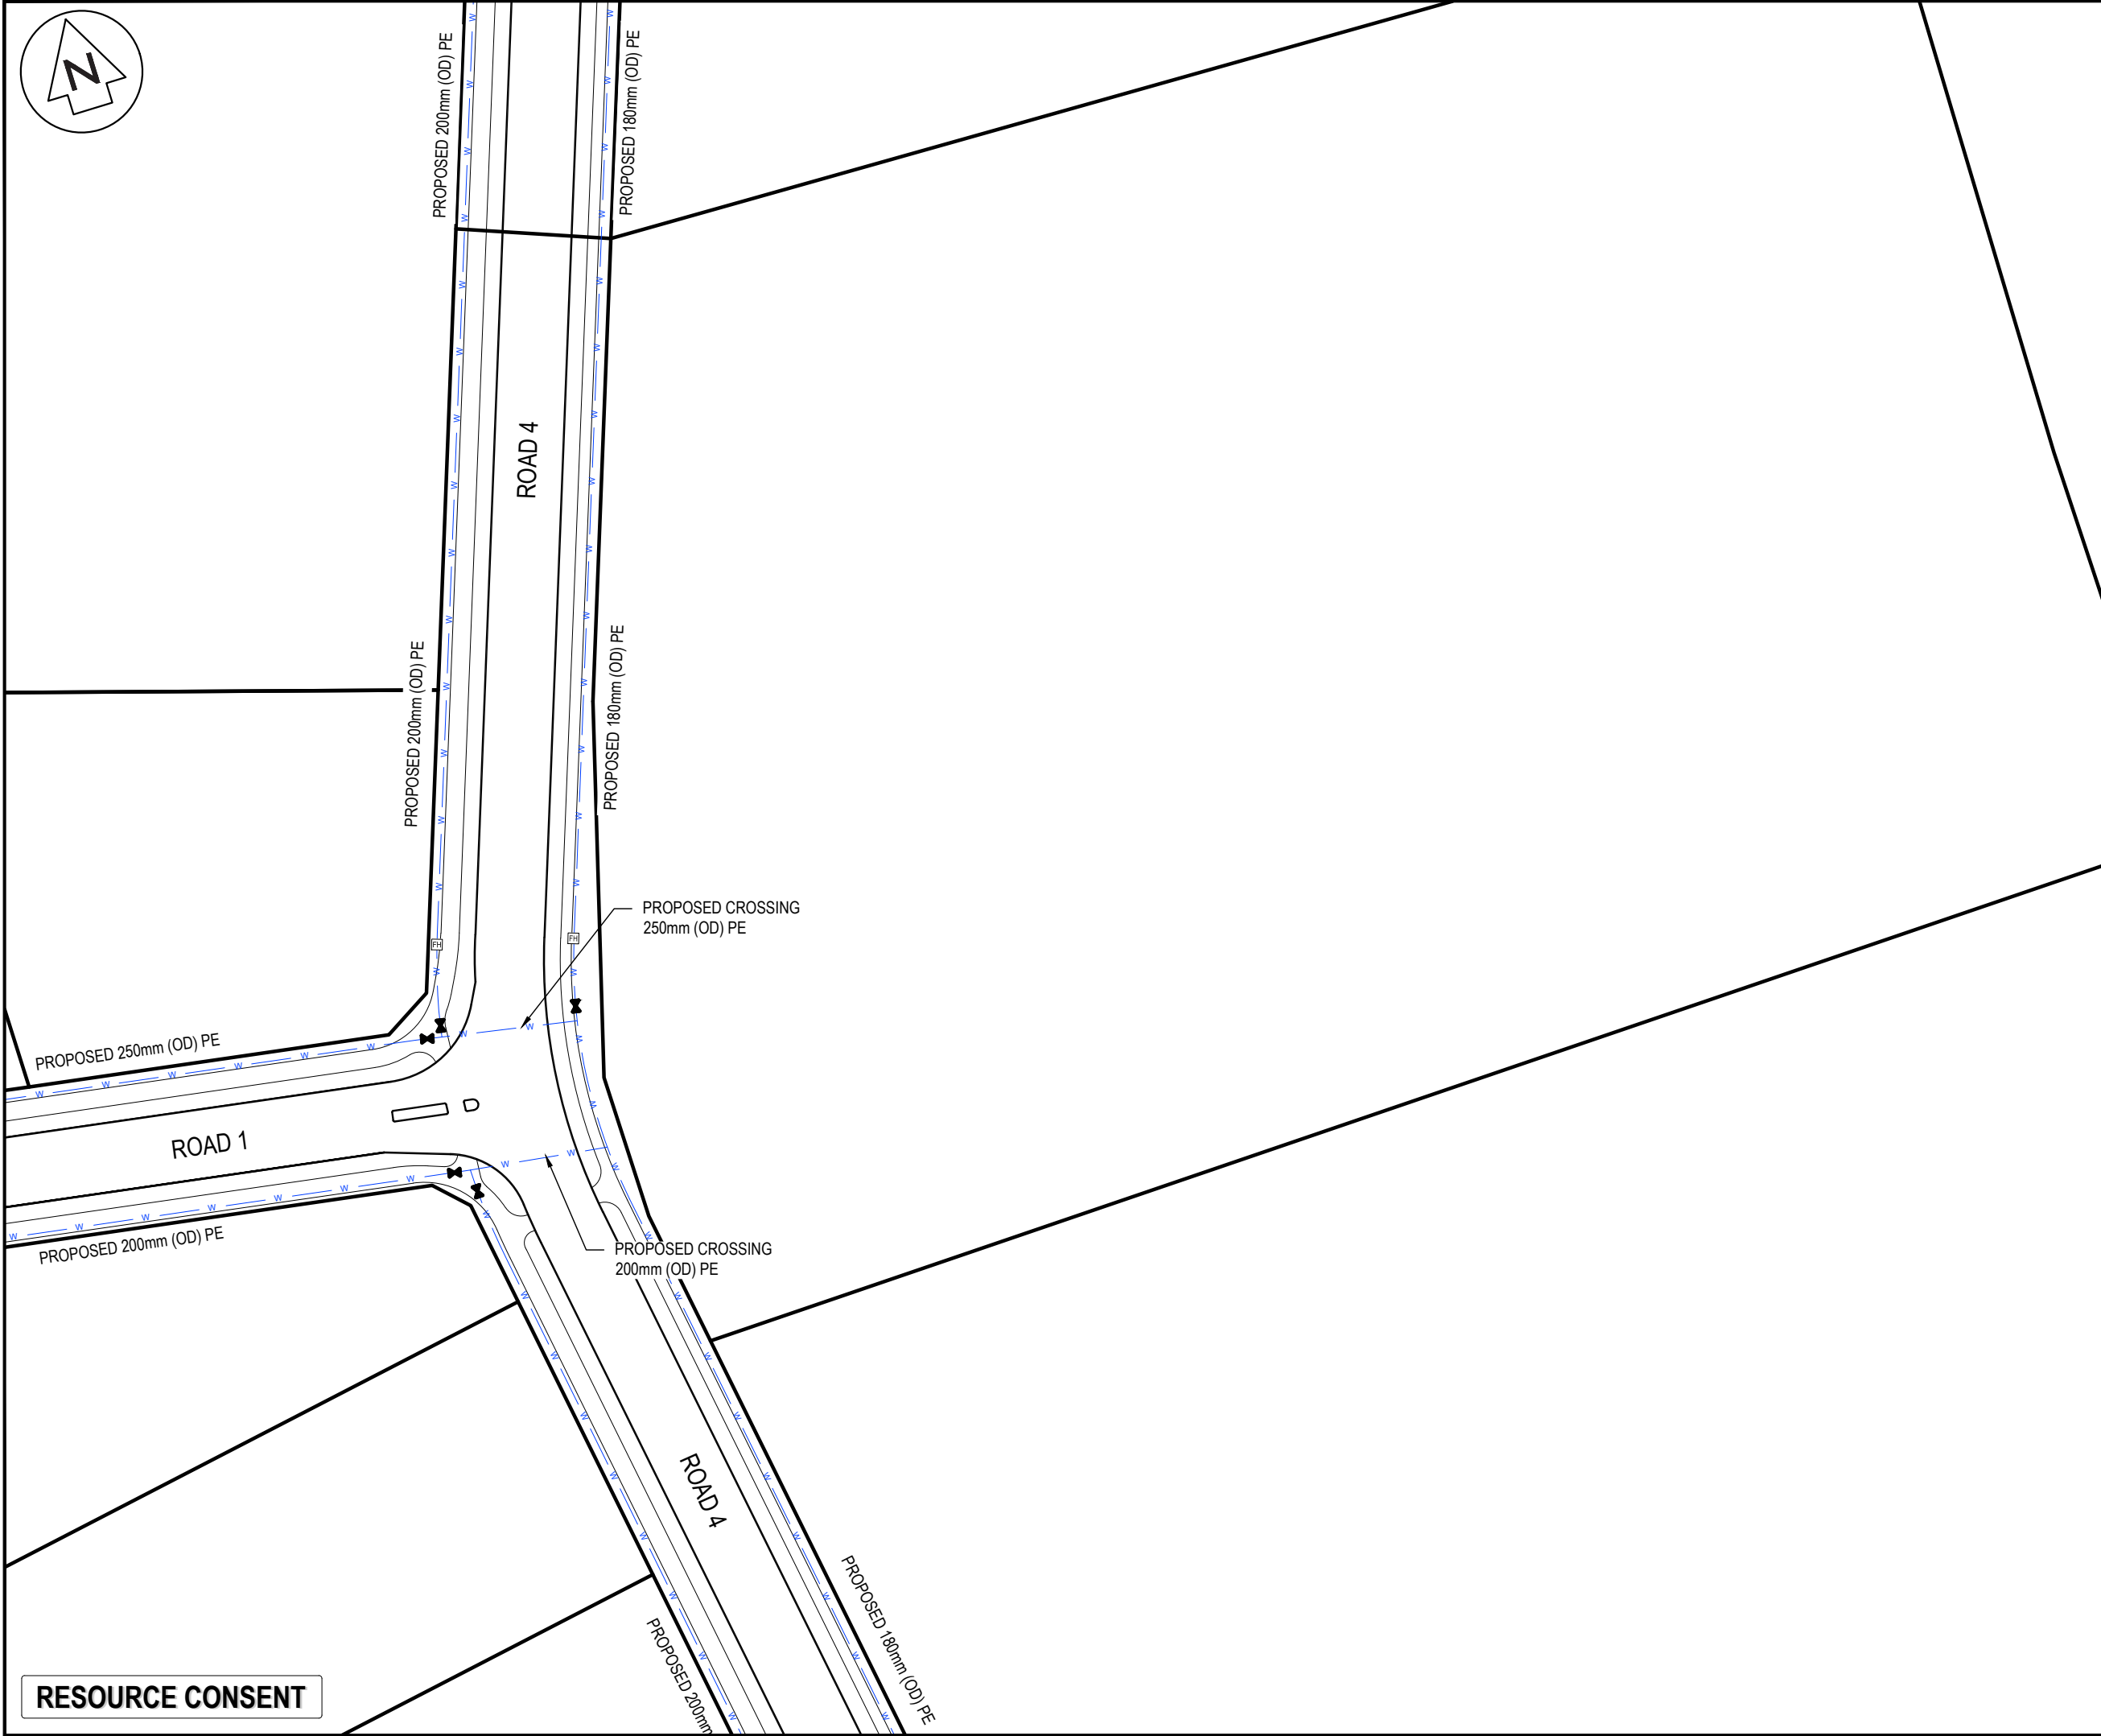

NOTES

- ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
- CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016.
- IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
- MINIMUM COVER SHALL BE:
ROADS AND FRONTIM OF BERM: 900MM
BERMS 600MM
SERVICE CONNECTIONS: 450MM
- WATERMAINS LAID ACROSS ROADS SHALL BE BACKFILLED WITH HARDFILL COMPACTED IN 200MM LAYERS ABOVE THE EMBEDMENT MATERIAL.
- ALL UPVC PIPE SHALL BE PN12 MINIMUM PRESSURE RATED WITH SPIGNOT AND SOCKET RUBBER RING JOINTS.
- ALL PE PIPE SHALL BE PN12.5 MINIMUM PRESSURE RATED WITH BUTT-WELDED. WELD BEADS SHALL BE REMOVED TO PROVIDE A SMOOTH BORE.
- ALL NON-METALIC PIPES ARE TO HAVE TRACER WIRE FITTED TO COUNCIL STANDARDS.
- PIPES SHALL BE BEDDED AND SURROUNDED TO 150MM ABOVE THE PIPE SOFFIT WITH SAND OR AP20.
- METAL DETECTOR TAPE PRINTED WITH 'WATER PIPE BELOW' SHALL BE LAID 150MM ABOVE ALL WATERMAINS.
- A YELLOW ISOSCELES TRIANGLE WITH CATS EYE POINTING TO FH SHALL BE PAINTED IN THE CENTRE OF ALL SEALED ROADS.
- ALL VALVES TO BE MARKED WITH SAWCUT KERB AND BLUE PAINT.
- ALL FLANGE JOINTS TO BE PROTECTED WITH DENSO TAPE OR SIMILAR APPROVED BY THE ENGINEER.

LEGEND

	EX BDY
	PROP BDY
	EX WATERMAIN
	PROP WATERMAIN
	PR WATER PRIVATE
	EX/PROP HYDRANT
	EX/PROP METER
	EX SLUICE VALVE
	EX PEET VALVE
	PROP SLUICE VALVE
	PROP PEET VALVE
	PROP REDUCER

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
		By	Date
Survey	MAVEN		05/2025
Design	JKP		06/2026
Drawn	JKP		06/2026
Checked	SM		09/2026

Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project



**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title

**PROPOSED
WATER SUPPLY
PLAN**

Project no.	298002-IND SL1		
Scale	1:1000 @ A3		
Cad file	298002-11-C600 WS.DWG		
Drawing no.	I1-C600-8	Rev	A

RESOURCE CONSENT

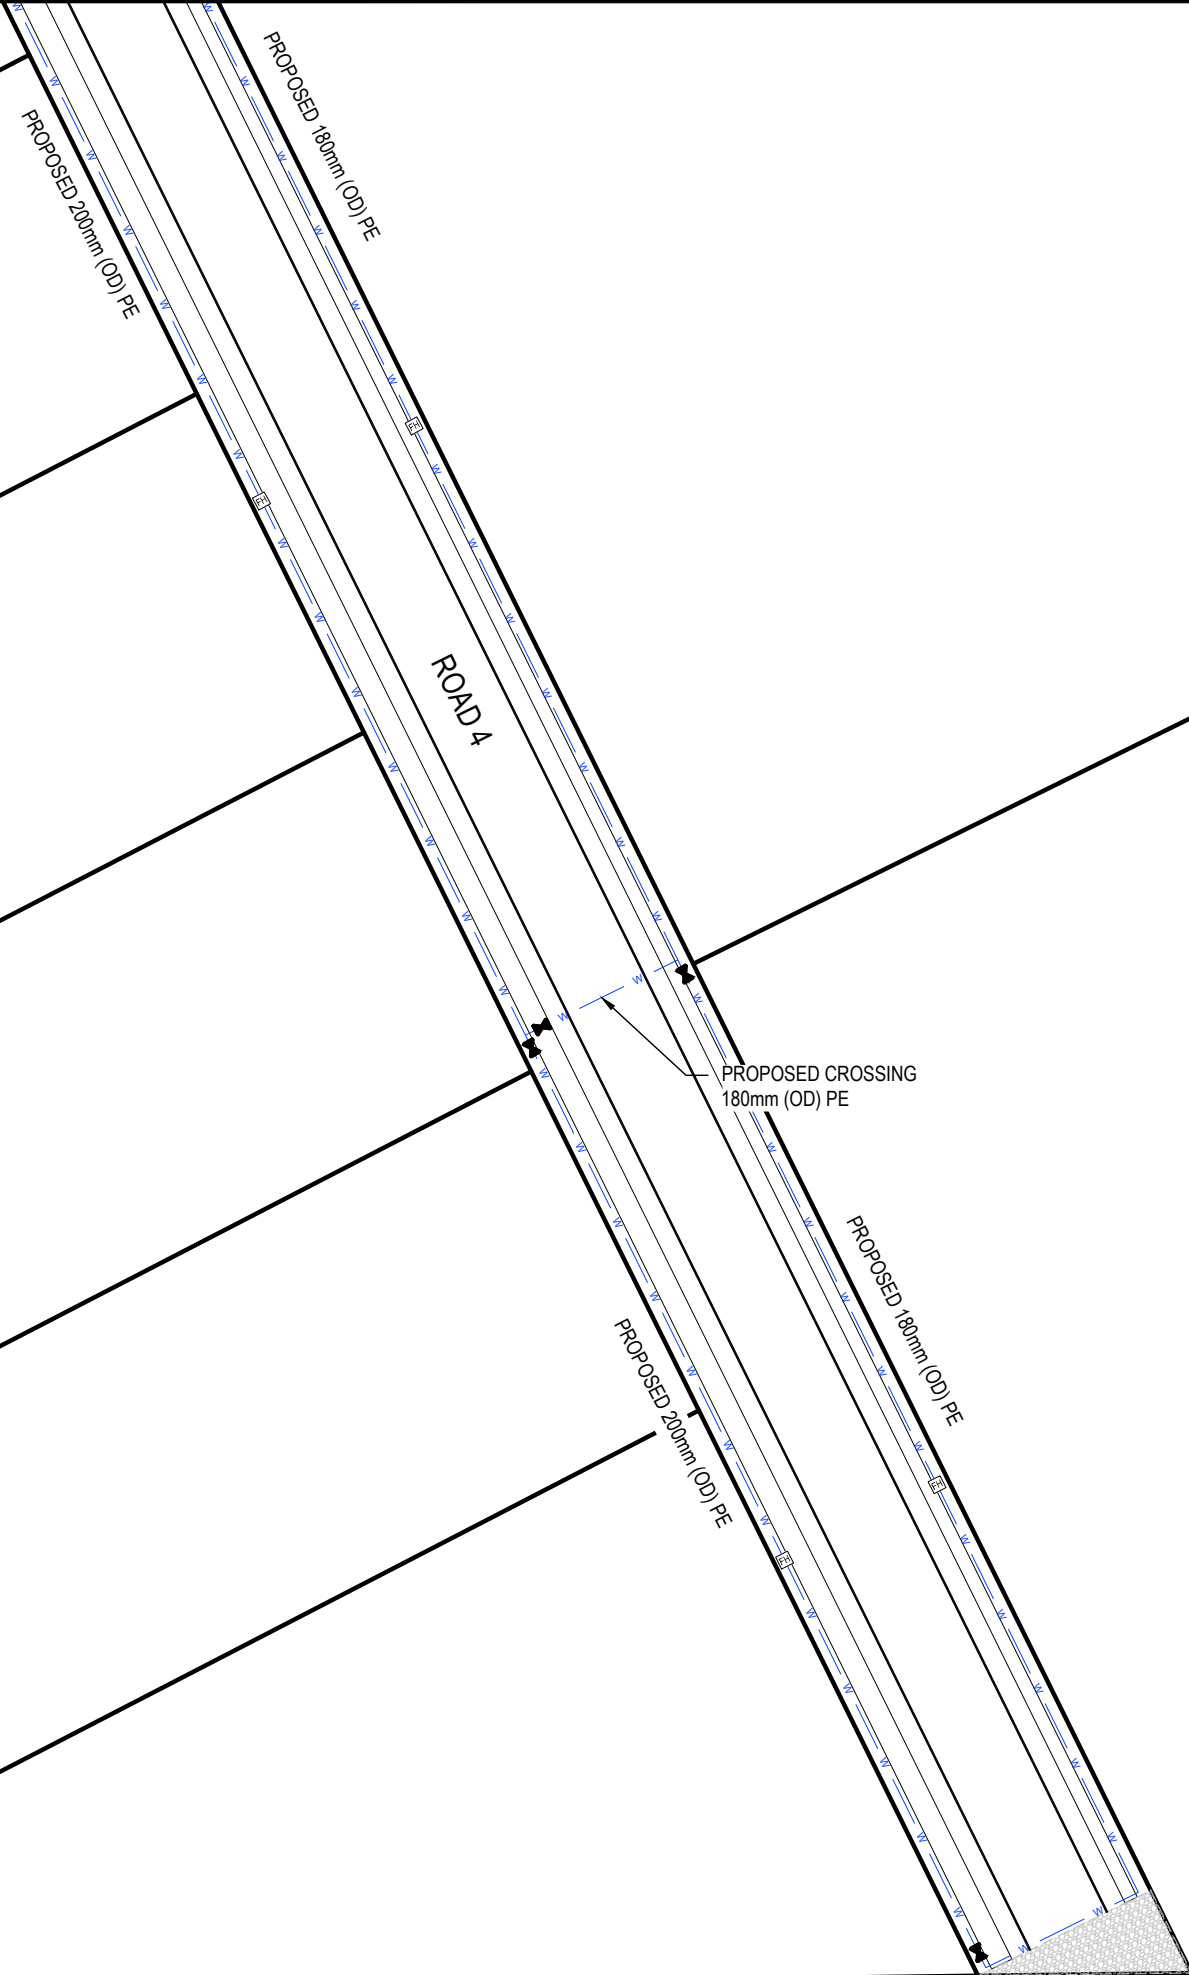

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016.
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
 4. MINIMUM COVER SHALL BE:
ROADS AND FRONTIM OF BERM: 900MM
BERMS 600MM
SERVICE CONNECTIONS: 450MM
 5. WATERMAINS LAID ACROSS ROADS SHALL BE BACKFILLED WITH HARDFILL COMPACTED IN 200MM LAYERS ABOVE THE EMBEDMENT MATERIAL.
 6. ALL UPVC PIPE SHALL BE PN12 MINIMUM PRESSURE RATED WITH SPIGNOT AND SOCKET RUBBER RING JOINTS.
 7. ALL PE PIPE SHALL BE PN12.5 MINIMUM PRESSURE RATED WITH BUTT-WELDED. WELD BEADS SHALL BE REMOVED TO PROVIDE A SMOOTH BORE.
 8. ALL NON-METALIC PIPES ARE TO HAVE TRACER WIRE FITTED TO COUNCIL STANDARDS.
 9. PIPES SHALL BE BEDDED AND SURROUNDED TO 150MM ABOVE THE PIPE SOFFIT WITH SAND OR AP20.
 10. METAL DETECTOR TAPE PRINTED WITH 'WATER PIPE BELOW' SHALL BE LAID 150MM ABOVE ALL WATERMAINS.
 11. A YELLOW ISOSCELES TRIANGLE WITH CATS EYE POINTING TO FH SHALL BE PAINTED IN THE CENTRE OF ALL SEALED ROADS.
 12. ALL VALVES TO BE MARKED WITH SAWCUT KERB AND BLUE PAINT.
 13. ALL FLANGE JOINTS TO BE PROTECTED WITH DENSO TAPE OR SIMILAR APPROVED BY THE ENGINEER.

LEGEND

	EX BDY
	PROP BDY
	EX WATERMAIN
	PROP WATERMAIN
	PR WATER PRIVATE
	EX/PROP HYDRANT
	EX/PROP METER
	EX SLUICE VALVE
	EX PEET VALVE
	PROP SLUICE VALVE
	PROP PEET VALVE
	PROP REDUCER

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	By	Date	
Survey	MAVEN	05/2025	
Design	JPK	06/2026	
Drawn	JPK	06/2026	
Checked	SM	09/2026	

Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project

**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**




Title

**PROPOSED
WATER SUPPLY
PLAN**

Project no.	298002-IND SL1		
Scale	1:1000 @ A3		
Cad file	298002-11-C600 WS.DWG		
Drawing no.	11-C600-9	Rev	A

RESOURCE CONSENT

DATE: 9/2/26 FILEPATH: F:\MAVEN\HAMILTON\6. PROJECTS\298002 - SOUTHERN LINKS\11\09\298002-H-C600 WS.DWG

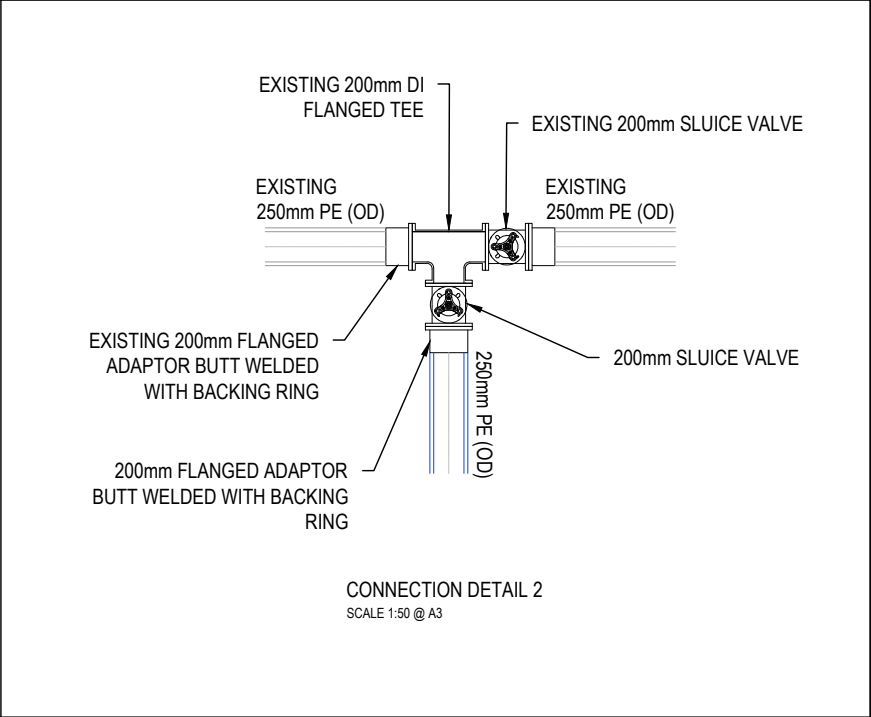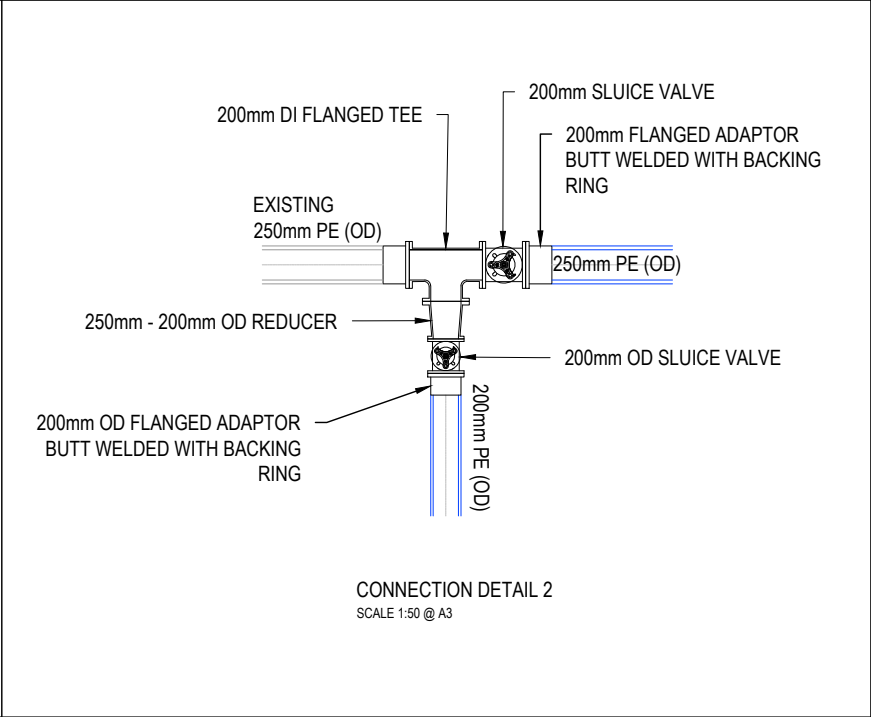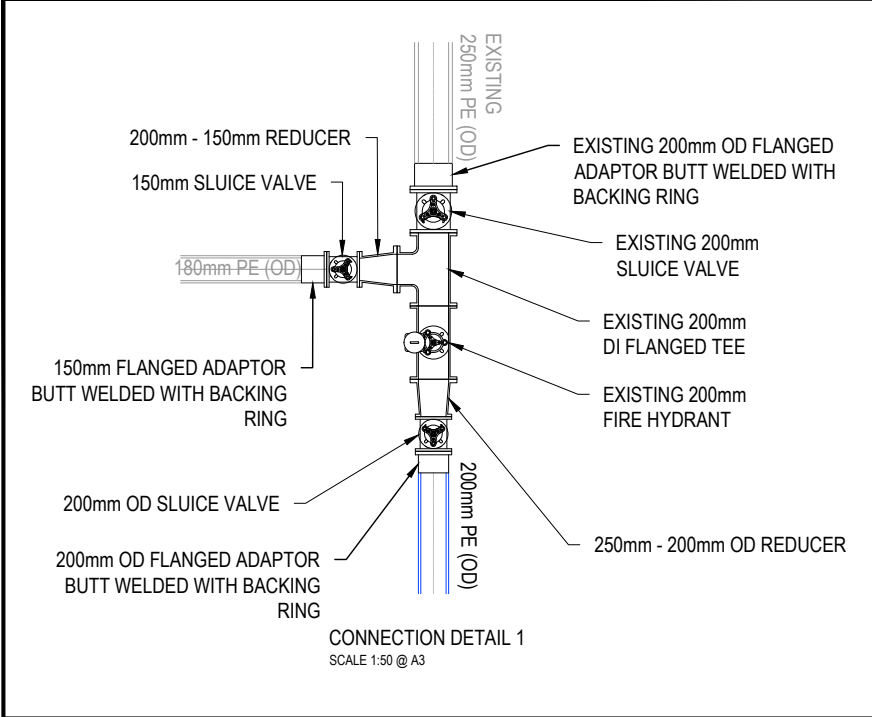

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016.
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
 4. MINIMUM COVER SHALL BE:
ROADS AND FRONTIM OF BERM: 900MM
BERMS 600MM
SERVICE CONNECTIONS: 450MM
 5. WATERMAINS LAID ACROSS ROADS SHALL BE BACKFILLED WITH HARDFILL COMPACTED IN 200MM LAYERS ABOVE THE EMBEDMENT MATERIAL.
 6. ALL UPVC PIPE SHALL BE PN12 MINIMUM PRESSURE RATED WITH SPIGNOT AND SOCKET RUBBER RING JOINTS.
 7. ALL PE PIPE SHALL BE PN12.5 MINIMUM PRESSURE RATED WITH BUTT-WELDED. WELD BEADS SHALL BE REMOVED TO PROVIDE A SMOOTH BORE.
 8. ALL NON-METALIC PIPES ARE TO HAVE TRACER WIRE FITTED TO COUNCIL STANDARDS.
 9. PIPES SHALL BE BEDDED AND SURROUNDED TO 150MM ABOVE THE PIPE SOFFIT WITH SAND OR AP20.
 10. METAL DETECTOR TAPE PRINTED WITH 'WATER PIPE BELOW' SHALL BE LAID 150MM ABOVE ALL WATERMAINS.
 11. A YELLOW ISOSCELES TRIANGLE WITH CATS EYE POINTING TO FH SHALL BE PAINTED IN THE CENTRE OF ALL SEALED ROADS.
 12. ALL VALVES TO BE MARKED WITH SAWCUT KERB AND BLUE PAINT.
 13. ALL FLANGE JOINTS TO BE PROTECTED WITH DENSO TAPE OR SIMILAR APPROVED BY THE ENGINEER.

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	By	Date	
Survey	MAVEN	06/2025	
Design	JPK	11/2025	
Drawn	JPK	11/2025	
Checked	SM	09/2026	

M

A

E

N

Maven Waikato

07 242 0601

info@maven.co.nz

www.maven.co.nz

Level 1 286 Victoria Street, Hamilton



New Zealand

Project
SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM



Title
PROPOSED
WATER SUPPLY
CONNECTION DETAILS

Project no.	298002-IND SL1		
Scale	AS SHOWN		
Cad file	298002-11-C600 WS.DWG		
Drawing no.	R1-C650-1	Rev	A

RESOURCE CONSENT

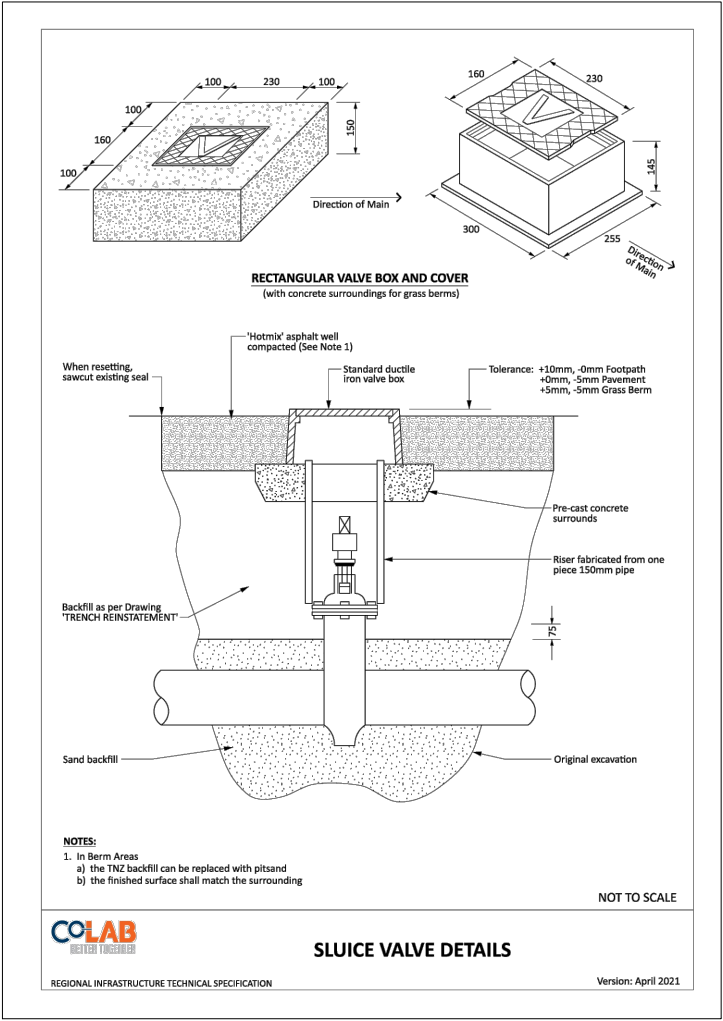
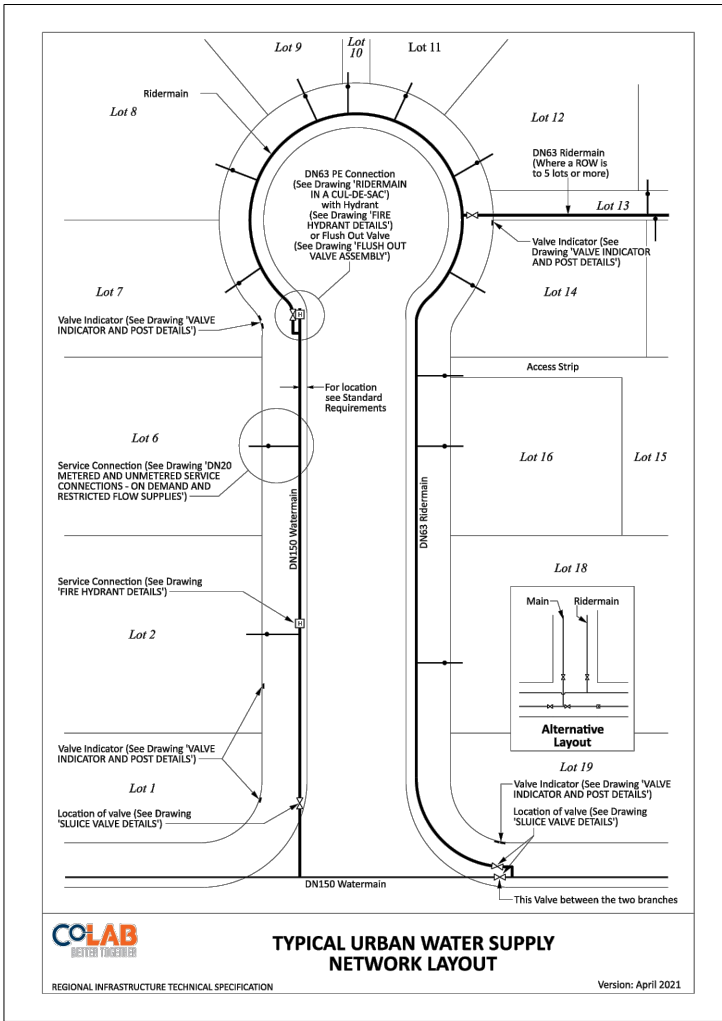


- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 777m.
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. ALL CONCRETE SW PIPE TO BE INSTALLED IN ACCORDANCE WITH AS/NZS 3725:2007 FOR BURIED CONCRETE PIPES AND AS/NZ 4058:2007 FOR PRECAST CONCRETE PIPES (PRESSURE AND NON-PRESSURE) AS STIPULATED IN THE RITS 2018
 5. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL STORMWATER LINES WITHIN THE ROAD RESERVE.
 6. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS.
 7. ALL CESSPIT LEADS SHALL HAVE MIN COVER 0.9m.
 8. ALL LINES ARE TO BE CLASS4 RCRRJ UNLESS SHOWN OTHERWISE.
 9. ALL LINES TO BE ABANDONED SHALL BE SEALED AT EACH END. TIMING OF ALL SEALING TO BE COORDINATED WITH COUNCIL STAFF.

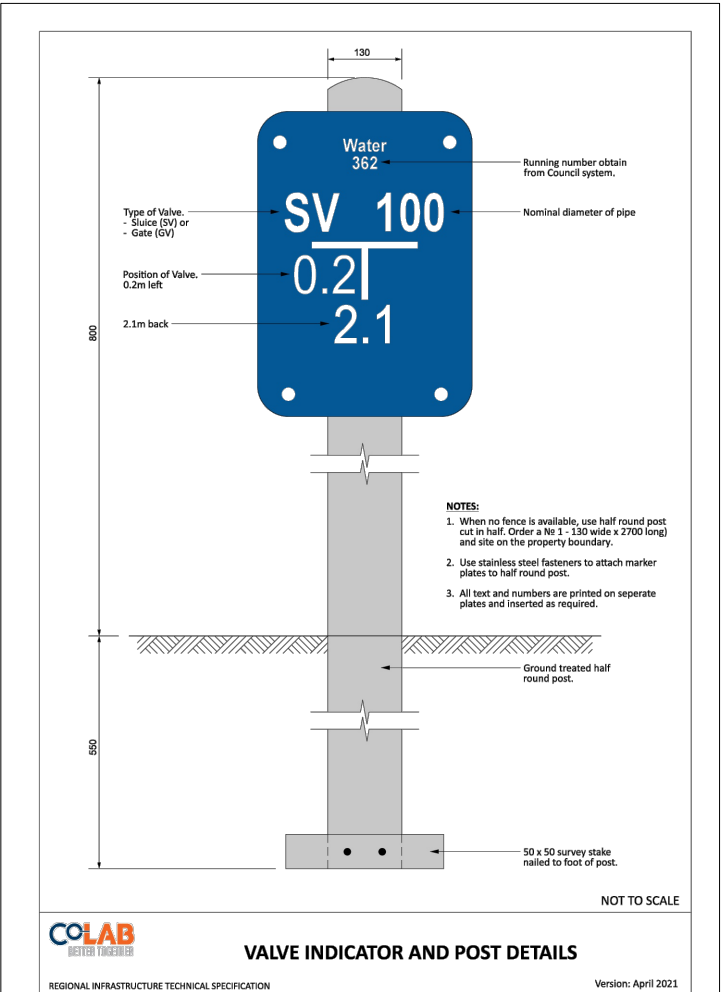
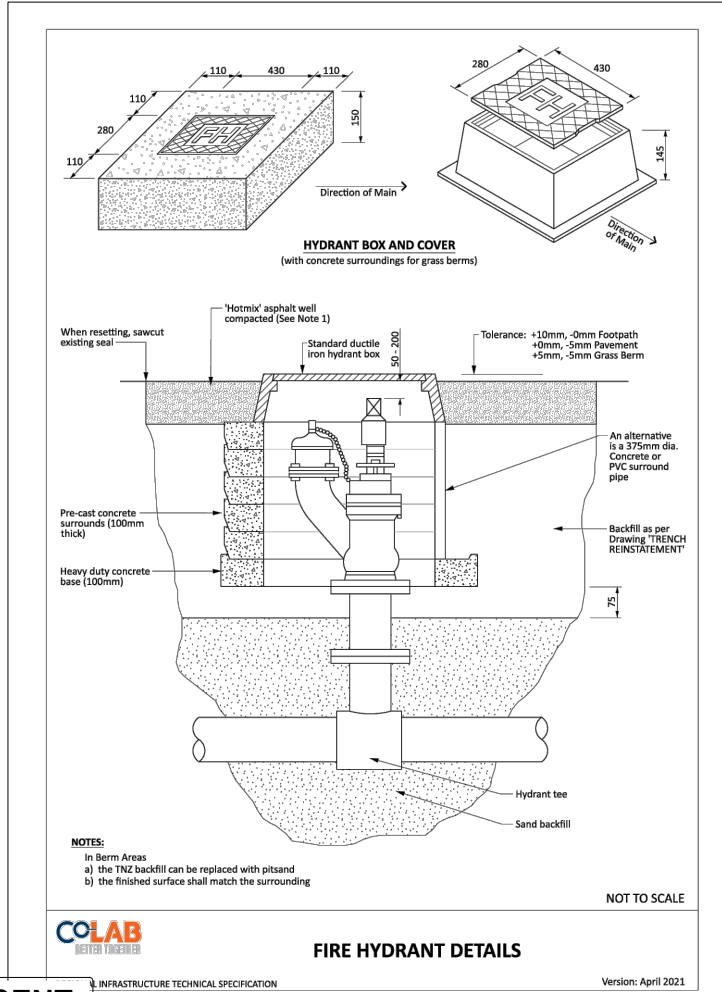


A	FAST TRACK APP	MKS	09/2026
Rev	Description	By	Date
		By	Date
Survey	-- / --	-- / --	
Design	JPK	06/2026	
Drawn	JPK	06/2026	
Checked	SM	09/2026	
M M A E N Maven Waikato 07 242 0601 info@maven.co.nz www.maven.co.nz Level 1 286 Victoria Street, Hamilton New Zealand			
Project			
SOUTHERN LINKS 1			
RESIDENTIAL STAGE 1			
HAMILTON, WAIKATO			
FOR SL1			
NORTHERN CONSORTIUM			
Title			
PROPOSED			
WATER SUPPLY			
STANDARD DETAILS			
Project no.	298001-R1 SL1		
Scale	1:100 @ A3		
Cad file	298002-11-C680 WS STANDARD DETAILS.DWG		
Drawing no.	I1-C680-1	Rev	A

DATE: 9/2/25 FILE PATH: \\MAVEN\MAVEN\CONSULTING\CO-NZ\SHARE\REQ\RES\HAMILTON\6-PROJECTS\298002-11-11\DWG\298002-11-C680-WS STANDARD DETAILS.DWG

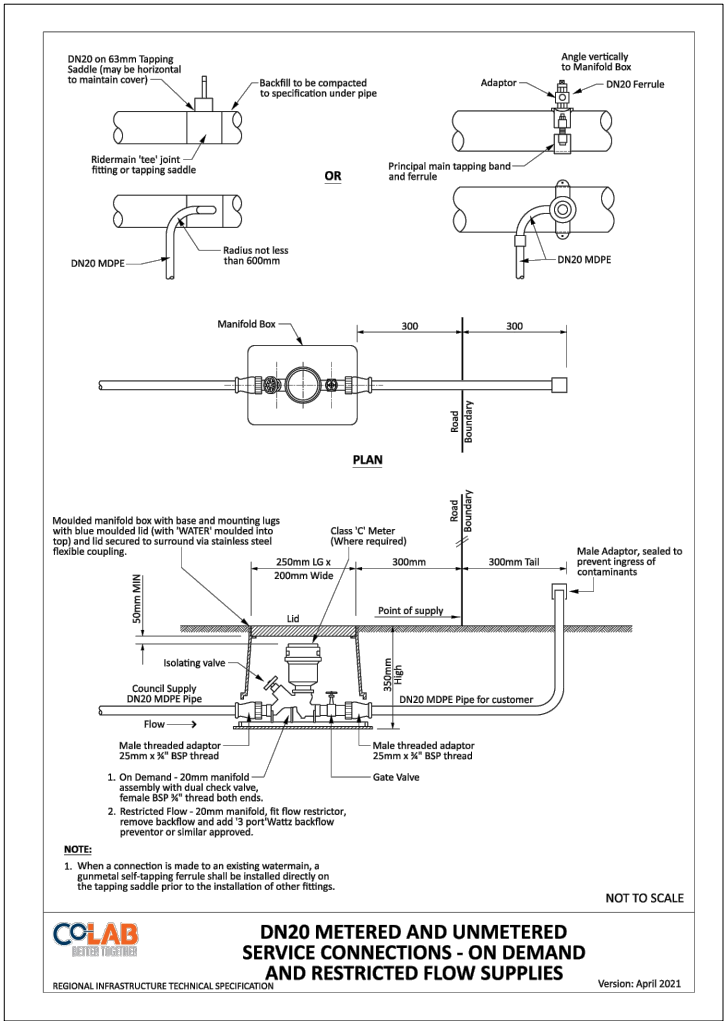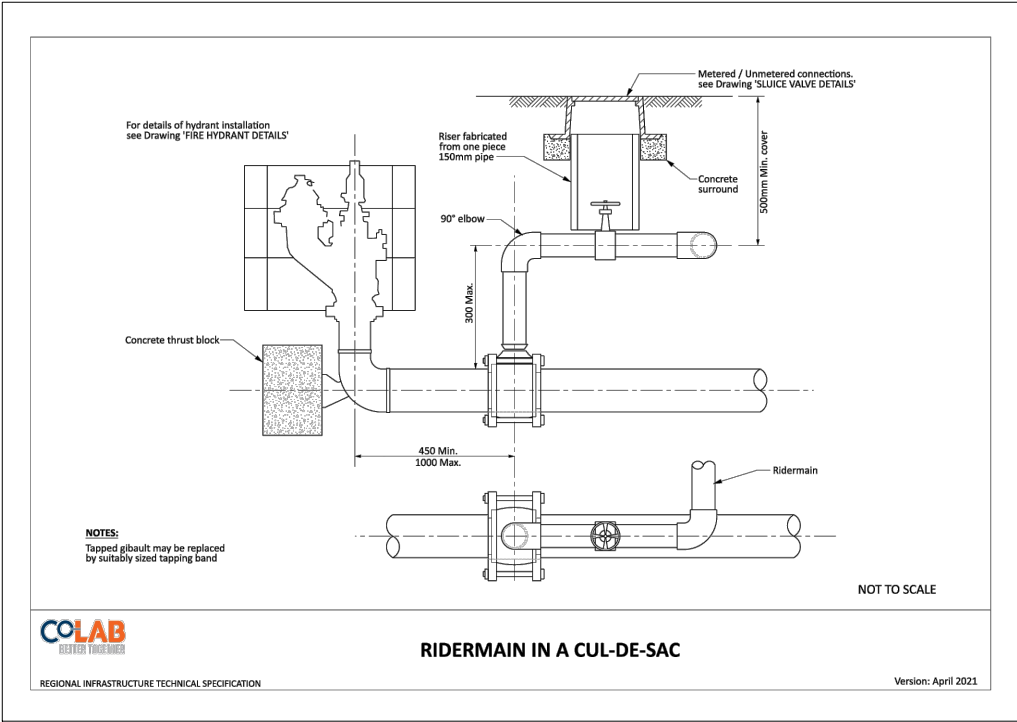





- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 777m.
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. ALL CONCRETE SW PIPE TO BE INSTALLED IN ACCORDANCE WITH AS/NZS 3725:2007 FOR BURIED CONCRETE PIPES AND AS/NZ 4058:2007 FOR PRECAST CONCRETE PIPES (PRESSURE AND NON-PRESSURE) AS STIPULATED IN THE RITS 2018
 5. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL STORMWATER LINES WITHIN THE ROAD RESERVE.
 6. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS.
 7. ALL CESSPIT LEADS SHALL HAVE MIN COVER 0.9m.
 8. ALL LINES ARE TO BE CLASS4 RCRRJ UNLESS SHOWN OTHERWISE.
 9. ALL LINES TO BE ABANDONED SHALL BE SEALED AT EACH END. TIMING OF ALL SEALING TO BE COORDINATED WITH COUNCIL STAFF.

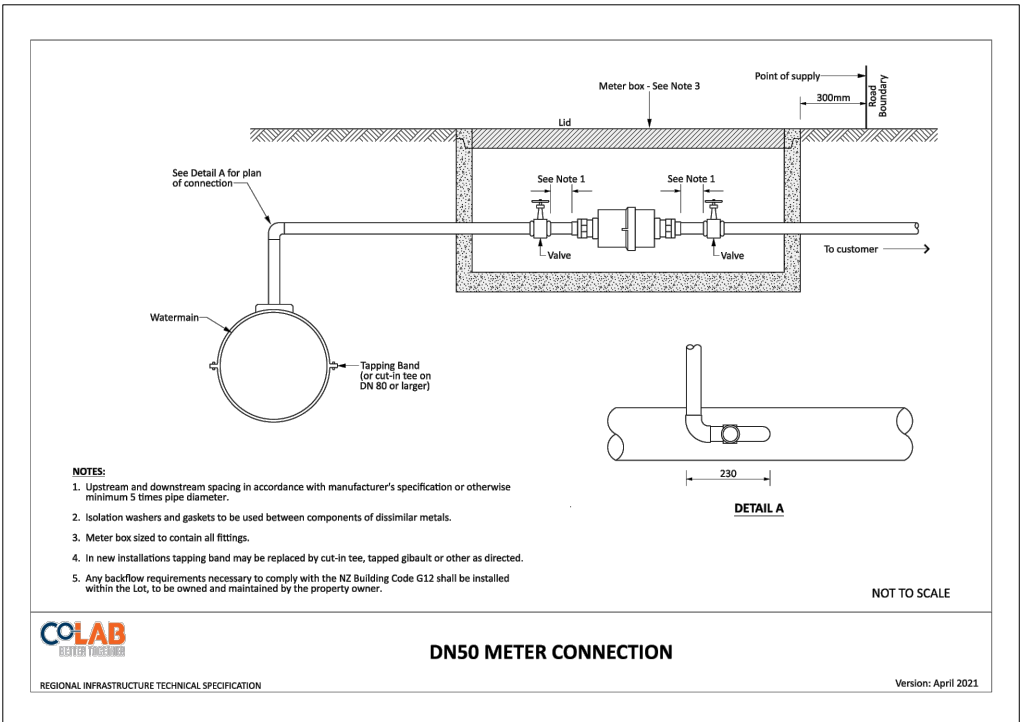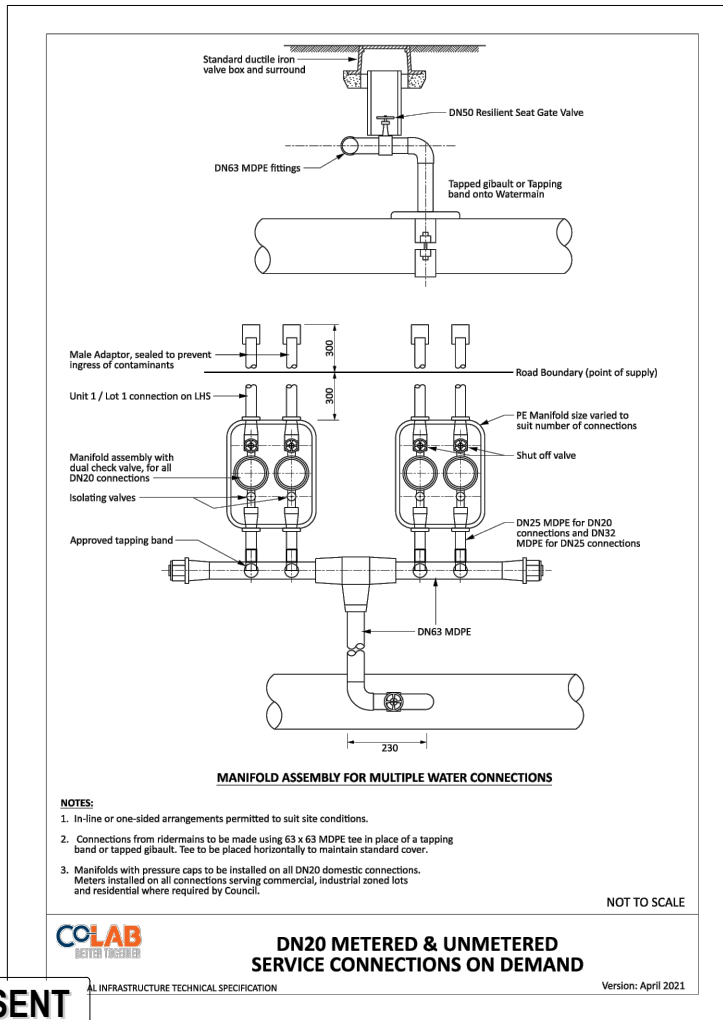

A	FAST TRACK APP	MKS	09/2026
Rev	Description	By	Date
Survey	-- / --	-- / --	
Design	JPK	06/2026	
Drawn	JPK	06/2026	
Checked	SM	09/2026	
M MAVEN Maven Waikato 07 242 0601 info@maven.co.nz www.maven.co.nz Level 1 286 Victoria Street, Hamilton New Zealand			
Project			
SOUTHERN LINKS 1			
RESIDENTIAL STAGE 1			
HAMILTON, WAIKATO			
FOR SL1			
NORTHERN CONSORTIUM			
Title			
PROPOSED			
WATER SUPPLY			
STANDARD DETAILS			
Project no.	298001-R1 SL1		
Scale	1:100 @ A3		
Cad file	298002-11-C680 WS STANDARD DETAILS.DWG		
Drawing no.	I1-C680-2	Rev	A

RESOURCE CONSENT

DATE: 9/2/25 FILE PATH: \\MAVEN\MAVEN\CONSULTING\CO NZ\SHARE\CURRENT\MAVEN - HAMILTON\6. PROJECT\298002-11-C680\WS STANDARD DETAILS.DWG

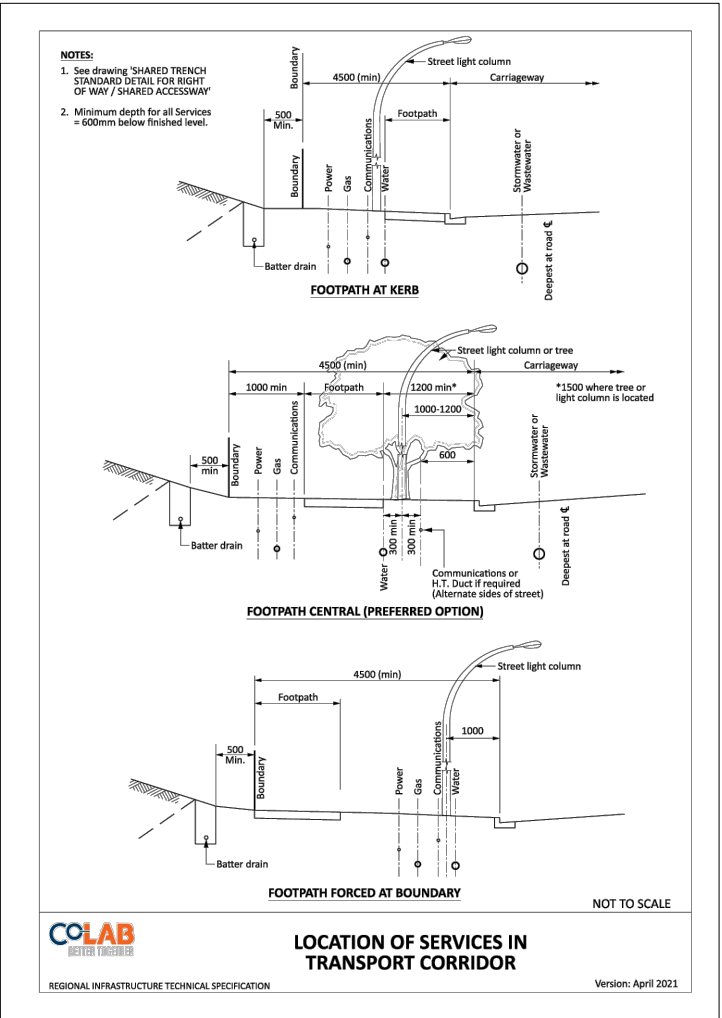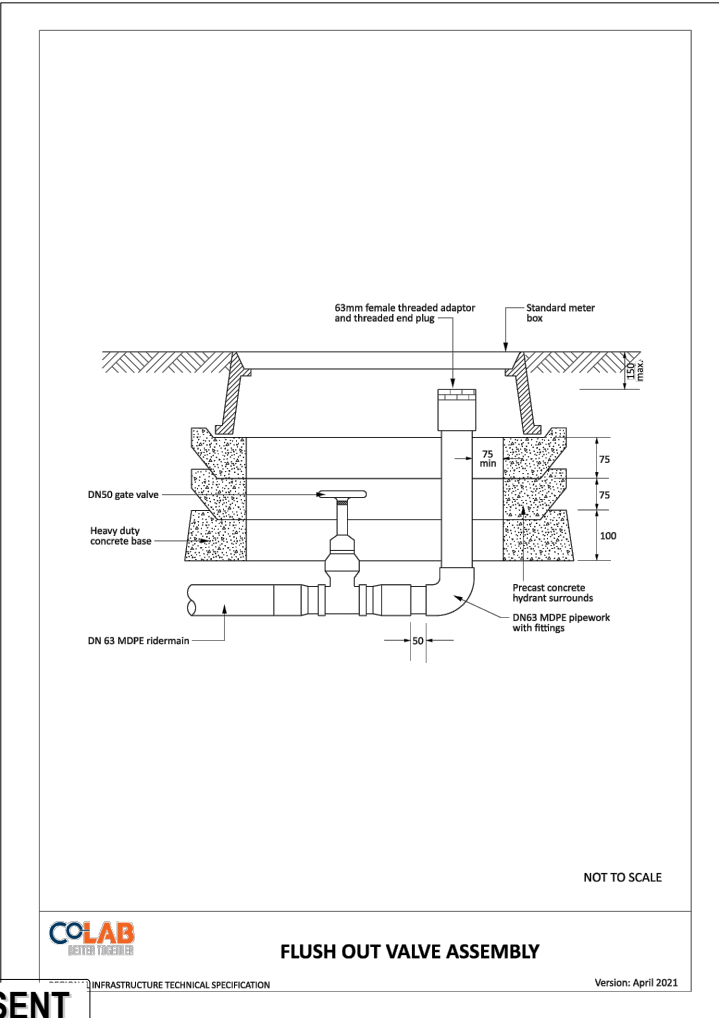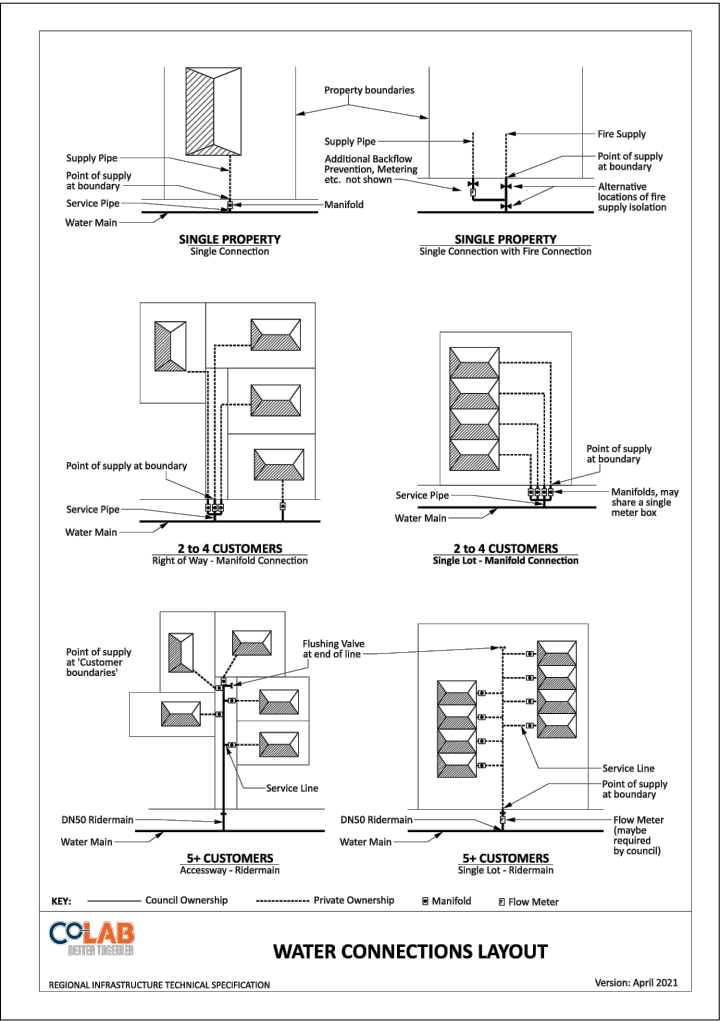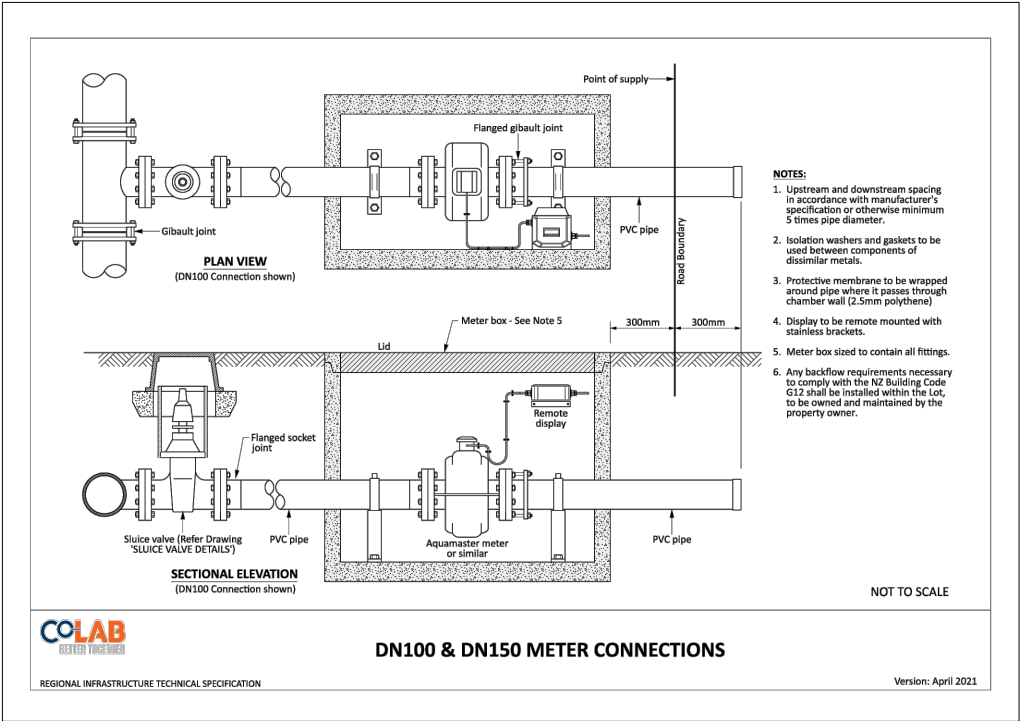


- NOTES**
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 777m.
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. ALL CONCRETE SW PIPE TO BE INSTALLED IN ACCORDANCE WITH AS/NZS 3725:2007 FOR BURIED CONCRETE PIPES AND AS/NZ 4058:2007 FOR PRECAST CONCRETE PIPES (PRESSURE AND NON-PRESSURE) AS STIPULATED IN THE RITS 2018
 5. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL STORMWATER LINES WITHIN THE ROAD RESERVE.
 6. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS.
 7. ALL CESSPIT LEADS SHALL HAVE MIN COVER 0.9m.
 8. ALL LINES ARE TO BE CLASS4 RCRRJ UNLESS SHOWN OTHERWISE.
 9. ALL LINES TO BE ABANDONED SHALL BE SEALED AT EACH END. TIMING OF ALL SEALING TO BE COORDINATED WITH COUNCIL STAFF.

A	FAST TRACK APP	MKS	09/2026
Rev	Description	By	Date
		By	Date
Survey	-- / --	-- / --	
Design	JPK	06/2026	
Drawn	JPK	06/2026	
Checked	SM	09/2026	
M MAVEN Maven Waikato 07 242 0601 info@maven.co.nz www.maven.co.nz Level 1 286 Victoria Street, Hamilton New Zealand			
Project			
SOUTHERN LINKS 1			
RESIDENTIAL STAGE 1			
HAMILTON, WAIKATO			
FOR SL1			
NORTHERN CONSORTIUM			
Title			
PROPOSED			
WATER SUPPLY			
STANDARD DETAILS			
Project no.	298001-R1 SL1		
Scale	1:100 @ A3		
Cad file	298002-11-C680 WS STANDARD DETAILS.DWG		
Drawing no.	I1-C680-3	Rev	A


DATE: 9/2/26 FILE PATH: \\MAVEN\MAVEN\CONSULTING\CON\SHARE\CURRENT\MAVEN_HAMILTON_6 PROJECT: S298002 - SL1 SL1 (11-DWG) S298002-11-C680 WS STANDARD DETAILS.DWG

RESOURCE CONSENT

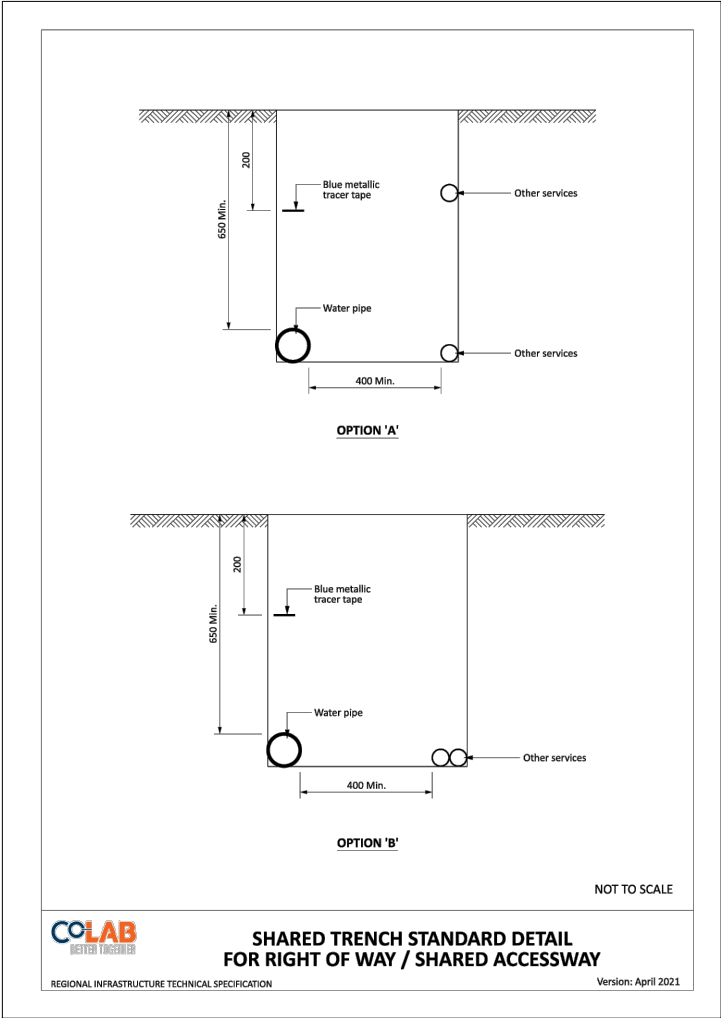

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000. LEVELS IN TERMS OF THE NEW ZEALAND VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING ???m.
 3. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ALL SERVICES THAT MAY BE AFFECTED BY HIS OPERATIONS.
 4. ALL CONCRETE SW PIPE TO BE INSTALLED IN ACCORDANCE WITH AS/NZS 3725:2007 FOR BURIED CONCRETE PIPES AND AS/NZ 4058:2007 FOR PRECAST CONCRETE PIPES (PRESSURE AND NON-PRESSURE) AS STIPULATED IN THE RITS 2018
 5. APPROVED HARDFILL IS TO BE USED IN BACKFILLING OF ALL STORMWATER LINES WITHIN THE ROAD RESERVE.
 6. HEAVY DUTY MANHOLE LIDS AND FRAMES TO BE USED IN TRAFFICKED AREAS.
 7. ALL CESSPIT LEADS SHALL HAVE MIN COVER 0.9m.
 8. ALL LINES ARE TO BE CLASS4 RCRRJ UNLESS SHOWN OTHERWISE.
 9. ALL LINES TO BE ABANDONED SHALL BE SEALED AT EACH END. TIMING OF ALL SEALING TO BE COORDINATED WITH COUNCIL STAFF.

A	FAST TRACK APP	MKS	09/2026
Rev	Description	By	Date
	By	Date	
Survey	-- / --	-- / --	
Design	JPK	06/2026	
Drawn	JPK	06/2026	
Checked	SM	09/2026	
M MAVEN Maven Waikato 07 242 0601 info@maven.co.nz www.maven.co.nz Level 1 286 Victoria Street, Hamilton New Zealand			
Project			
SOUTHERN LINKS 1			
RESIDENTIAL STAGE 1			
HAMILTON, WAIKATO			
FOR SL1			
NORTHERN CONSORTIUM			
Title			
PROPOSED			
WATER SUPPLY			
STANDARD DETAILS			
Project no.	298001-R1 SL1		
Scale	1:100 @ A3		
Cad file	298002-11-C680 WS STANDARD DETAILS.DWG		
Drawing no.	I1-C680-4	Rev	A

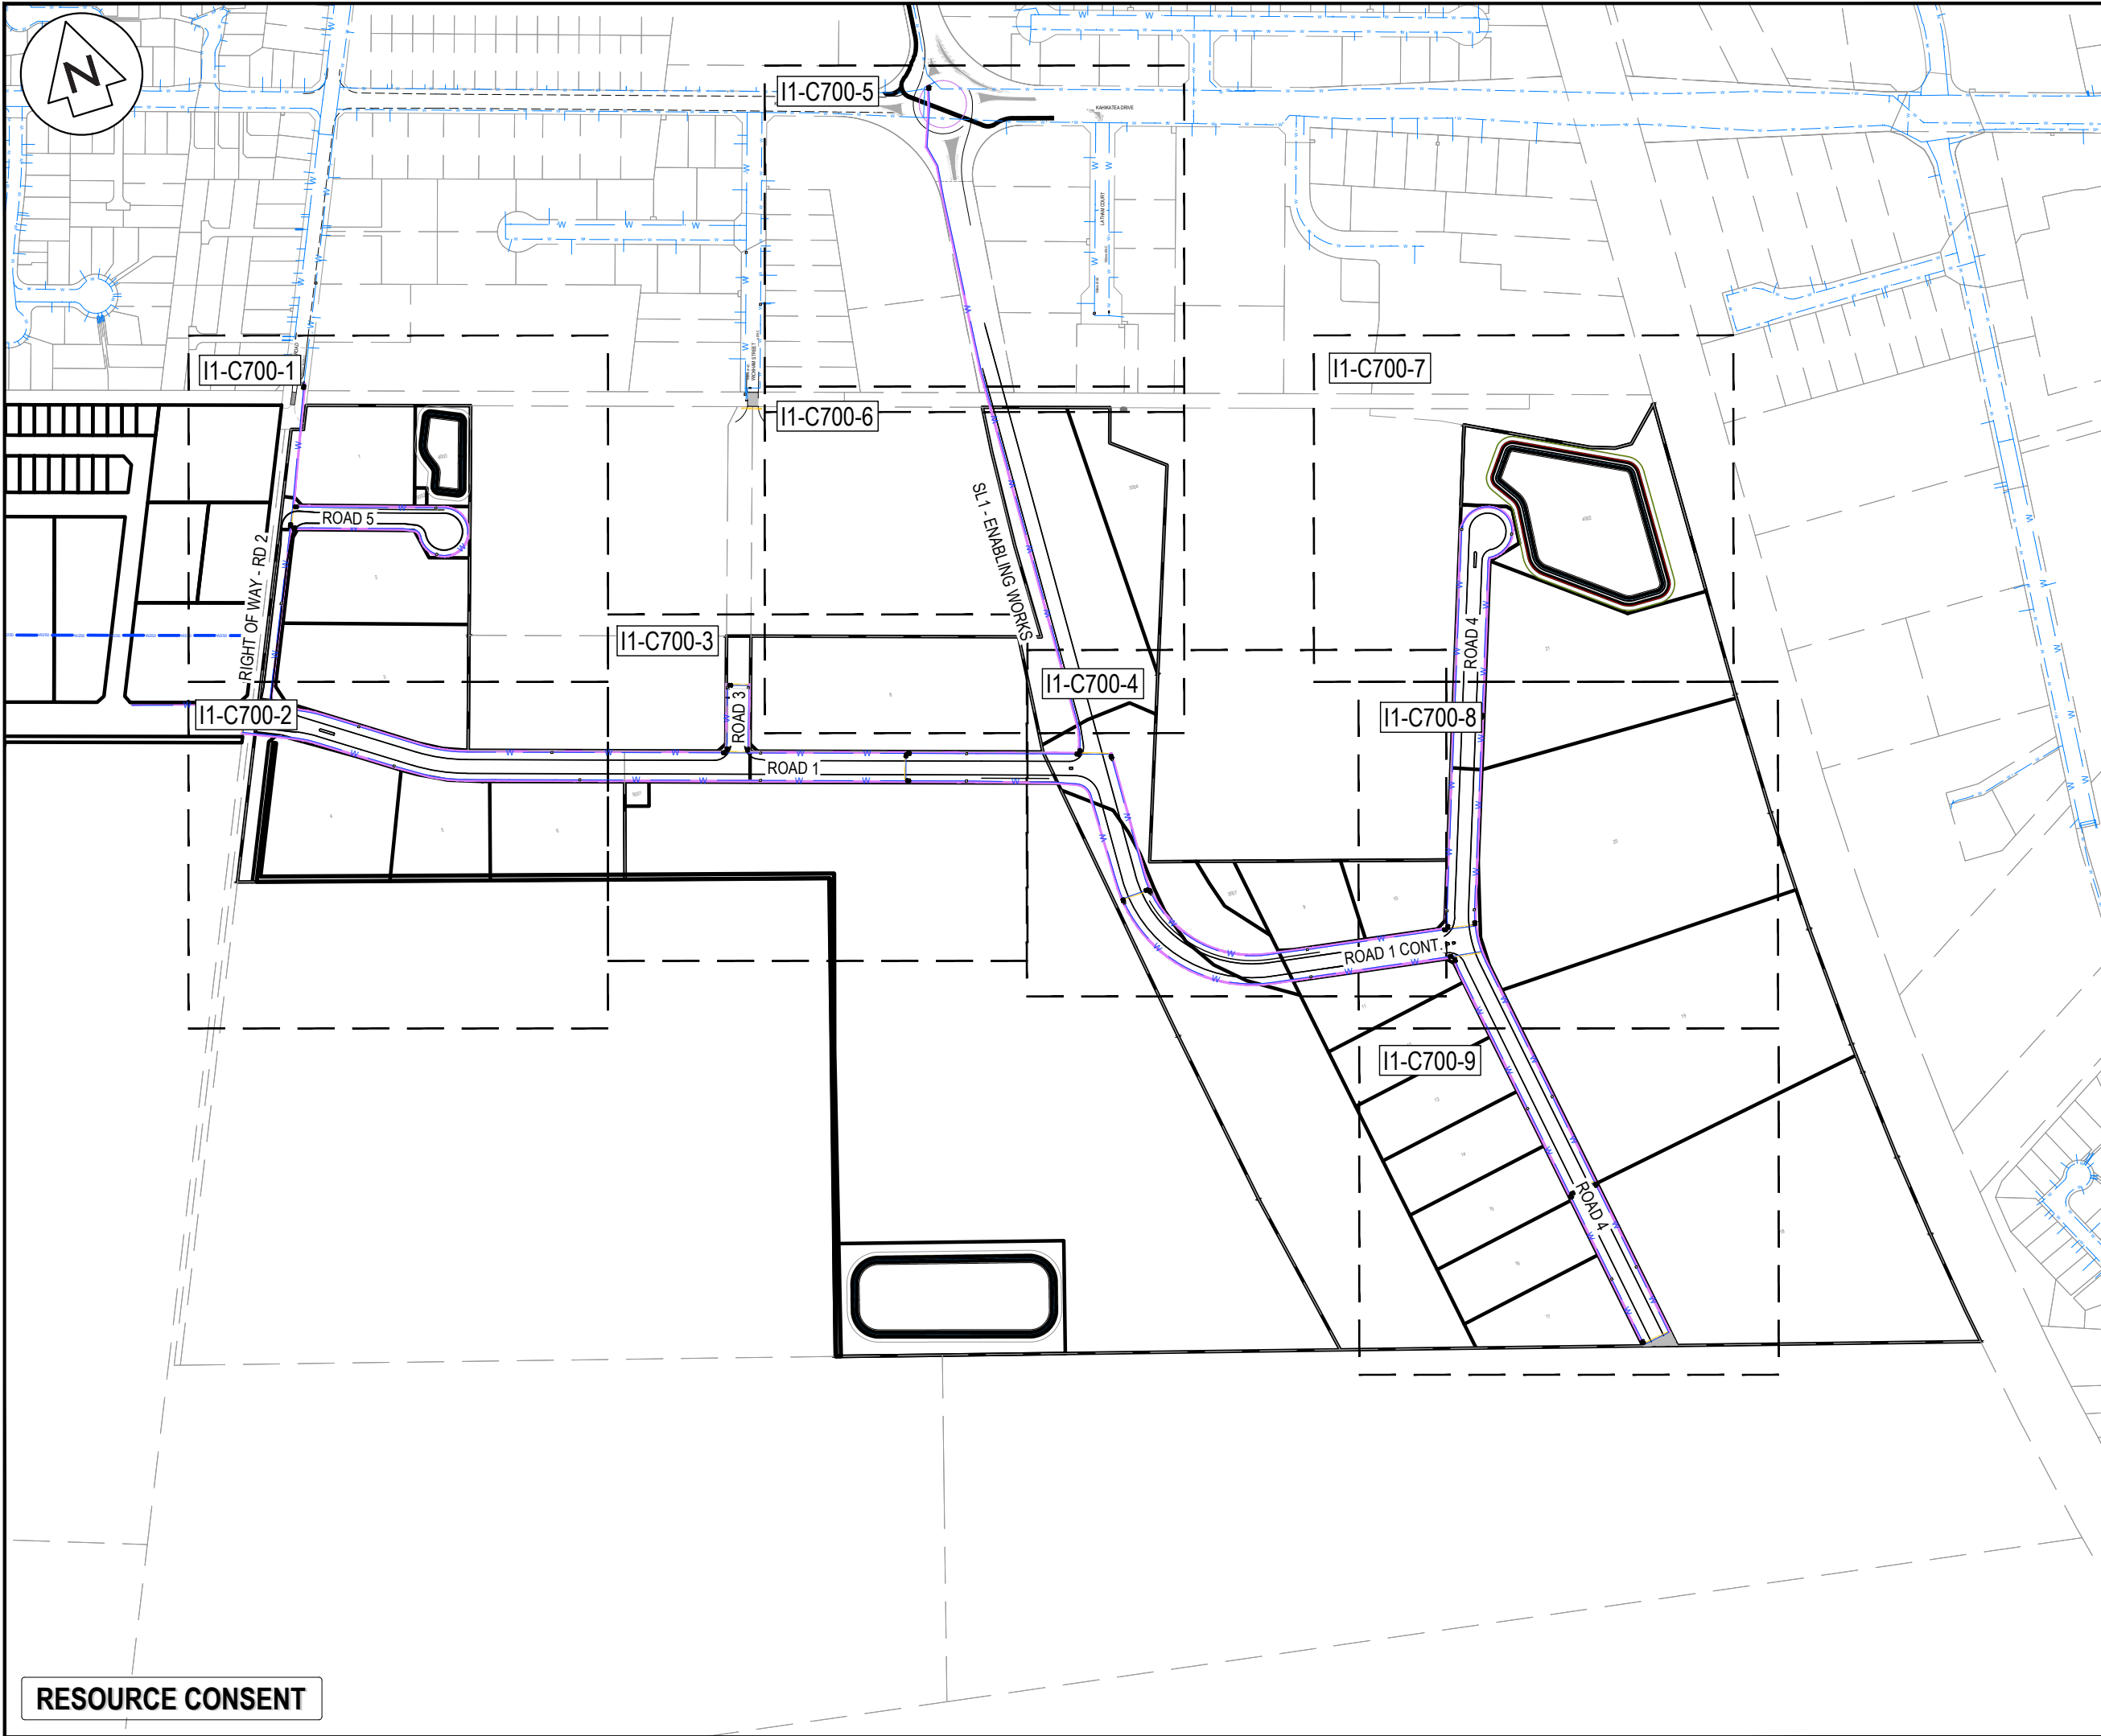

NOTES

1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000
3. LEVELS IN TERMS OF THE NZ VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M. BOUNDARIES ARE SUBJECT TO FINAL SURVEY.
4. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
5. MINIMUM COVER SHALL BE:
ROADS, FOOTPATHS, CROSSINGS: 1000MM
BERMS: 600MM
6. UTILITY SERVICES SHALL BE INSTALLED IN ACCORDANCE WITH PROVIDERS SPECIFICATION.
7. SERVICE TRENCHES UNDER ROADS, ACCESSWAYS AND PATHS SHALL BE HARDFILLED BACKFILLED AND COMPACTED IN 200MM LAYERS.
8. WORK AREAS SHALL BE REINSTATED TO AN EQUAL STANDARD BEFORE WORK STARTED.
9. UTILITY SERVICES SHALL MAINTAIN MINIMUM CLEARANCES TO STORMWATER AND WASTEWATER ASSETS.

LEGEND

—	EX BDY
—	PROP BDY
— T —	EX TELECOM
— P —	EX POWER
— GAS —	EX GAS
—	PR TRENCH CROSSING
—	PR BERM TRENCH
— T —	PROP TELECOM
— V —	PROP POWER
— HV —	PROP POWER HV
— LV —	PROP POWER LV
— GAS —	PROP GAS
⦿	PROP STREET LIGHT
⊗	PROP PWR POLE
⊗	PROP PWR CHAMBER
⊗	PROP PWR PLINTH
⊗	PROP PWR RMU
⊗	PROP TRANSFORMER
⊗	PROP PWR PILAR
⊗	PROP TELECOM PLINTH
⊗	PROP TELECOM CHAMBER

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
		By	Date
Survey	MAVEN		05/2025
Design	JPK		06/2026
Drawn	JPK		06/2026
Checked	SM		09/2026

Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project


**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title

**PROPOSED
SERVICES
OVERVIEW PLAN**

Project no.	298002-IND SL1		
Scale	1:5000 @ A3		
Cad file	298002-I1-C700 SERV.DWG		
Drawing no.	I1-C700	Rev	A

RESOURCE CONSENT

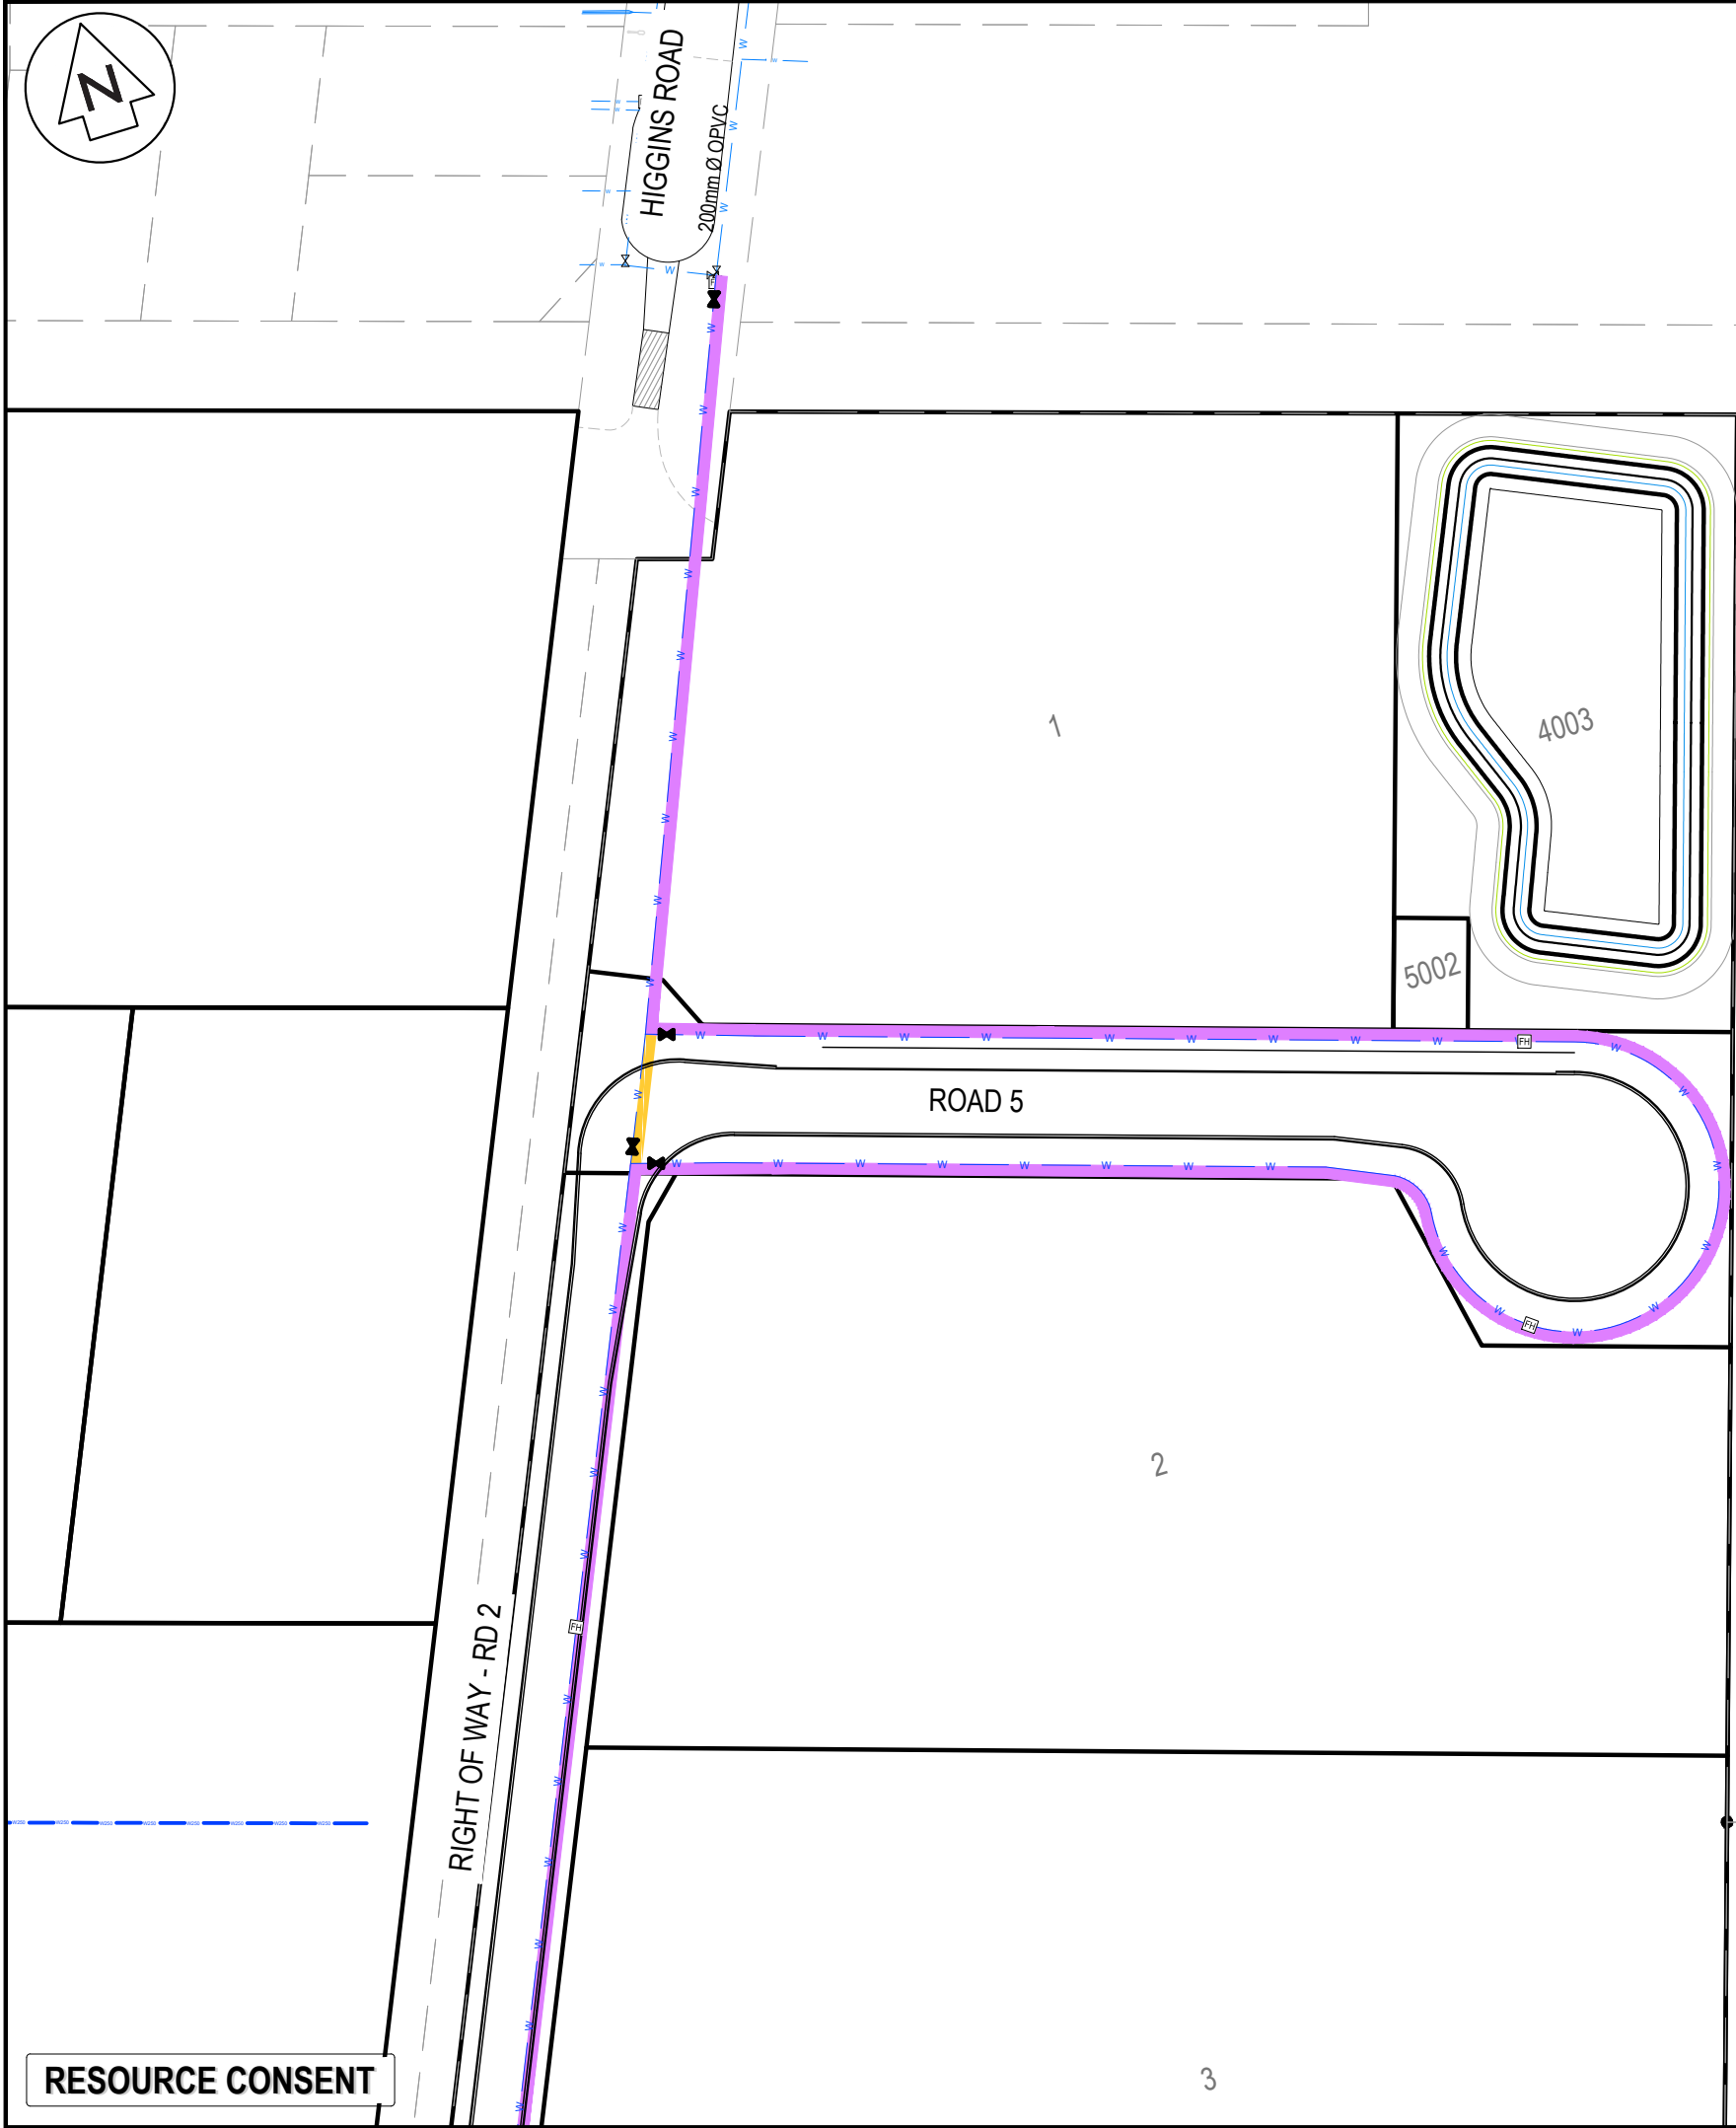

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000
 3. LEVELS IN TERMS OF THE NZ VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M. BOUNDARIES ARE SUBJECT TO FINAL SURVEY.
 4. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
 5. MINIMUM COVER SHALL BE:
ROADS, FOOTPATHS, CROSSINGS: 1000MM
BERMS: 600MM
 6. UTILITY SERVICES SHALL BE INSTALLED IN ACCORDANCE WITH PROVIDERS SPECIFICATION.
 7. SERVICE TRENCHES UNDER ROADS, ACCESSWAYS AND PATHS SHALL BE HARD FILLED BACK FILLED AND COMPACTED IN 200MM LAYERS.
 8. WORK AREAS SHALL BE REINSTATED TO AN EQUAL STANDARD BEFORE WORK STARTED.
 9. UTILITY SERVICES SHALL MAINTAIN MINIMUM CLEARANCES TO STORMWATER AND WASTEWATER ASSETS.

LEGEND		
	EX BDY	
	PROP BDY	
	EX TELECOM	
	EX POWER	
	EX GAS	
	PR TRENCH CROSSING	
	PR BERM TRENCH	
	PROP TELECOM	
	PROP POWER	
	PROP POWER HV	
	PROP POWER LV	
	PROP GAS	
	PROP STREET LIGHT	
	PROP PWR POLE	
	PROP PWR CHAMBER	
	PROP PWR PLINTH	
	PROP PWR RMU	
	PROP TRANSFORMER	
	PROP PWR PILAR	
	PROP TELECOM PLINTH	
	PROP TELECOM CHAMBER	

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	By	Date	
Survey	MAVEN	05/2025	
Design	JPK	06/2026	
Drawn	JPK	06/2026	
Checked	SM	09/2026	




Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project
**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title
**PROPOSED
SERVICES
PLAN**

Project no.	298002-IND SL1		
Scale	1:1000 @ A3		
Cad file	298002-11-C700 SERV.DWG		
Drawing no.	I1-C700-1	Rev	A

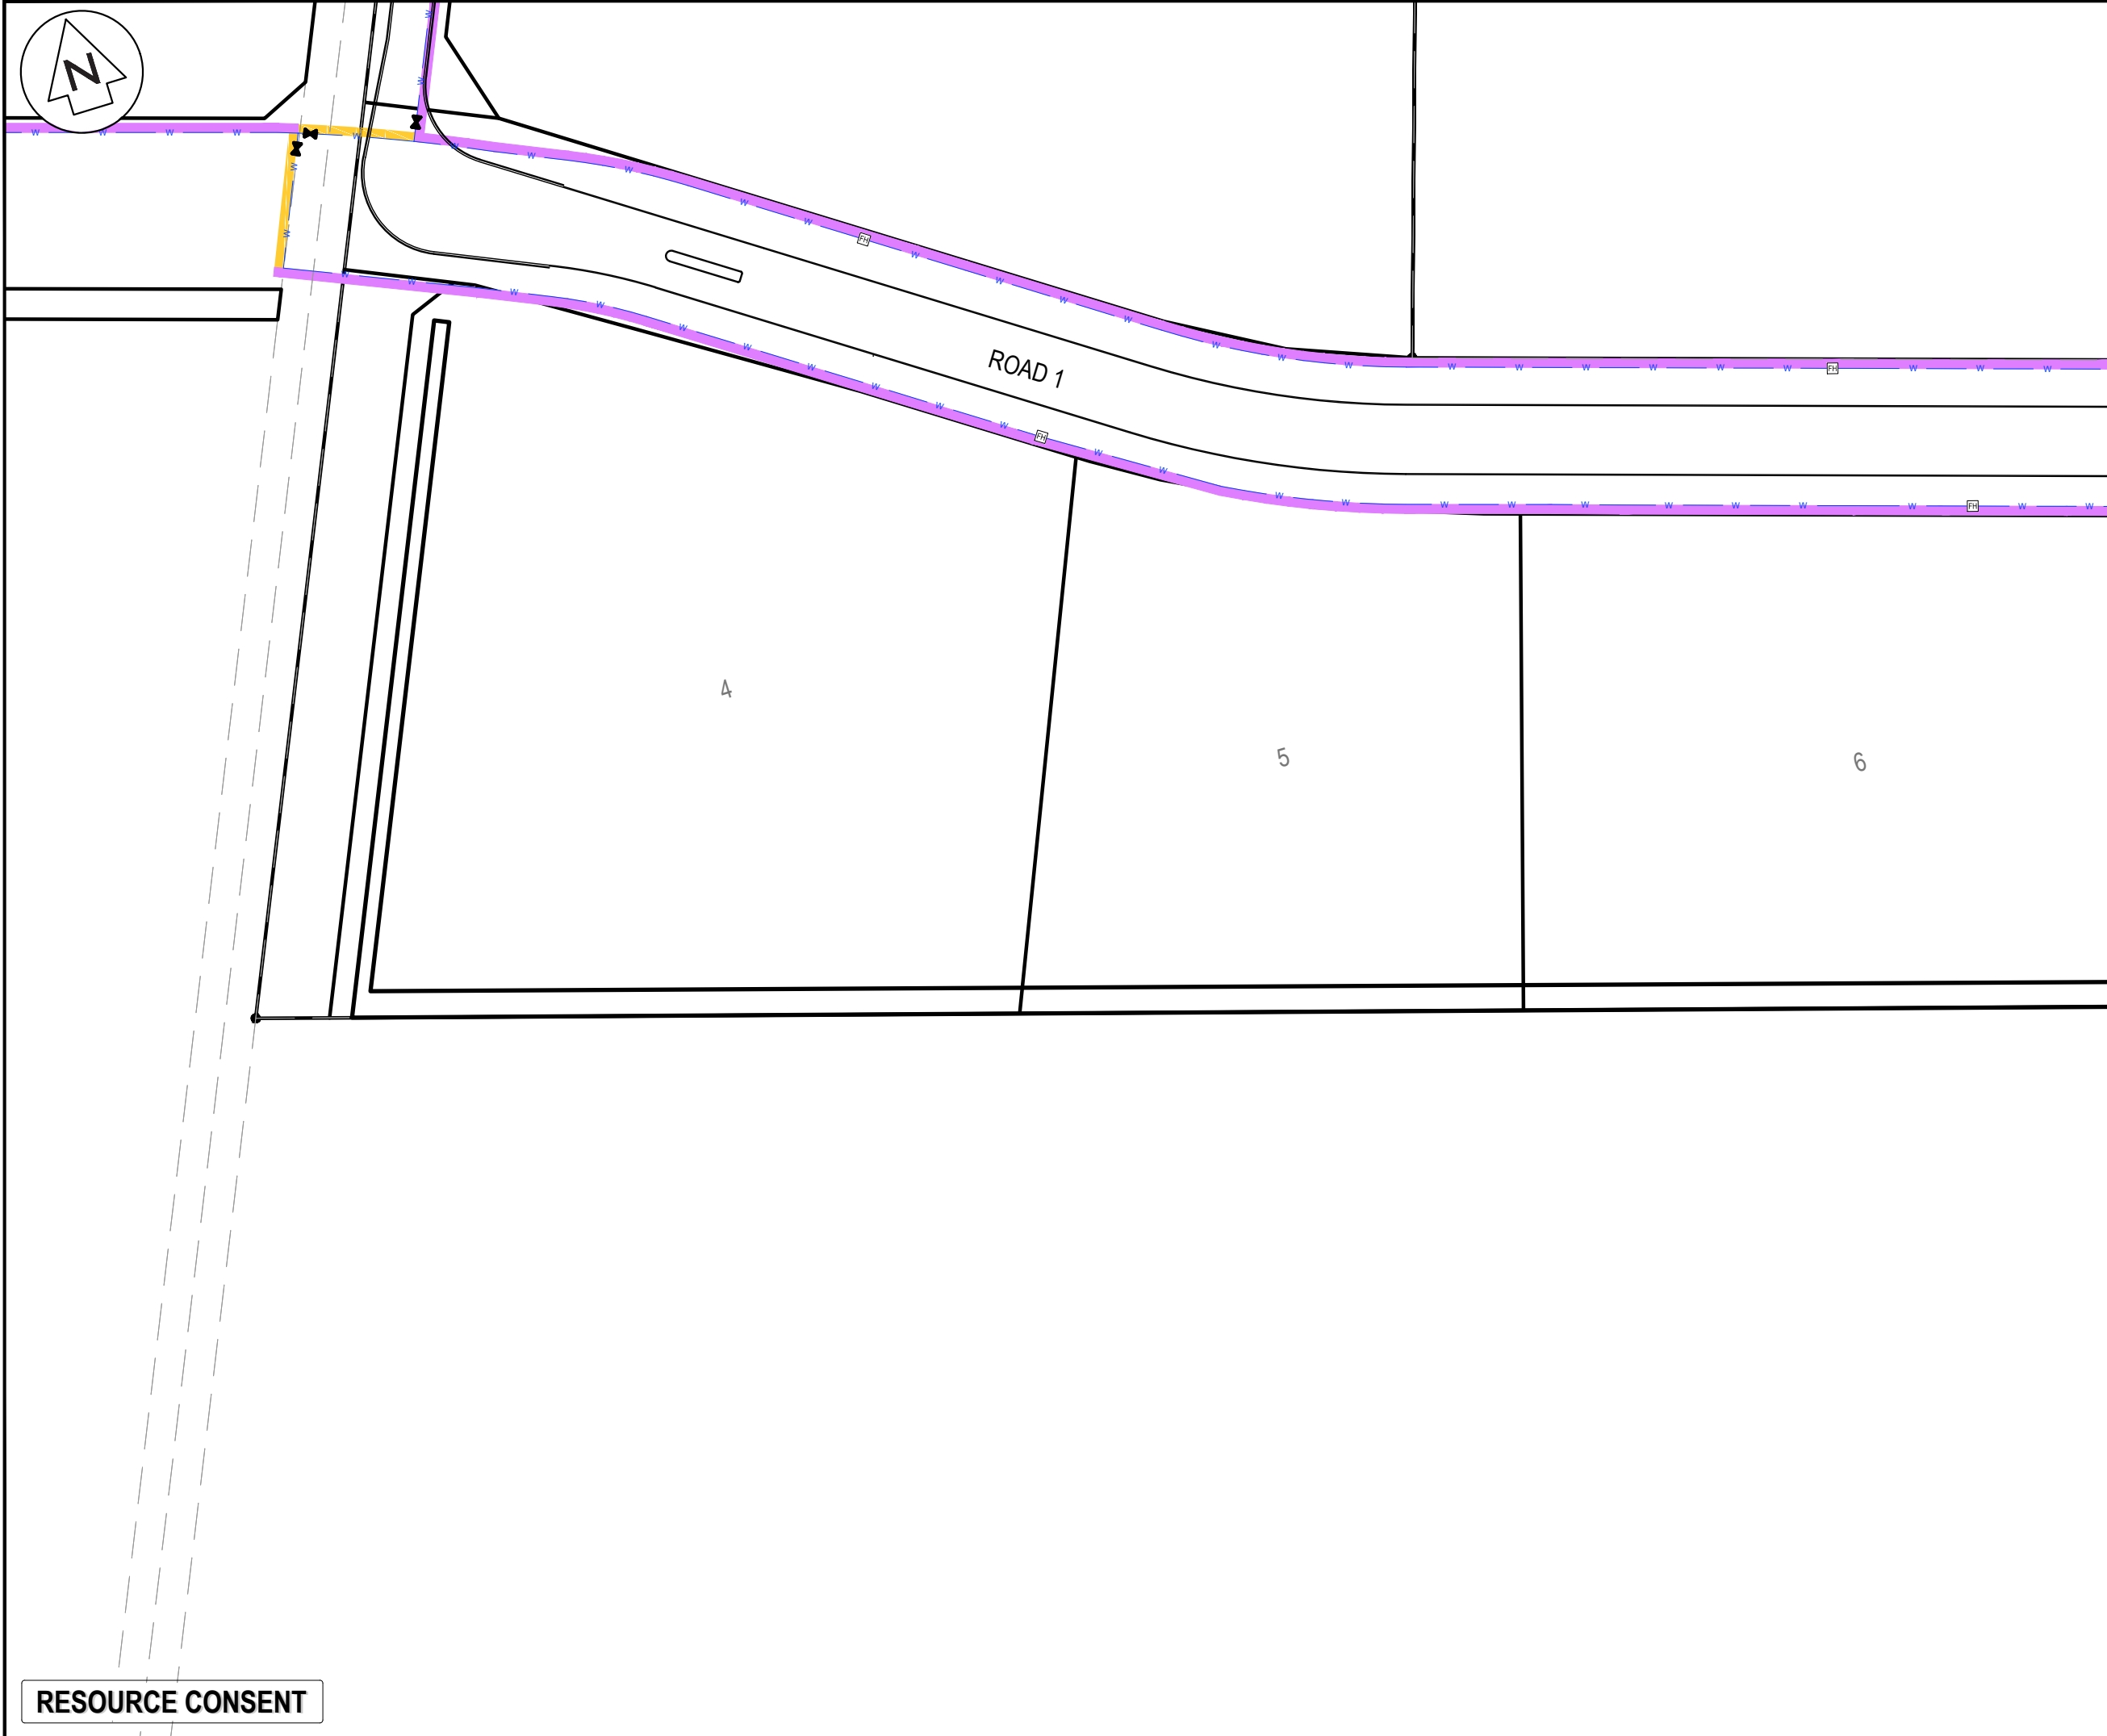

NOTES

1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000
3. LEVELS IN TERMS OF THE NZ VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M.BOUNDARIES ARE SUBJECT TO FINAL SURVEY.
4. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
5. MINIMUM COVER SHALL BE:
ROADS, FOOTPATHS,CROSSINGS: 1000MM
BERMS: 600MM
6. UTILITY SERVICES SHALL BE INSTALLED IN ACCORDANCE WITH PROVIDERS SPECIFICATION.
7. SERVICE TRENCHES UNDER ROADS, ACCESSWAYS AND PATHS SHALL BE HARDFILLED BACKFILLED AND COMPACTED IN 200MM LAYERS.
8. WORK AREAS SHALL BE REINSTATED TO AN EQUAL STANDARD BEFORE WORK STARTED.
9. UTILITY SERVICES SHALL MAINTAIN MINIMUM CLEARANCES TO STORMWATER AND WASTEWATER ASSETS.

LEGEND

—	EX BDY
- - -	PROP BDY
— T —	EX TELECOM
— P —	EX POWER
— GAS —	EX GAS
— T —	PROP TELECOM
— P —	PROP POWER
— HV —	PROP POWER HV
— LV —	PROP POWER LV
— GAS —	PROP GAS
⬮	PROP STREET LIGHT
⬮	PROP PWR POLE
⬮	PROP PWR CHAMBER
⬮	PROP PWR PLINTH
⬮	PROP PWR RMU
⬮	PROP TRANSFORMER
⬮	PROP PWR PILAR
⬮	PROP TELECOM PLINTH
⬮	PROP TELECOM CHAMBER

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	By	Date	
Survey	MAVEN	05/2025	
Design	JPK	06/2026	
Drawn	JPK	06/2026	
Checked	SM	09/2026	



Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand


Project

**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title

**PROPOSED
SERVICES
PLAN**

Project no.	298002-IND SL1		
Scale	1:1000 @ A3		
Cad file	298002-11-C700 SERV.DWG		
Drawing no.	11-C700-2	Rev	A

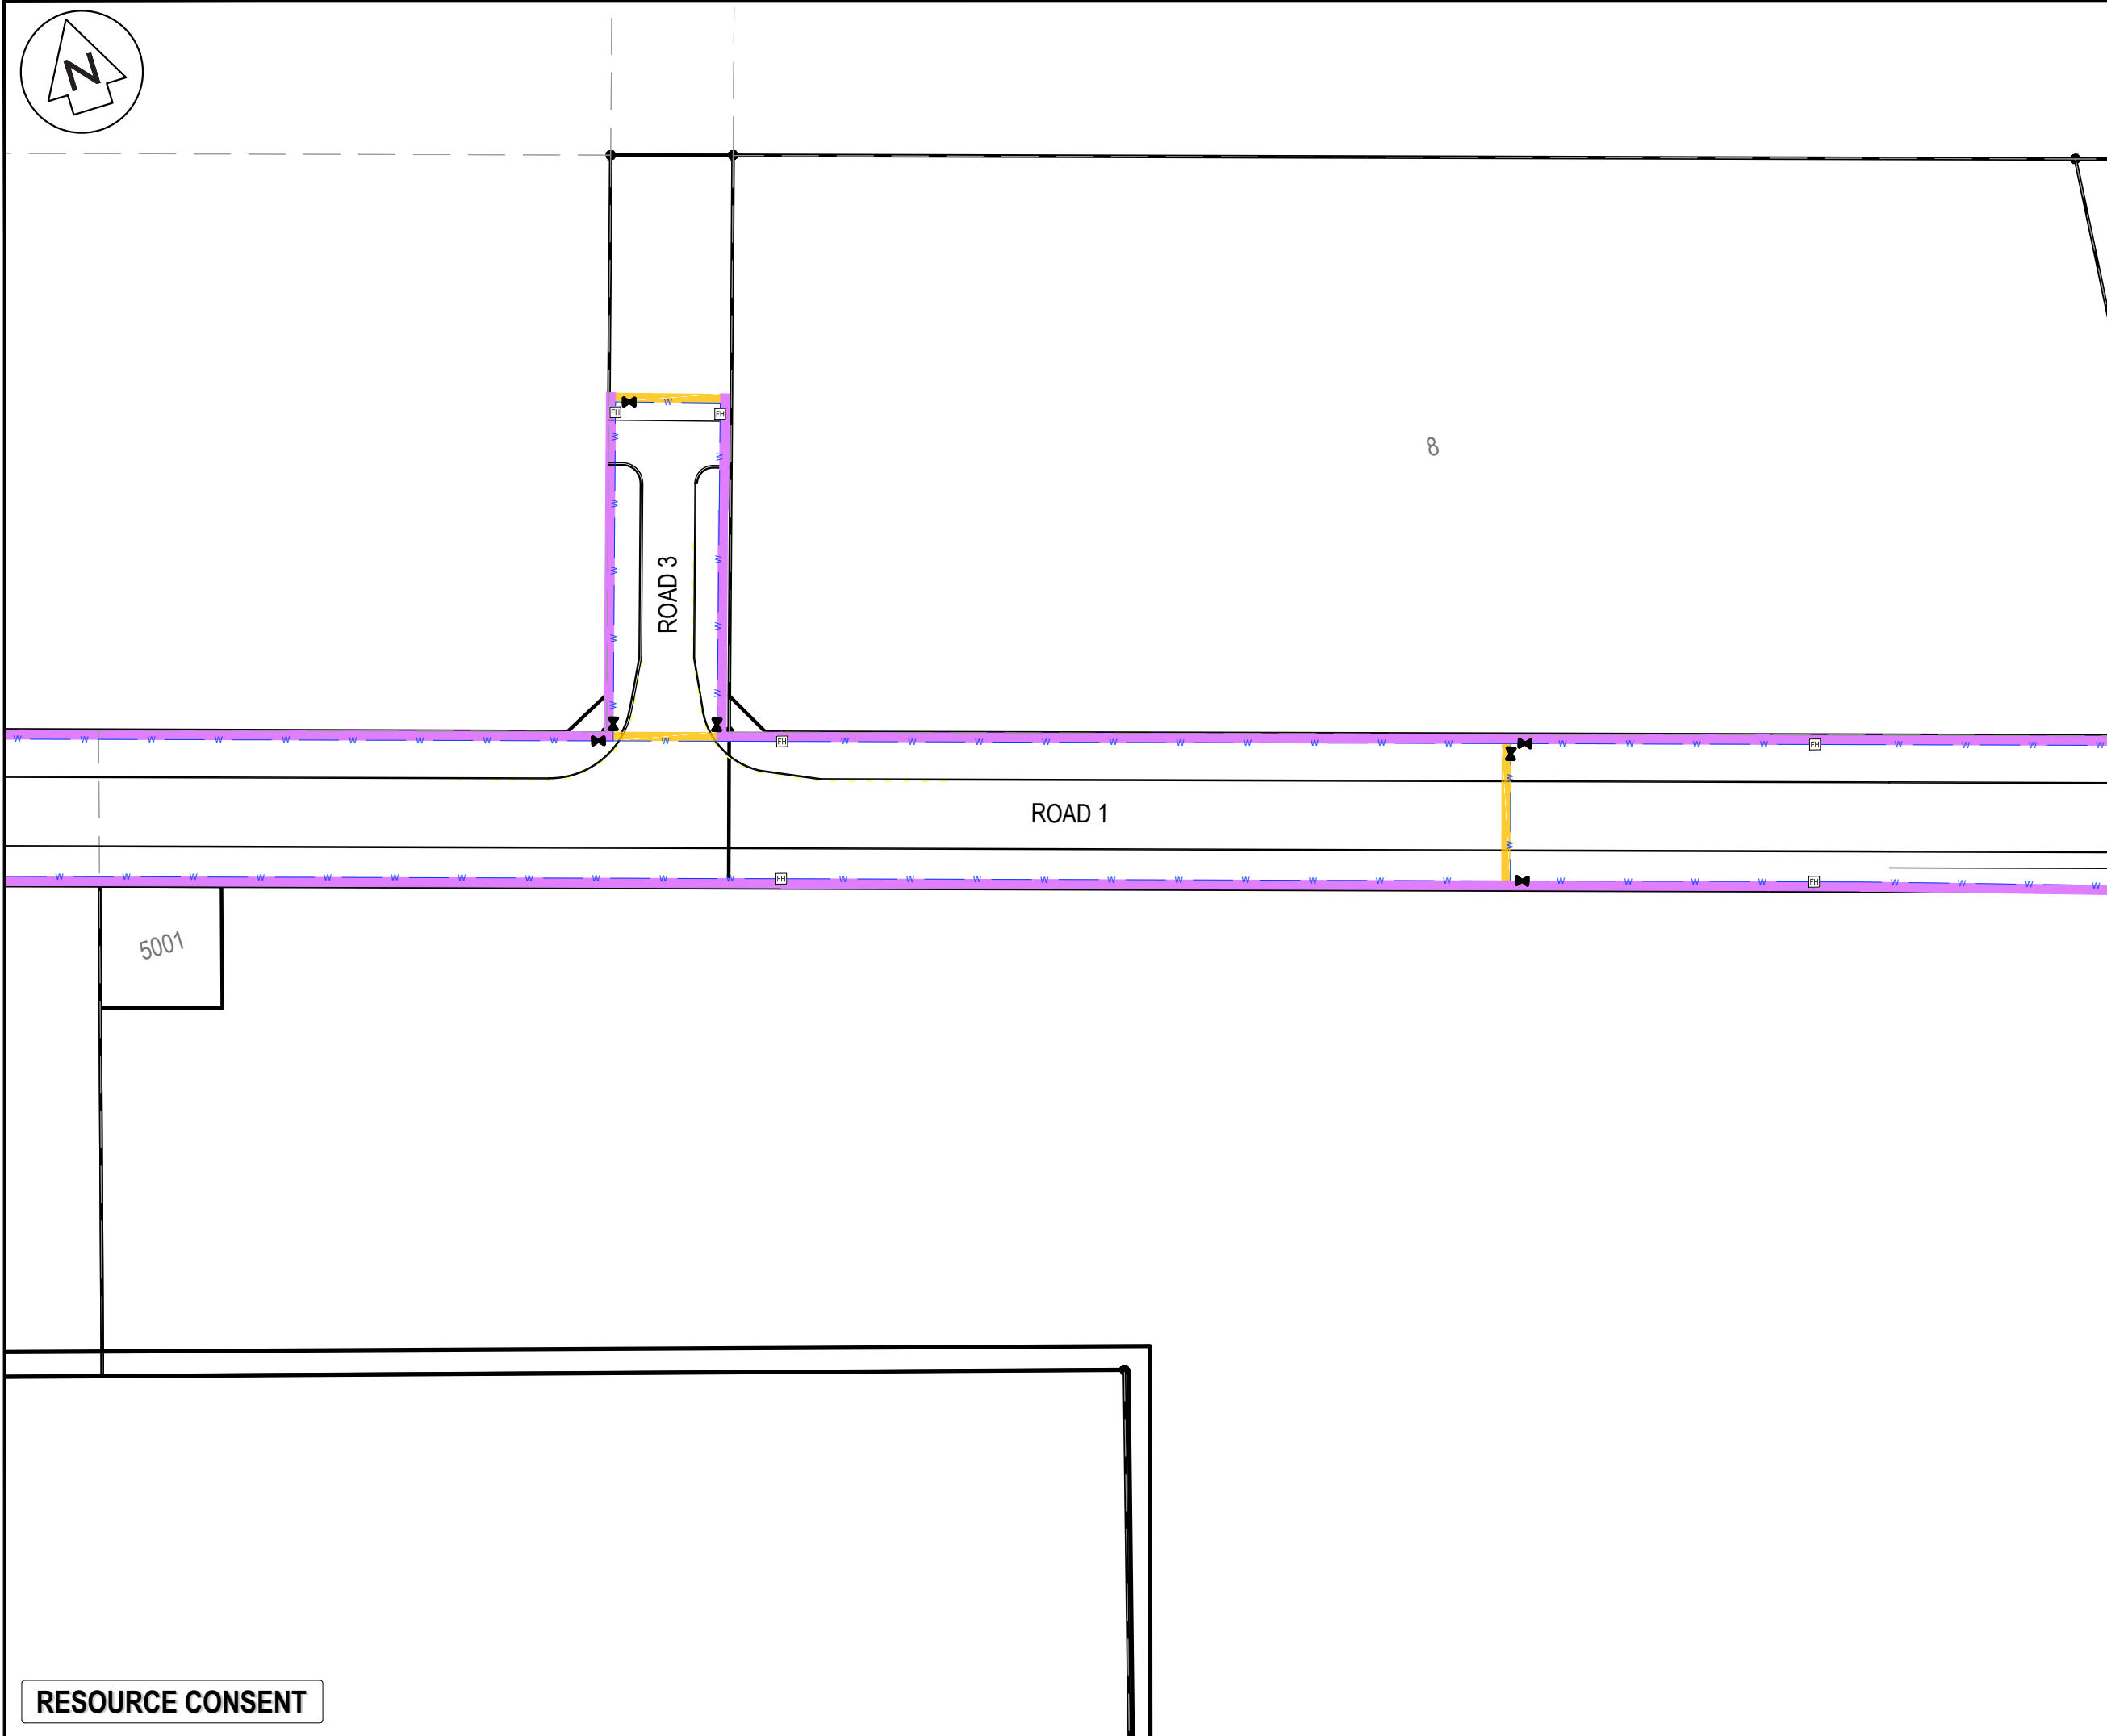

NOTES

1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000
3. LEVELS IN TERMS OF THE NZ VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M.BOUNDARIES ARE SUBJECT TO FINAL SURVEY.
4. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
5. MINIMUM COVER SHALL BE:
ROADS, FOOTPATHS,CROSSINGS: 1000MM
BERMS: 600MM
6. UTILITY SERVICES SHALL BE INSTALLED IN ACCORDANCE WITH PROVIDERS SPECIFICATION.
7. SERVICE TRENCHES UNDER ROADS, ACCESSWAYS AND PATHS SHALL BE HARDFILLED BACKFILLED AND COMPACTED IN 200MM LAYERS.
8. WORK AREAS SHALL BE REINSTATED TO AN EQUAL STANDARD BEFORE WORK STARTED.
9. UTILITY SERVICES SHALL MAINTAIN MINIMUM CLEARANCES TO STORMWATER AND WASTEWATER ASSETS.

LEGEND

—	EX BDY
—	PROP BDY
— T —	EX TELECOM
— P —	EX POWER
— GAS —	EX GAS
— T —	PROP TELECOM
— P —	PROP POWER
— HV —	PROP POWER HV
— LV —	PROP POWER LV
— GAS —	PROP GAS
—	PROP TRENCH CROSSING
—	PR BERM TRENCH
—	PROP STREET LIGHT
—	PROP PWR POLE
—	PROP PWR CHAMBER
—	PROP PWR PLINTH
—	PROP PWR RMU
—	PROP TRANSFORMER
—	PROP PWR PILAR
—	PROP TELECOM PLINTH
—	PROP TELECOM CHAMBER

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	By	Date	
Survey	MAVEN	05/2025	
Design	JPK	06/2026	
Drawn	JPK	06/2026	
Checked	SM	09/2026	

Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project



**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title

**PROPOSED
SERVICES
PLAN**

Project no.	298002-IND SL1		
Scale	1:1000 @ A3		
Cad file	298002-11-C700 SERV.DWG		
Drawing no.	I1-C700-3	Rev	A

RESOURCE CONSENT

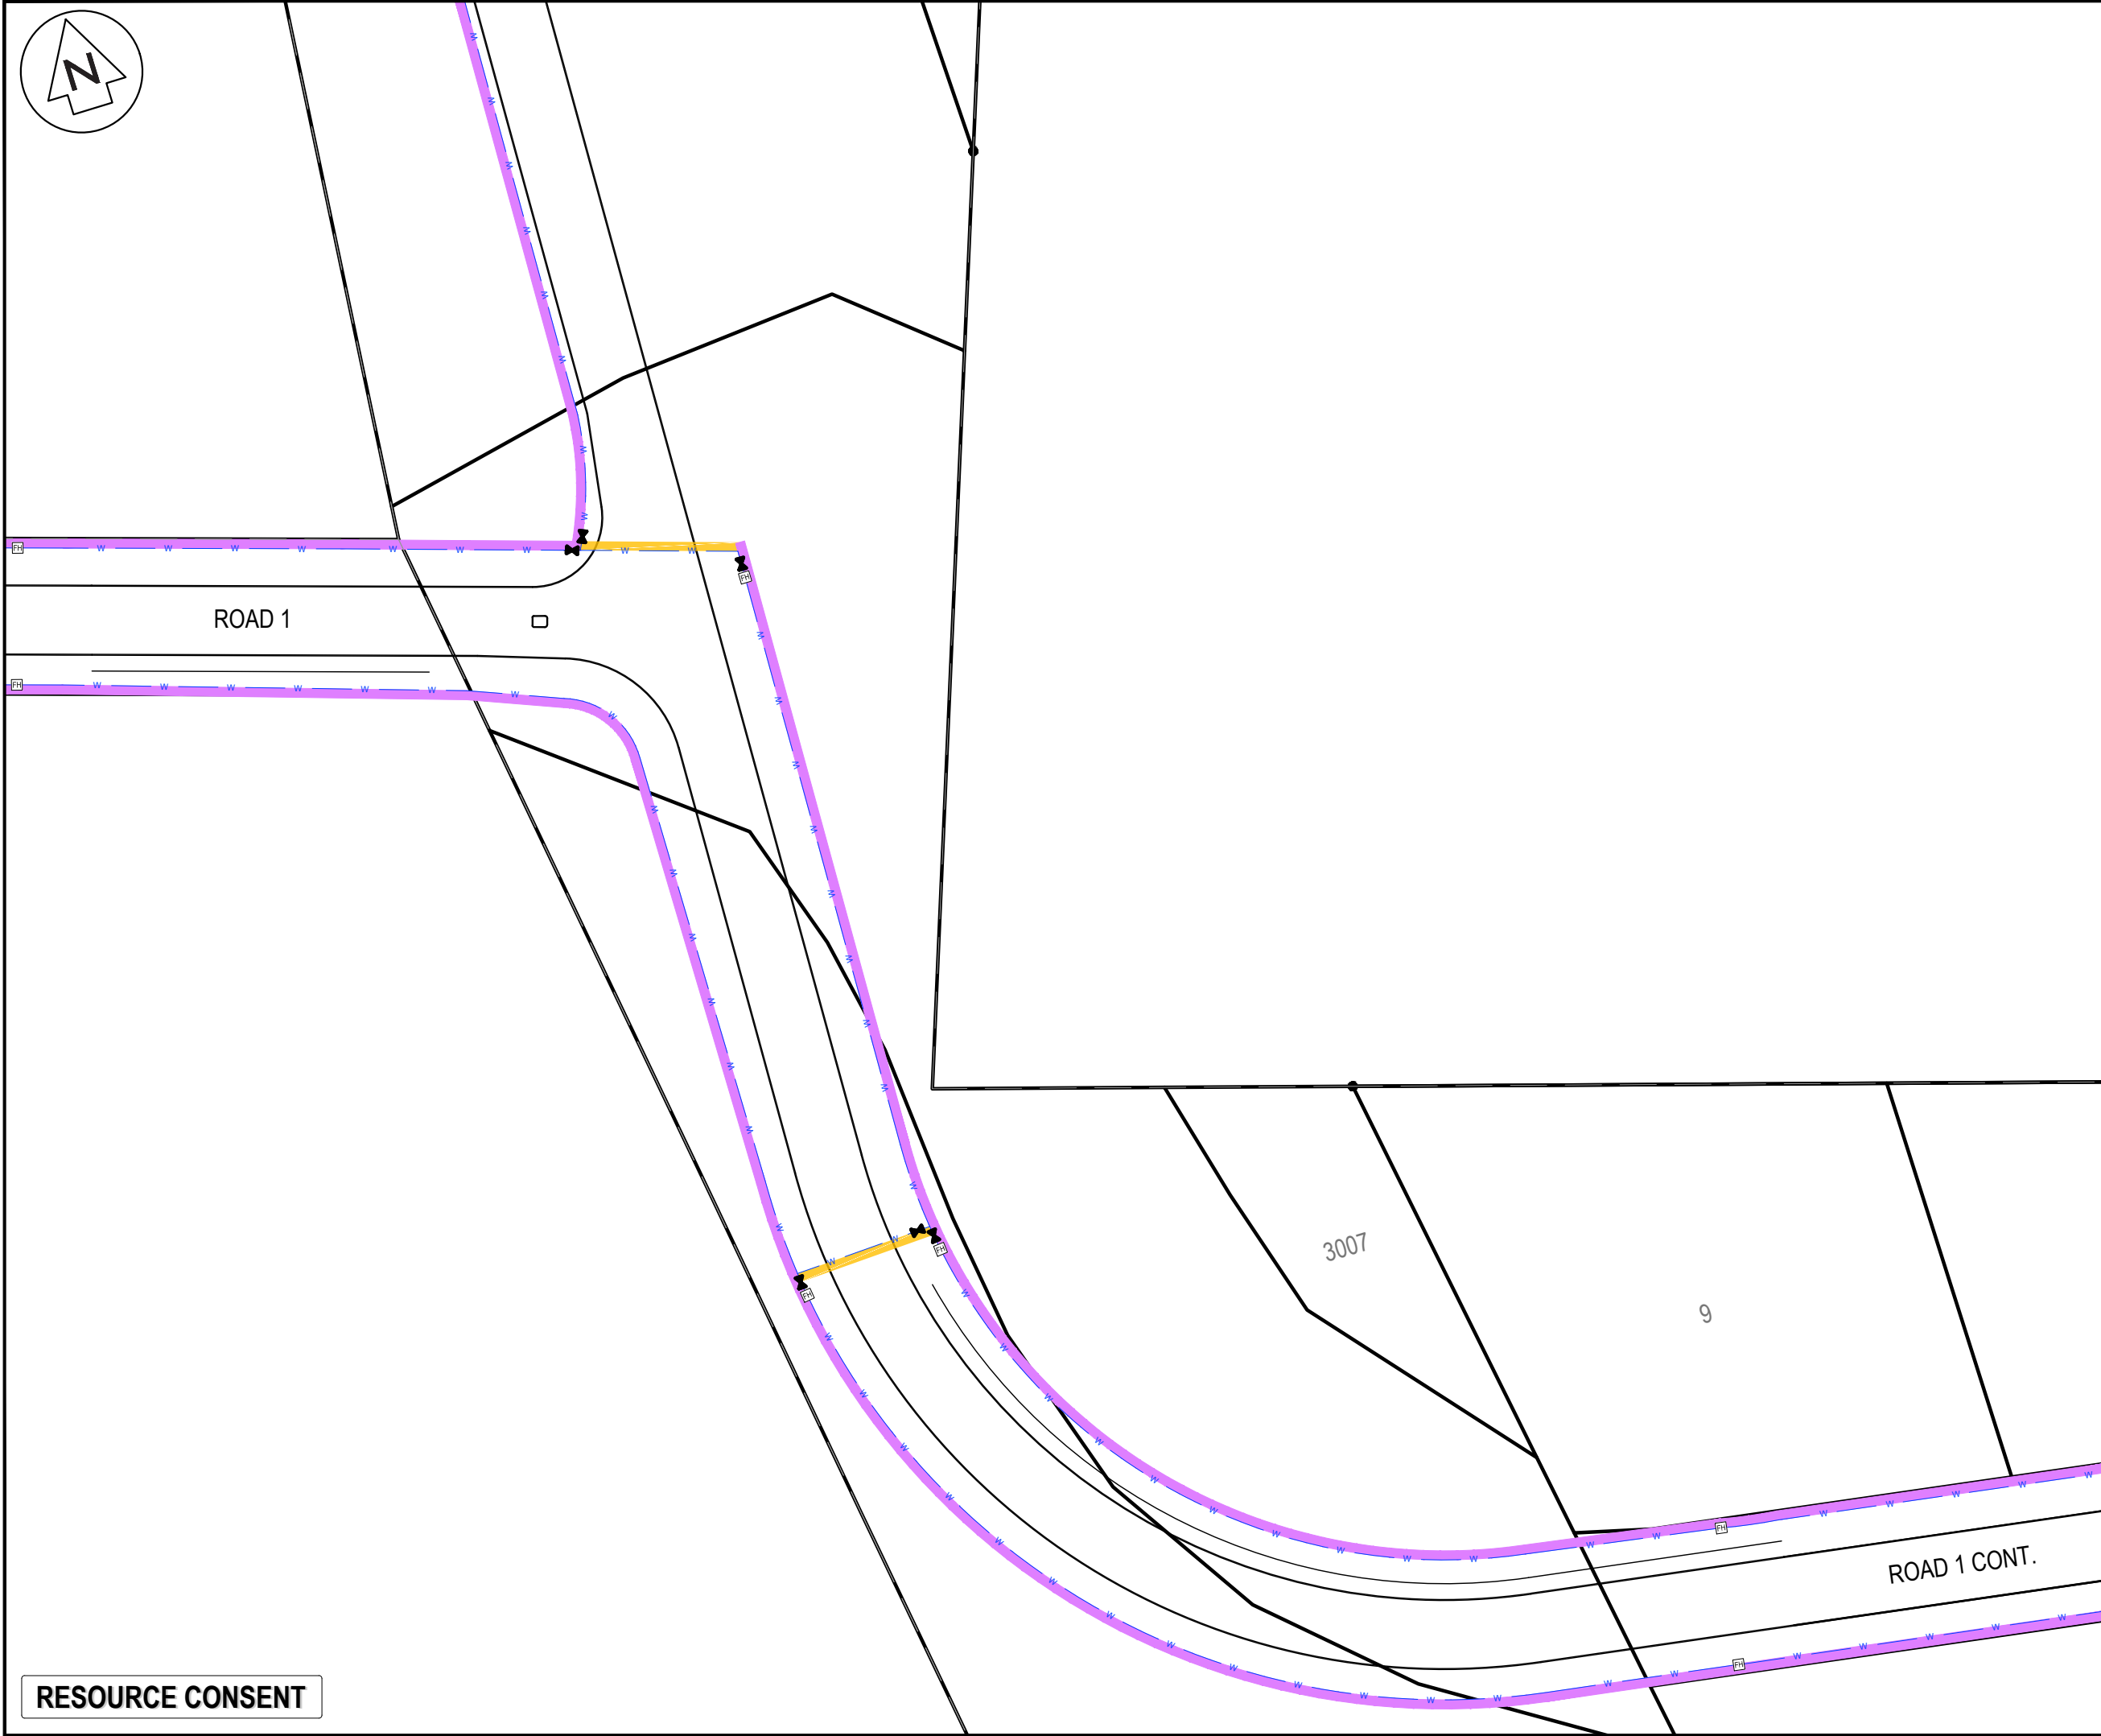

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000
 3. LEVELS IN TERMS OF THE NZ VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M.BOUNDARIES ARE SUBJECT TO FINAL SURVEY.
 4. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
 5. MINIMUM COVER SHALL BE:
ROADS, FOOTPATHS,CROSSINGS: 1000MM
BERMS: 600MM
 6. UTILITY SERVICES SHALL BE INSTALLED IN ACCORDANCE WITH PROVIDERS SPECIFICATION.
 7. SERVICE TRENCHES UNDER ROADS, ACCESSWAYS AND PATHS SHALL BE HARDILLED BACKFILLED AND COMPACTED IN 200MM LAYERS.
 8. WORK AREAS SHALL BE REINSTATED TO AN EQUAL STANDARD BEFORE WORK STARTED.
 9. UTILITY SERVICES SHALL MAINTAIN MINIMUM CLEARANCES TO STORMWATER AND WASTEWATER ASSETS.

LEGEND

	EX BDY
	PROP BDY
	EX TELECOM
	EX POWER
	EX GAS
	PR TRENCH CROSSING
	PR BERM TRENCH
	PROP TELECOM
	PROP POWER
	PROP POWER HV
	PROP POWER LV
	PROP GAS
	PROP STREET LIGHT
	PROP PWR POLE
	PROP PWR CHAMBER
	PROP PWR PLINTH
	PROP PWR RMU
	PROP TRANSFORMER
	PROP PWR PILAR
	PROP TELECOM PLINTH
	PROP TELECOM CHAMBER

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	By	Date	
Survey	MAVEN	05/2025	
Design	JPK	06/2026	
Drawn	JPK	06/2026	
Checked	SM	09/2026	


Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project
**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title
**PROPOSED
SERVICES
PLAN**

Project no.	298002-IND SL1		
Scale	1:1000 @ A3		
Cad file	298002-11-C700 SERV.DWG		
Drawing no.	11-C700-4	Rev	A

RESOURCE CONSENT



KAHIKATEA DRIVE EXTENSION

KAHIKATEA DRIVE

LATHAM COURT

SL1 - ENABLING WORKS

WICKHAM STREET

100mm Ø AC

100mm Ø AC
150mm Ø AC

RESOURCE CONSENT

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000
 3. LEVELS IN TERMS OF THE NZ VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M. BOUNDARIES ARE SUBJECT TO FINAL SURVEY.
 4. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
 5. MINIMUM COVER SHALL BE:
ROADS, FOOTPATHS, CROSSINGS: 1000MM
BERMS: 600MM
 6. UTILITY SERVICES SHALL BE INSTALLED IN ACCORDANCE WITH PROVIDERS SPECIFICATION.
 7. SERVICE TRENCHES UNDER ROADS, ACCESSWAYS AND PATHS SHALL BE HARDFILLED BACKFILLED AND COMPACTED IN 200MM LAYERS.
 8. WORK AREAS SHALL BE REINSTATED TO AN EQUAL STANDARD BEFORE WORK STARTED.
 9. UTILITY SERVICES SHALL MAINTAIN MINIMUM CLEARANCES TO STORMWATER AND WASTEWATER ASSETS.

LEGEND

	EX BDY
	PROP BDY
	EX TELECOM
	EX POWER
	EX GAS
	PR TRENCH CROSSING
	PR BERM TRENCH
	PROP TELECOM
	PROP POWER
	PROP POWER HV
	PROP POWER LV
	PROP GAS
	PROP STREET LIGHT
	PROP PWR POLE
	PROP PWR CHAMBER
	PROP PWR PLINTH
	PROP PWR RMU
	PROP TRANSFORMER
	PROP PWR PILAR
	PROP TELECOM PLINTH
	PROP TELECOM CHAMBER

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	Survey	MAVEN	05/2025
	Design	JPK	06/2026
	Drawn	JPK	06/2026
	Checked	SM	09/2026





Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project
**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title
**PROPOSED
SERVICES
PLAN**

Project no.	298002-IND SL1		
Scale	1:1000 @ A3		
Cad file	298002-11-C700 SERV.DWG		
Drawing no.	I1-C700-5	Rev	A

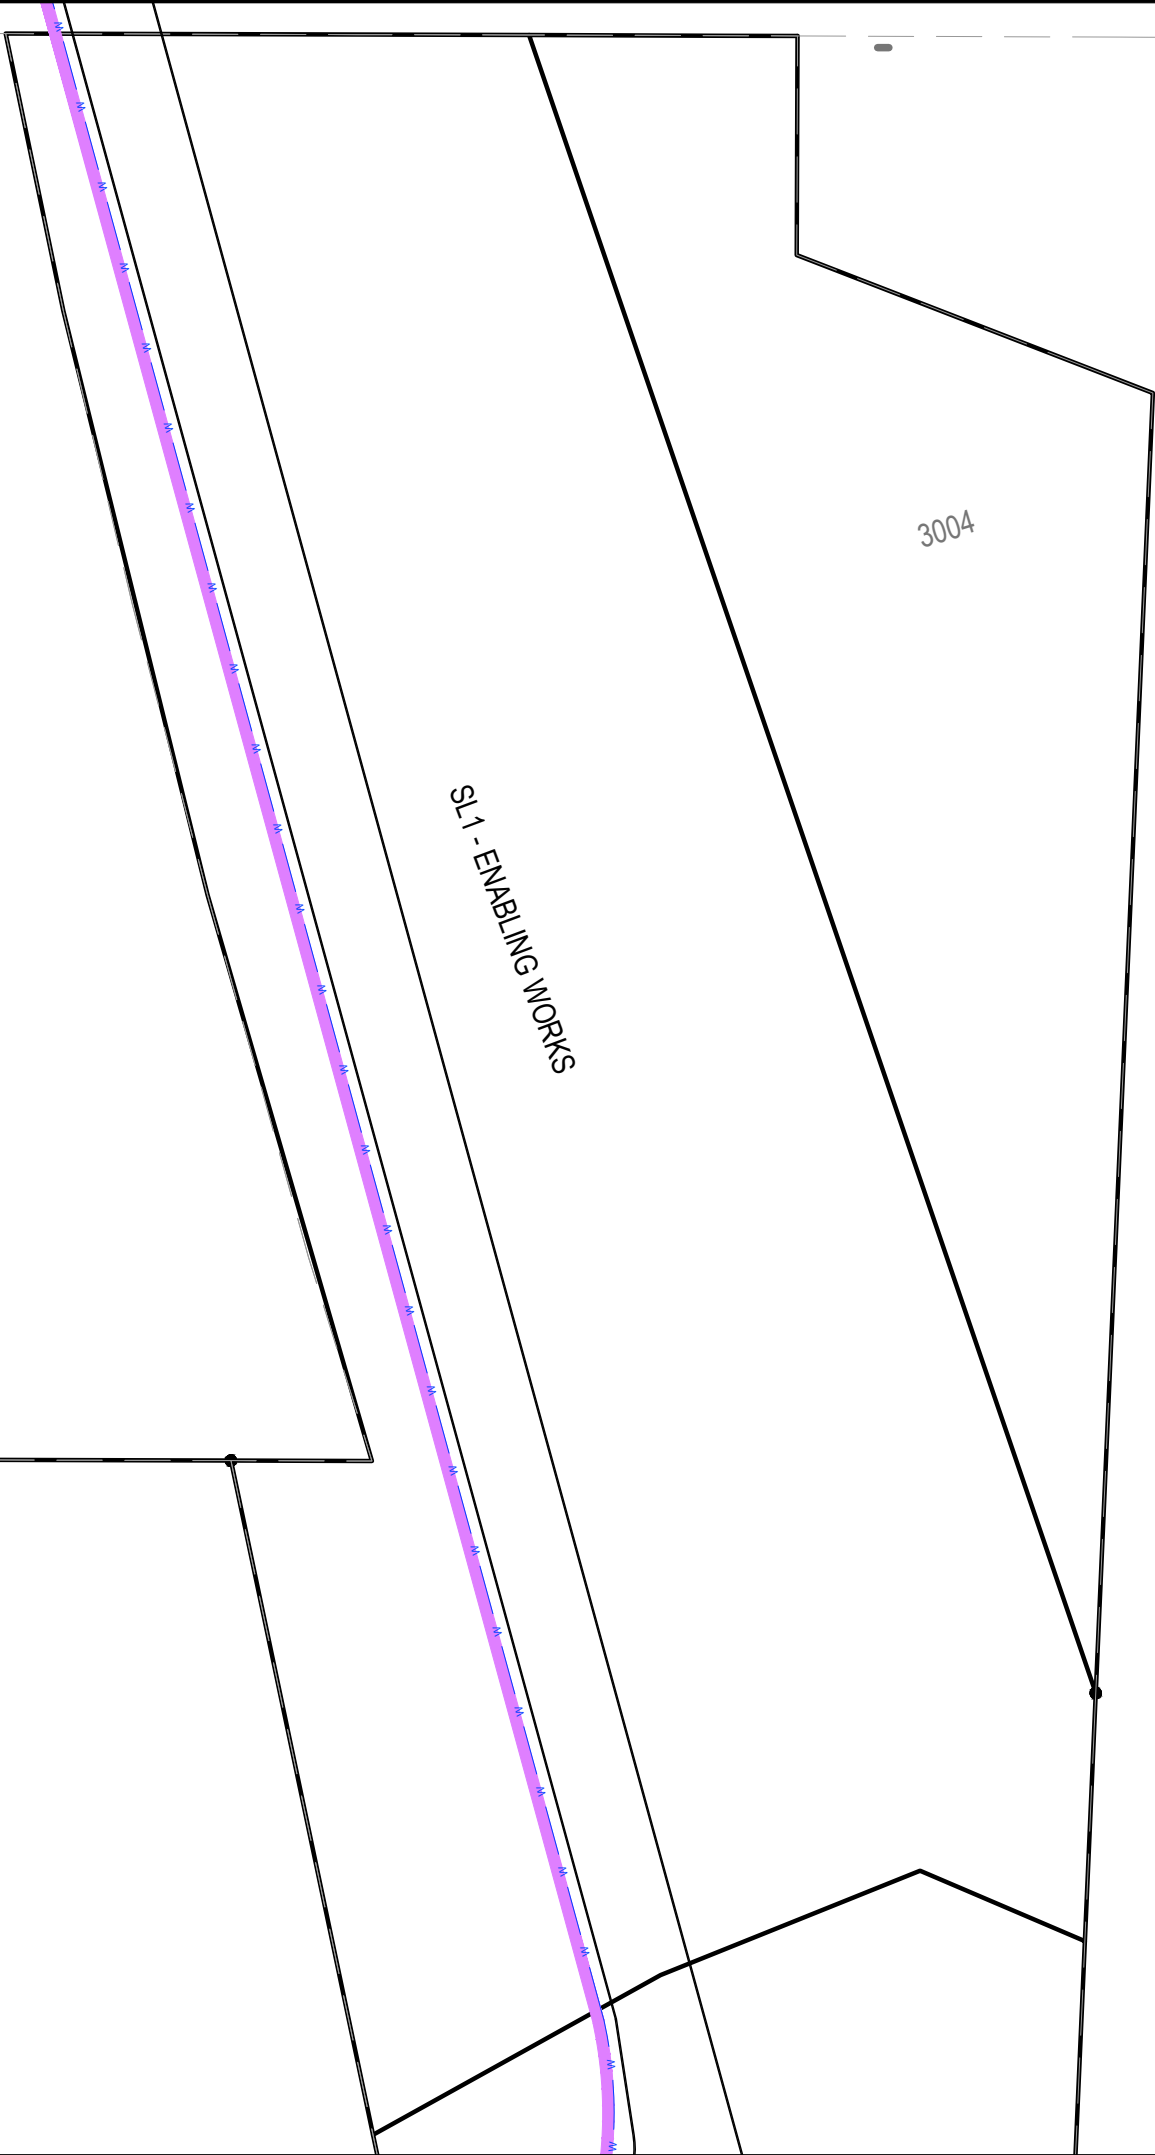

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000
 3. LEVELS IN TERMS OF THE NZ VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M.BOUNDARIES ARE SUBJECT TO FINAL SURVEY.
 4. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
 5. MINIMUM COVER SHALL BE:
ROADS, FOOTPATHS,CROSSINGS: 1000MM
BERMS: 600MM
 6. UTILITY SERVICES SHALL BE INSTALLED IN ACCORDANCE WITH PROVIDERS SPECIFICATION.
 7. SERVICE TRENCHES UNDER ROADS, ACCESSWAYS AND PATHS SHALL BE HARDILLED BACKFILLED AND COMPACTED IN 200MM LAYERS.
 8. WORK AREAS SHALL BE REINSTATED TO AN EQUAL STANDARD BEFORE WORK STARTED.
 9. UTILITY SERVICES SHALL MAINTAIN MINIMUM CLEARANCES TO STORMWATER AND WASTEWATER ASSETS.

LEGEND		
	EX BDY	
	PROP BDY	
	EX TELECOM	
	EX POWER	
	EX GAS	
	PR TRENCH CROSSING	
	PR BERM TRENCH	
	PROP TELECOM	
	PROP POWER	
	PROP POWER HV	
	PROP POWER LV	
	PROP GAS	
	PROP STREET LIGHT	
	PROP PWR POLE	
	PROP PWR CHAMBER	
	PROP PWR PLINTH	
	PROP PWR RMU	
	PROP TRANSFORMER	
	PROP PWR PILAR	
	PROP TELECOM PLINTH	
	PROP TELECOM CHAMBER	

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
		By	Date
Survey	MAVEN		05/2025
Design	JPK		06/2026
Drawn	JPK		06/2026
Checked	SM		09/2026



Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project

SOUTHERN LINKS 1

INDUSTRIAL STAGE 1

HAMILTON, WAIKATO

FOR SL1

NORTHERN CONSORTIUM

Title


PROPOSED

SERVICES

PLAN

Project no.	298002-IND SL1		
Scale	1:1000 @ A3		
Cad file	298002-11-C700 SERV.DWG		
Drawing no.	I1-C700-6	Rev	A

RESOURCE CONSENT

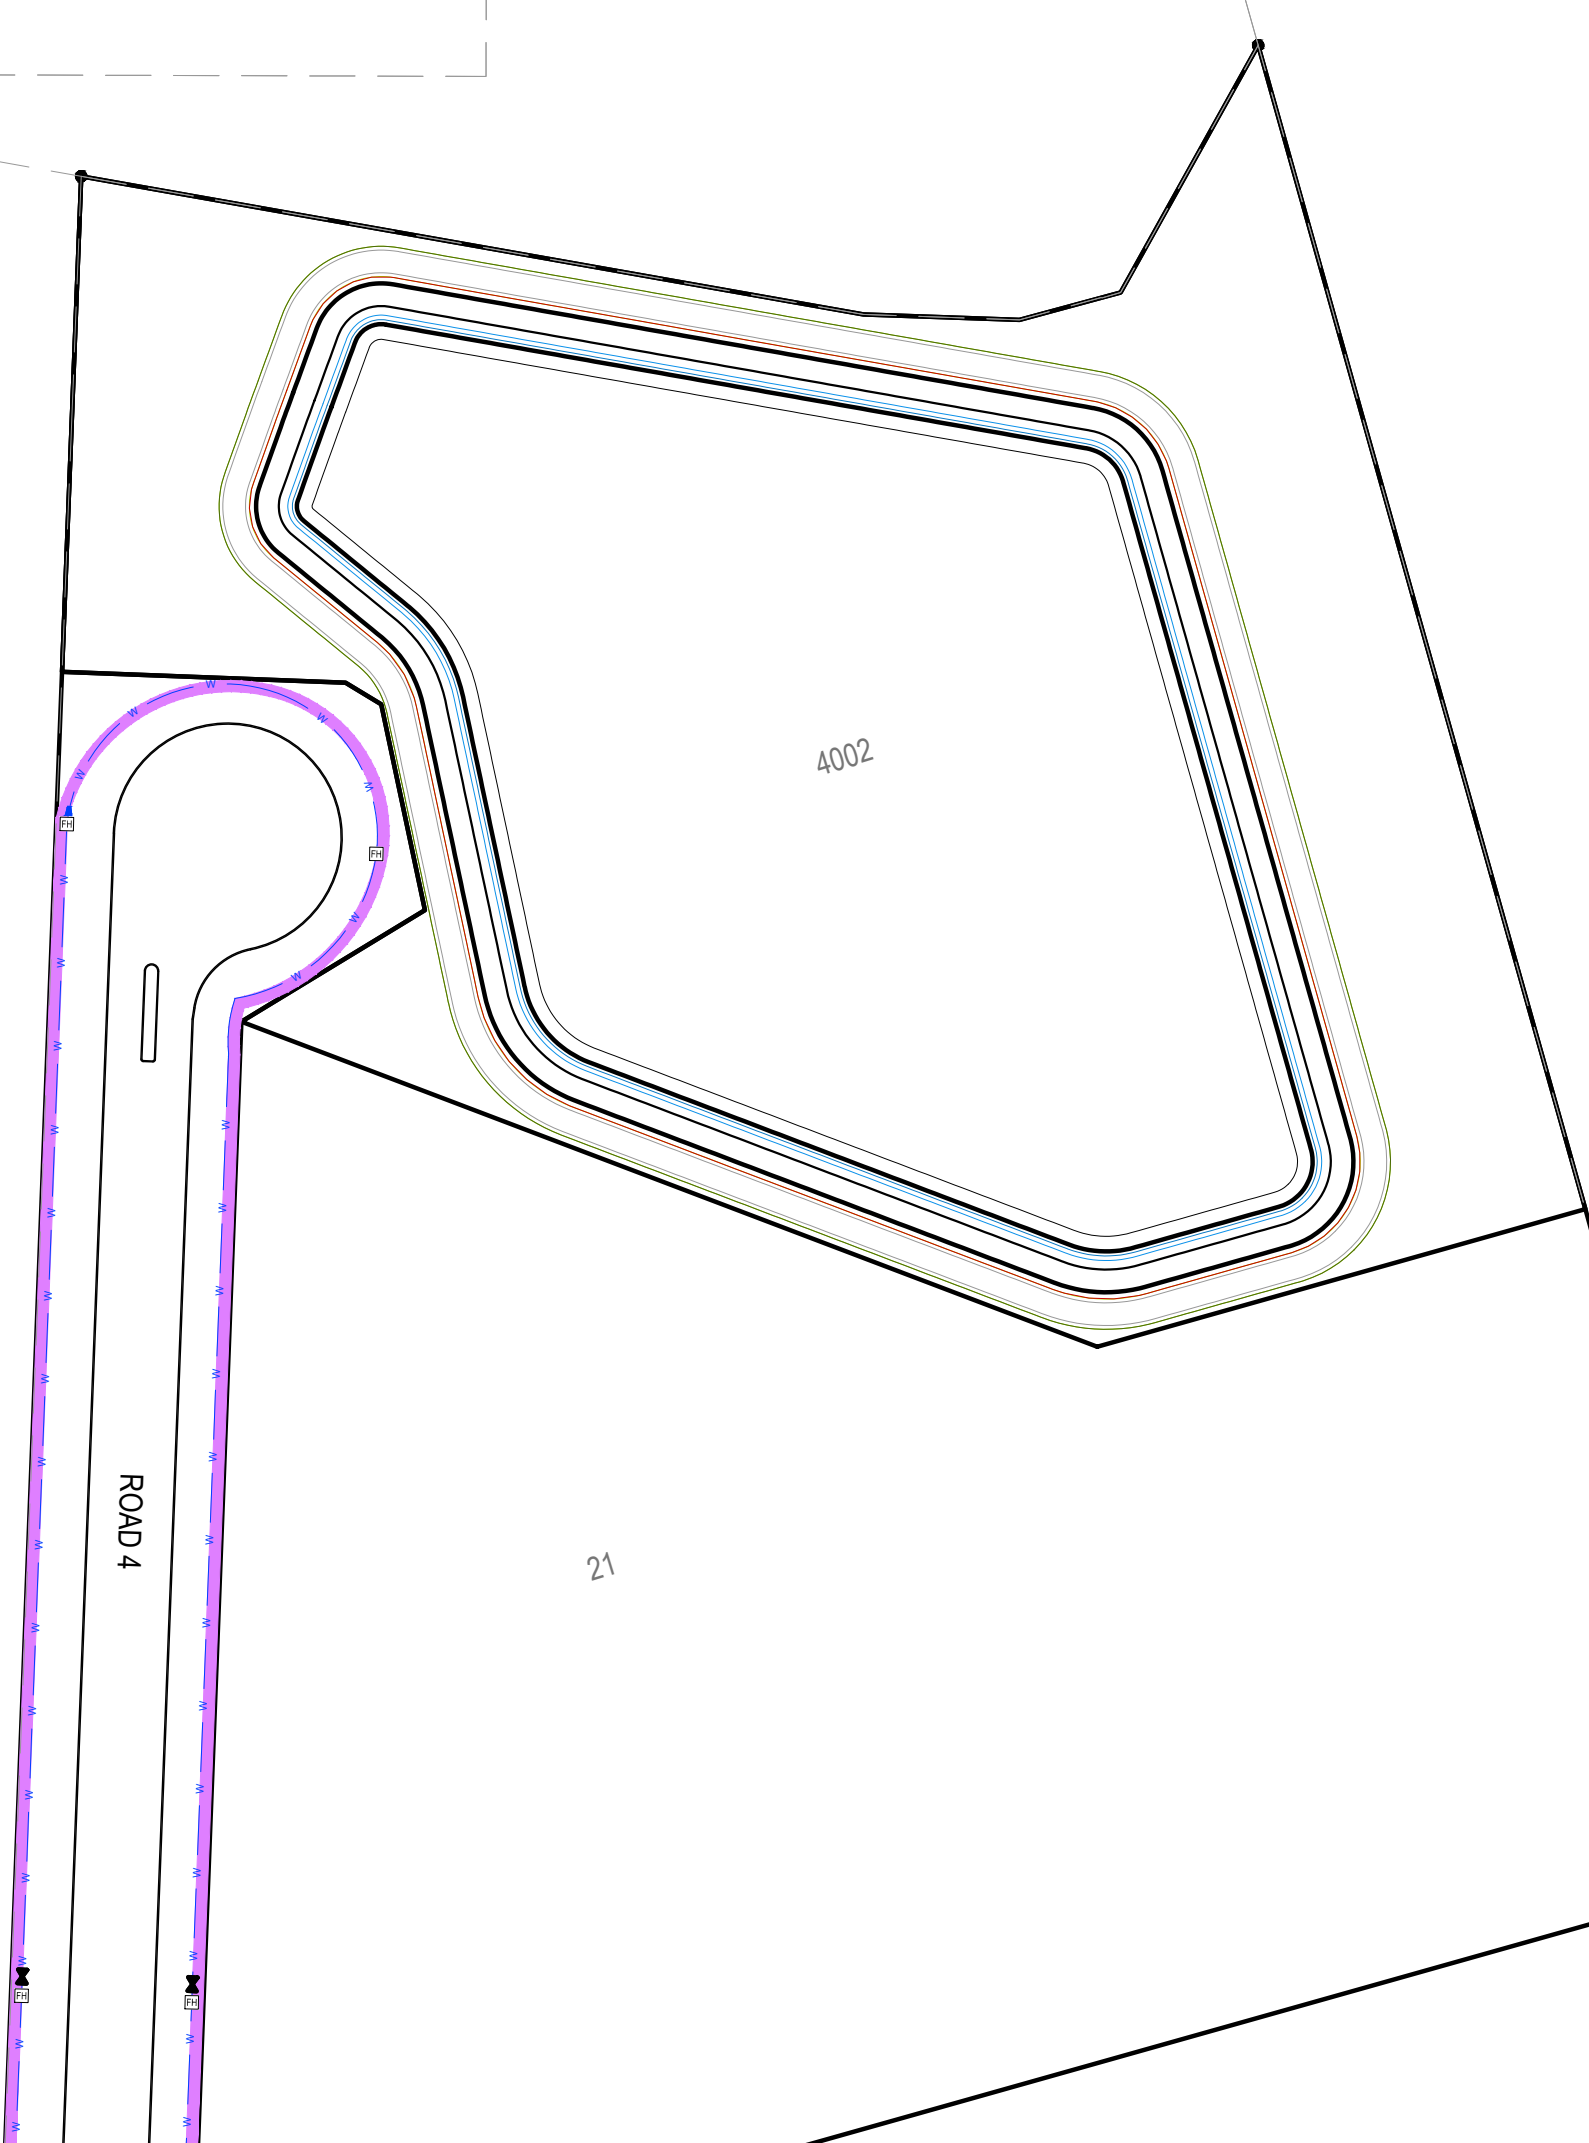

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000
 3. LEVELS IN TERMS OF THE NZ VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M. BOUNDARIES ARE SUBJECT TO FINAL SURVEY.
 4. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
 5. MINIMUM COVER SHALL BE:
ROADS, FOOTPATHS, CROSSINGS: 1000MM
BERMS: 600MM
 6. UTILITY SERVICES SHALL BE INSTALLED IN ACCORDANCE WITH PROVIDERS SPECIFICATION.
 7. SERVICE TRENCHES UNDER ROADS, ACCESSWAYS AND PATHS SHALL BE HARD FILLED BACK FILLED AND COMPACTED IN 200MM LAYERS.
 8. WORK AREAS SHALL BE REINSTATED TO AN EQUAL STANDARD BEFORE WORK STARTED.
 9. UTILITY SERVICES SHALL MAINTAIN MINIMUM CLEARANCES TO STORMWATER AND WASTEWATER ASSETS.

LEGEND		
	EX BDY	
	PROP BDY	
	EX TELECOM	
	EX POWER	
	EX GAS	
	PR TRENCH CROSSING	
	PR BERM TRENCH	
	PROP TELECOM	
	PROP POWER	
	PROP POWER HV	
	PROP POWER LV	
	PROP GAS	
	PROP STREET LIGHT	
	PROP PWR POLE	
	PROP PWR CHAMBER	
	PROP PWR PLINTH	
	PROP PWR RMU	
	PROP TRANSFORMER	
	PROP PWR PILAR	
	PROP TELECOM PLINTH	
	PROP TELECOM CHAMBER	

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	Survey	MAVEN	05/2025
	Design	JPK	06/2026
	Drawn	JPK	06/2026
	Checked	SM	09/2026

Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project

SOUTHERN LINKS 1

INDUSTRIAL STAGE 1

HAMILTON, WAIKATO

FOR SL1

NORTHERN CONSORTIUM

Title


PROPOSED

SERVICES

PLAN

Project no.	298002-IND SL1		
Scale	1:1000 @ A3		
Cad file	298002-11-C700 SERV.DWG		
Drawing no.	I1-C700-7	Rev	A

RESOURCE CONSENT

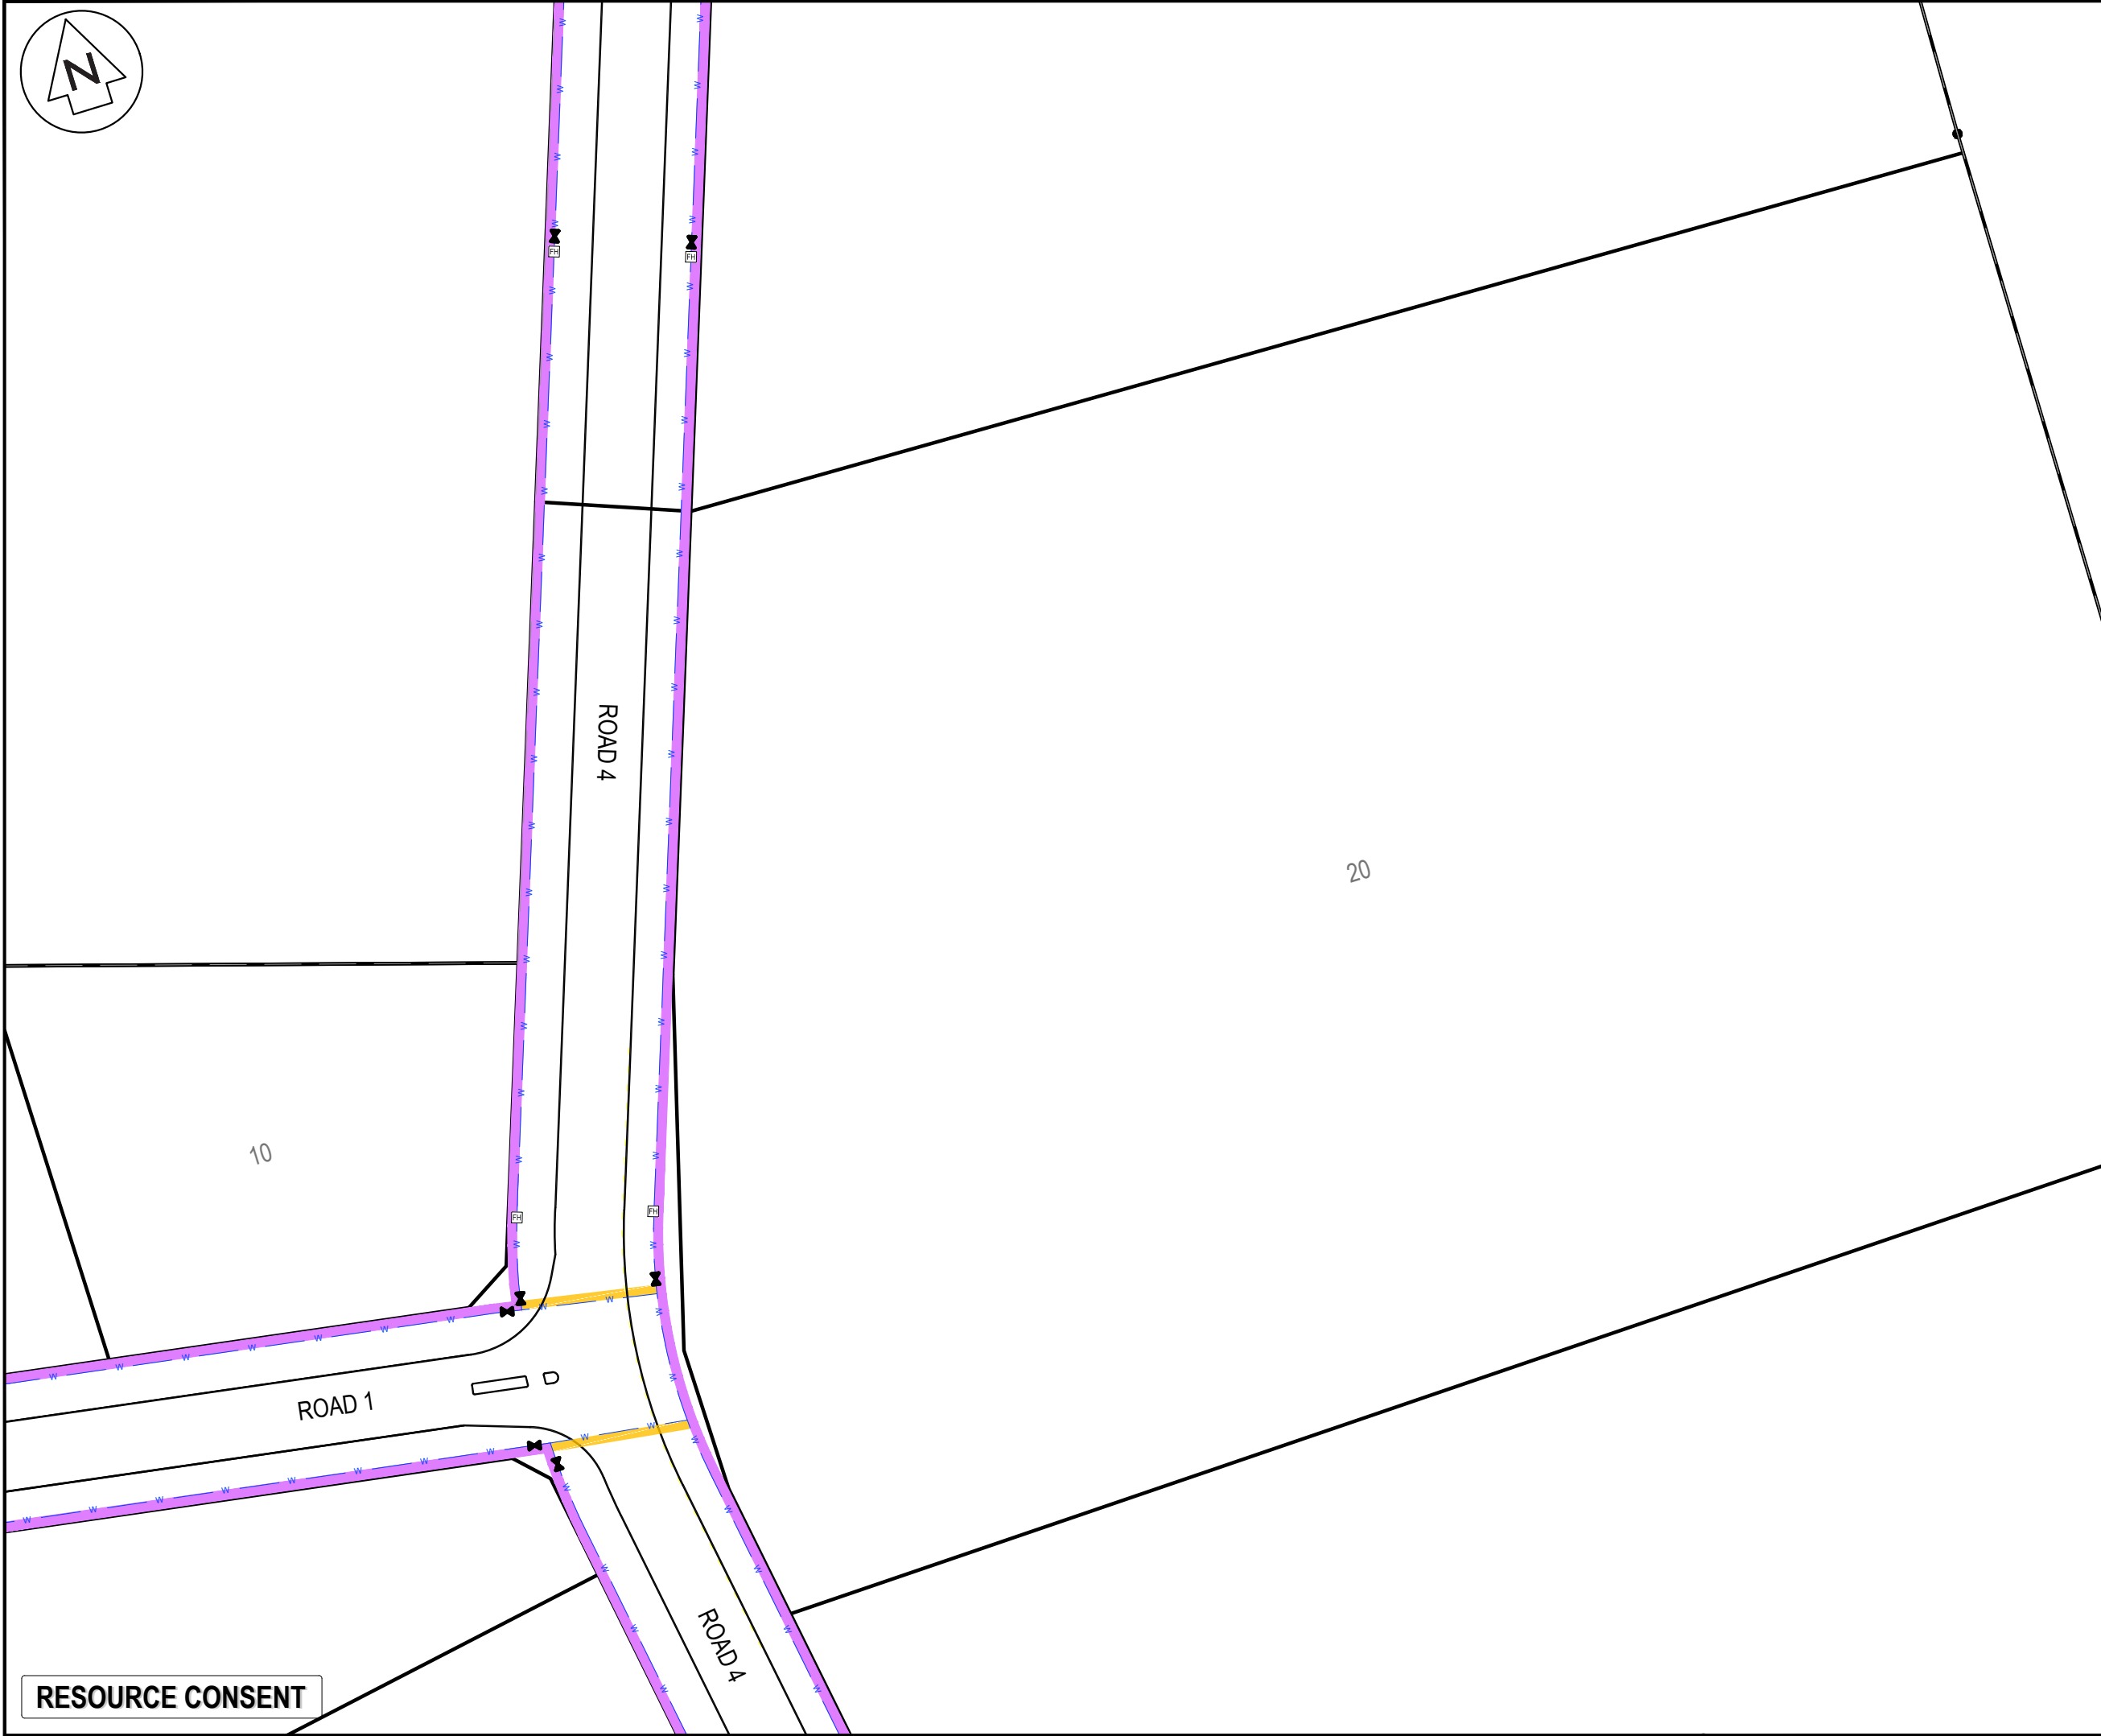

NOTES

- ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
- CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000
- LEVELS IN TERMS OF THE NZ VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M. BOUNDARIES ARE SUBJECT TO FINAL SURVEY.
- IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
- MINIMUM COVER SHALL BE:
ROADS, FOOTPATHS, CROSSINGS: 1000MM
BERMS: 600MM
- UTILITY SERVICES SHALL BE INSTALLED IN ACCORDANCE WITH PROVIDERS SPECIFICATION.
- SERVICE TRENCHES UNDER ROADS, ACCESSWAYS AND PATHS SHALL BE HARD FILLED BACK FILLED AND COMPACTED IN 200MM LAYERS.
- WORK AREAS SHALL BE REINSTATED TO AN EQUAL STANDARD BEFORE WORK STARTED.
- UTILITY SERVICES SHALL MAINTAIN MINIMUM CLEARANCES TO STORMWATER AND WASTEWATER ASSETS.

LEGEND

—	EX BDY
—	PROP BDY
— T —	EX TELECOM
— P —	EX POWER
— GAS —	EX GAS
— T —	PR TRENCH CROSSING
— T —	PR BERM TRENCH
— T —	PROP TELECOM
— V —	PROP POWER
— HV —	PROP POWER HV
— LV —	PROP POWER LV
— GAS —	PROP GAS
—	PROP STREET LIGHT
—	PROP PWR POLE
—	PROP PWR CHAMBER
—	PROP PWR PLINTH
—	PROP PWR RMU
—	PROP TRANSFORMER
—	PROP PWR PILAR
—	PROP TELECOM PLINTH
—	PROP TELECOM CHAMBER

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	By	Date	
Survey	MAVEN	05/2025	
Design	JKP	06/2026	
Drawn	JKP	06/2026	
Checked	SM	09/2026	

Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand


Project

**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title

**PROPOSED
SERVICES
PLAN**

Project no.	298002-IND SL1		
Scale	1:1000 @ A3		
Cad file	298002-11-C700 SERV.DWG		
Drawing no.	11-C700-8	Rev	A



12

13

14

15

16

17

19

ROAD 4

18

- NOTES
1. ALL WORKS TO BE IN ACCORDANCE WITH WAIKATO REGIONAL INFRASTRUCTURE TECHNICAL SPECIFICATIONS.
 2. CO-ORDINATES IN TERMS OF NZ GEODETIC DATUM MT EDEN 2000
 3. LEVELS IN TERMS OF THE NZ VERTICAL DATUM 2016. CONVERSION TO MOTURIKI 1953 CAN BE ACHIEVED BY ADDING 0.2594M.BOUNDARIES ARE SUBJECT TO FINAL SURVEY.
 4. IT IS THE CONTRACTORS RESPONSIBILITY TO LOCATE ANY UNDERGROUND SERVICES PRIOR TO THE COMMENCEMENT OF WORKS.
 5. MINIMUM COVER SHALL BE:
ROADS, FOOTPATHS,CROSSINGS: 1000MM
BERMS: 600MM
 6. UTILITY SERVICES SHALL BE INSTALLED IN ACCORDANCE WITH PROVIDERS SPECIFICATION.
 7. SERVICE TRENCHES UNDER ROADS, ACCESSWAYS AND PATHS SHALL BE HARDILLED BACKFILLED AND COMPACTED IN 200MM LAYERS.
 8. WORK AREAS SHALL BE REINSTATED TO AN EQUAL STANDARD BEFORE WORK STARTED.
 9. UTILITY SERVICES SHALL MAINTAIN MINIMUM CLEARANCES TO STORMWATER AND WASTEWATER ASSETS.

LEGEND

	EX BDY
	PROP BDY
	EX TELECOM
	EX POWER
	EX GAS
	PR TRENCH CROSSING
	PR BERM TRENCH
	PROP TELECOM
	PROP POWER
	PROP POWER HV
	PROP POWER LV
	PROP GAS
	PROP STREET LIGHT
	PROP PWR POLE
	PROP PWR CHAMBER
	PROP PWR PLINTH
	PROP PWR RMU
	PROP TRANSFORMER
	PROP PWR PILAR
	PROP TELECOM PLINTH
	PROP TELECOM CHAMBER

A	FAST TRACK APP	SM	09/2026
Rev	Description	By	Date
	Survey	MAVEN	05/2025
	Design	JPK	06/2026
	Drawn	JPK	06/2026
	Checked	SM	09/2026



Maven Waikato
07 242 0601
info@maven.co.nz
www.maven.co.nz
Level 1 286 Victoria Street, Hamilton
New Zealand

Project

**SOUTHERN LINKS 1
INDUSTRIAL STAGE 1
HAMILTON, WAIKATO
FOR SL1
NORTHERN CONSORTIUM**

Title

**PROPOSED
SERVICES
PLAN**

Project no.	298002-IND SL1		
Scale	1:1000 @ A3		
Cad file	298002-11-C700 SERV.DWG		
Drawing no.	I1-C700-9	Rev	A

RESOURCE CONSENT