


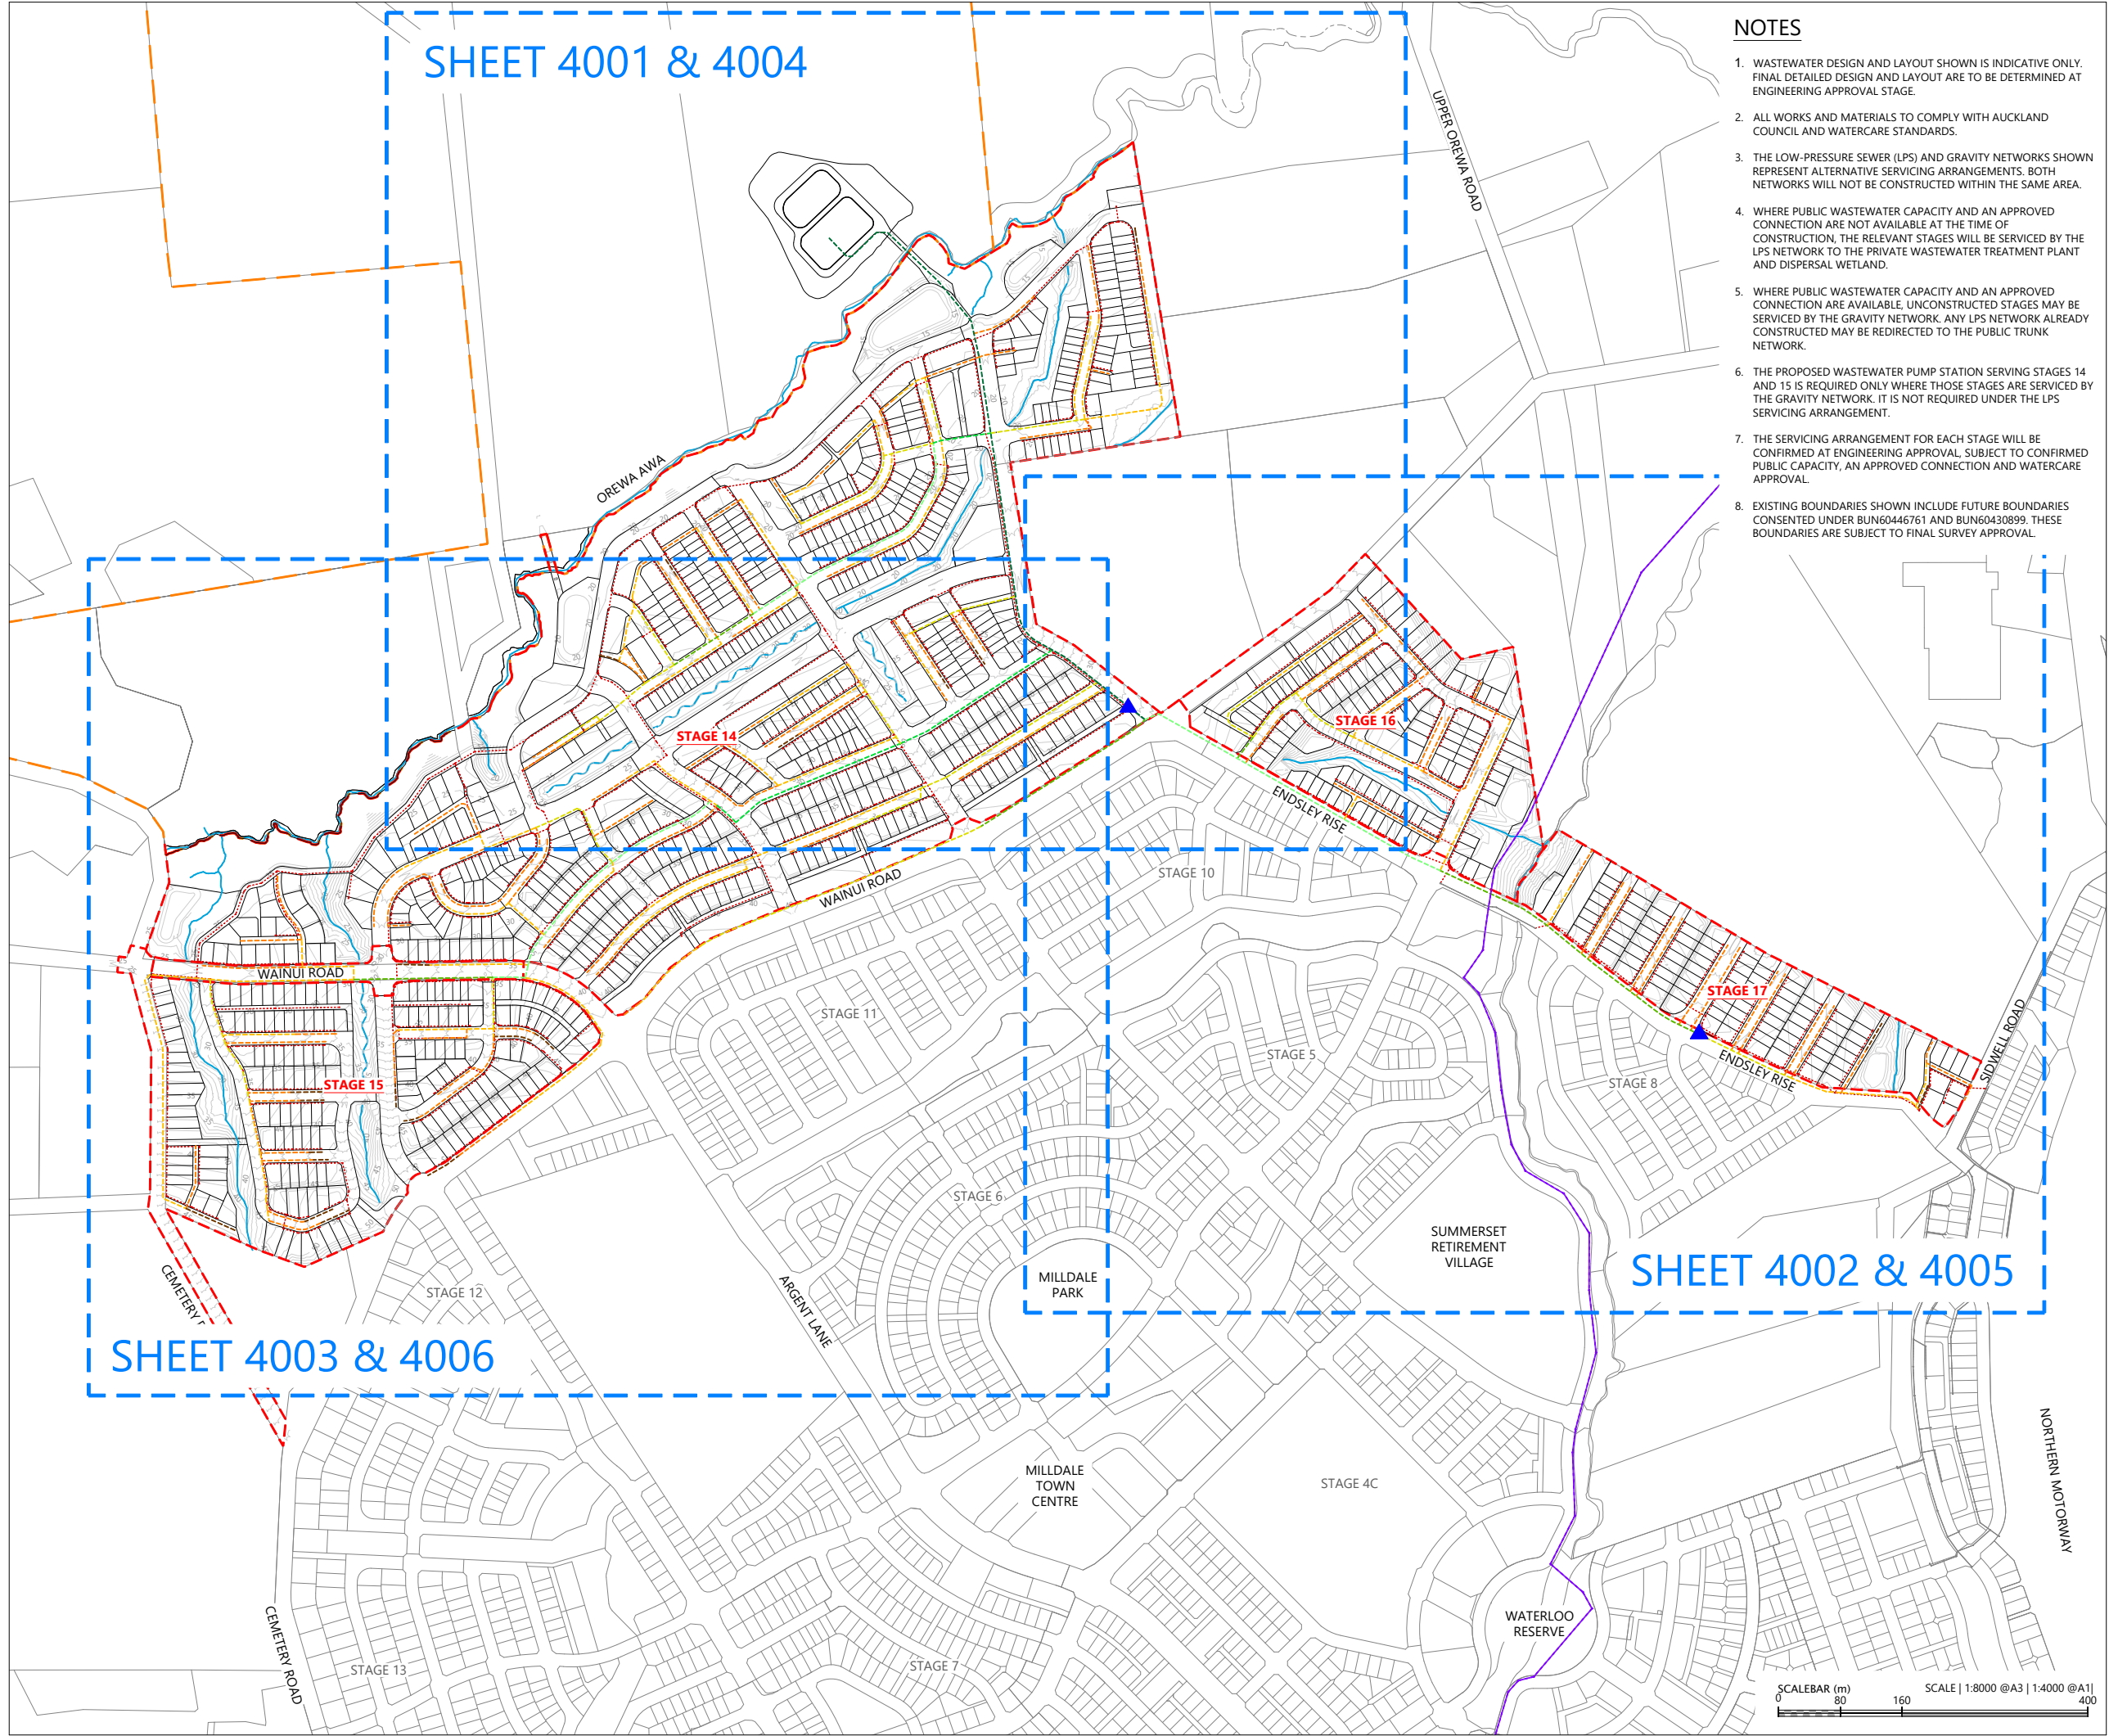

- NOTES
1. WASTEWATER DESIGN AND LAYOUT SHOWN IS INDICATIVE ONLY. FINAL DETAILED DESIGN AND LAYOUT ARE TO BE DETERMINED AT ENGINEERING APPROVAL STAGE.

2. ALL WORKS AND MATERIALS TO COMPLY WITH AUCKLAND COUNCIL AND WATERCARE STANDARDS.

3. THE LOW-PRESSURE SEWER (LPS) AND GRAVITY NETWORKS SHOWN REPRESENT ALTERNATIVE SERVICING ARRANGEMENTS. BOTH NETWORKS WILL NOT BE CONSTRUCTED WITHIN THE SAME AREA.

4. WHERE PUBLIC WASTEWATER CAPACITY AND AN APPROVED CONNECTION ARE NOT AVAILABLE AT THE TIME OF CONSTRUCTION, THE RELEVANT STAGES WILL BE SERVICED BY THE LPS NETWORK TO THE PRIVATE WASTEWATER TREATMENT PLANT AND DISPERSAL WETLAND.

5. WHERE PUBLIC WASTEWATER CAPACITY AND AN APPROVED CONNECTION ARE AVAILABLE, UNCONSTRUCTED STAGES MAY BE SERVICED BY THE GRAVITY NETWORK. ANY LPS NETWORK ALREADY CONSTRUCTED MAY BE REDIRECTED TO THE PUBLIC TRUNK NETWORK.

6. THE PROPOSED WASTEWATER PUMP STATION SERVING STAGES 14 AND 15 IS REQUIRED ONLY WHERE THOSE STAGES ARE SERVICED BY THE GRAVITY NETWORK. IT IS NOT REQUIRED UNDER THE LPS SERVICING ARRANGEMENT.

7. THE SERVICING ARRANGEMENT FOR EACH STAGE WILL BE CONFIRMED AT ENGINEERING APPROVAL, SUBJECT TO CONFIRMED PUBLIC CAPACITY, AN APPROVED CONNECTION AND WATERCARE APPROVAL.

8. EXISTING BOUNDARIES SHOWN INCLUDE FUTURE BOUNDARIES CONSENTED UNDER BUN60446761 AND BUN60430899. THESE BOUNDARIES ARE SUBJECT TO FINAL SURVEY APPROVAL.

LEGEND

EXTENTS OF MILLDALE STAGES 14-17 DEVELOPMENT AREA

EXTENTS OF TE KOROWAI O MARAEARIKI

PROPOSED BOUNDARIES

EXISTING BOUNDARIES

DESIGN CONTOURS (1.00m INTERVAL)

POST-DEVELOPMENT WATERCOURSE

PROPOSED WASTEWATER 50mm

PROPOSED WASTEWATER 63mm

PROPOSED WASTEWATER 75mm

PROPOSED WASTEWATER 90mm

PROPOSED WASTEWATER 110mm

PROPOSED WASTEWATER 125mm

PROPOSED WASTEWATER 140mm

PROPOSED WASTEWATER 180mm

PROPOSED GRAVITY WASTEWATER PIPE

EXISTING GRAVITY WASTEWATER PIPE

EXISTING WASTEWATER TRANSMISSION PIPE

REVISION DETAILS		BY	DATE
1	ISSUED FOR CONSENT	SK	AUG 2026

SURVEYED	WOODS	WAINUI ROAD MILLDALE AUCKLAND
DESIGNED	WOODS	
DRAWN	DH	
CHECKED	SK	
APPROVED	JW	
		WOODS.CO.NZ

N



MILLDALE
Connecting Lives

MILLDALE
STAGES 14-17
FAST-TRACK

PHASE 1: WASTEWATER NETWORK
OVERALL LAYOUT PLAN

STATUS	ISSUED FOR CONSENT	REV
SCALE	1:8000 @ A3	1
COUNCIL	AUCKLAND COUNCIL	
DWG NO	P25-609-01-4000-DR	



File: C:\1205\DATA\WP-AKL-APP-02\P25-609 - MILLDALE NORTH FAST-TRACK APPLICATION_23695\02 DRAWINGS\01 ENG\01 PHASE 1 - DEVELOPMENT AREA\P25-609-01-4000-WW-WASTEWATER DRAINAGE LAYOUT PLANDWG

NOTES

- 1. WASTEWATER DESIGN AND LAYOUT SHOWN IS INDICATIVE ONLY. FINAL DETAILED DESIGN AND LAYOUT ARE TO BE DETERMINED AT ENGINEERING APPROVAL STAGE.
- 2. ALL WORKS AND MATERIALS TO COMPLY WITH AUCKLAND COUNCIL AND WATERCARE STANDARDS.
- 3. THE LOW-PRESSURE SEWER (LPS) AND GRAVITY NETWORKS SHOWN REPRESENT ALTERNATIVE SERVICING ARRANGEMENTS. BOTH NETWORKS WILL NOT BE CONSTRUCTED WITHIN THE SAME AREA.
- 4. WHERE PUBLIC WASTEWATER CAPACITY AND AN APPROVED CONNECTION ARE NOT AVAILABLE AT THE TIME OF CONSTRUCTION, THE RELEVANT STAGES WILL BE SERVICED BY THE LPS NETWORK TO THE PRIVATE WASTEWATER TREATMENT PLANT AND DISPERSAL WETLAND.
- 5. WHERE PUBLIC WASTEWATER CAPACITY AND AN APPROVED CONNECTION ARE AVAILABLE, UNCONSTRUCTED STAGES MAY BE SERVICED BY THE GRAVITY NETWORK. ANY LPS NETWORK ALREADY CONSTRUCTED MAY BE REDIRECTED TO THE PUBLIC TRUNK NETWORK.
- 6. THE PROPOSED WASTEWATER PUMP STATION SERVING STAGES 14 AND 15 IS REQUIRED ONLY WHERE THOSE STAGES ARE SERVICED BY THE GRAVITY NETWORK. IT IS NOT REQUIRED UNDER THE LPS SERVICING ARRANGEMENT.
- 7. THE SERVICING ARRANGEMENT FOR EACH STAGE WILL BE CONFIRMED AT ENGINEERING APPROVAL, SUBJECT TO CONFIRMED PUBLIC CAPACITY, AN APPROVED CONNECTION AND WATERCARE APPROVAL.
- 8. EXISTING BOUNDARIES SHOWN INCLUDE FUTURE BOUNDARIES CONSENTED UNDER BUN60446761 AND BUN60430899. THESE BOUNDARIES ARE SUBJECT TO FINAL SURVEY APPROVAL.

REFER TO THE P25-609-02
DRAWING SERIES FOR FURTHER
INFORMATION RELATING TO
THE PRIVATE WASTEWATER
TREATMENT PLANT

POTENTIAL FUTURE WASTEWATER
TREATMENT PLANT (TO PUMP FLOWS
TO THE EXISTING TRANSMISSION
LINE, SHOULD PUBLIC CAPACITY
BECOME AVAILABLE)

PROPOSED AIR VALVE
AT LOCAL HIGH POINT

LEGEND

- EXTENTS OF MILLDALE STAGES 14-17 DEVELOPMENT AREA
- EXTENTS OF TE KOROWAI O MARAEARIKI
- PROPOSED BOUNDARIES
- EXISTING BOUNDARIES
- DESIGN CONTOURS (1.00m INTERVAL)
- POST-DEVELOPMENT WATERCOURSE
- PROPOSED WASTEWATER 50mm
- PROPOSED WASTEWATER 63mm
- PROPOSED WASTEWATER 75mm
- PROPOSED WASTEWATER 90mm
- PROPOSED WASTEWATER 110mm
- PROPOSED WASTEWATER 125mm
- PROPOSED WASTEWATER 140mm
- PROPOSED WASTEWATER 180mm
- EXISTING GRAVITY WASTEWATER PIPE
- EXISTING WASTEWATER TRANSMISSION PIPE

REVISION DETAILS		BY	DATE
1	ISSUED FOR CONSENT	SK	AUG 2026

SURVEYED	WOODS	WAINUI ROAD MILLDALE AUCKLAND
DESIGNED	WOODS	
DRAWN	DH	
CHECKED	SK	
APPROVED	JW	
		WOODS.CO.NZ

MILLDALE
STAGES 14-17
FAST-TRACK

PHASE 1: LOW PRESSURE SEWER
NETWORK LAYOUT PLAN - SHEET 1

STATUS	ISSUED FOR CONSENT	REV
SCALE	1:4000 @ A3	1
COUNCIL	AUCKLAND COUNCIL	
DWG NO	P25-609-01-4001-DR	

File: C:\1205\DATA\WP-AKL-APP-02\P25-609 - MILLDALE NORTH FAST-TRACK APPLICATION_22695\02 DRAWINGS\01 ENG\01 PHASE 1 - DEVELOPMENT AREA\P25-609-01-4000-WW-WASTEWATER DRAINAGE LAYOUT PLANDWG

NOTES

1.

WASTEWATER DESIGN AND LAYOUT SHOWN IS INDICATIVE ONLY. FINAL DETAILED DESIGN AND LAYOUT ARE TO BE DETERMINED AT ENGINEERING APPROVAL STAGE.
2.

ALL WORKS AND MATERIALS TO COMPLY WITH AUCKLAND COUNCIL AND WATERCARE STANDARDS.
3.

THE LOW-PRESSURE SEWER (LPS) AND GRAVITY NETWORKS SHOWN REPRESENT ALTERNATIVE SERVICING ARRANGEMENTS. BOTH NETWORKS WILL NOT BE CONSTRUCTED WITHIN THE SAME AREA.
4.

WHERE PUBLIC WASTEWATER CAPACITY AND AN APPROVED CONNECTION ARE NOT AVAILABLE AT THE TIME OF CONSTRUCTION, THE RELEVANT STAGES WILL BE SERVICED BY THE LPS NETWORK TO THE PRIVATE WASTEWATER TREATMENT PLANT AND DISPERSAL WETLAND.
5.

WHERE PUBLIC WASTEWATER CAPACITY AND AN APPROVED CONNECTION ARE AVAILABLE, UNCONSTRUCTED STAGES MAY BE SERVICED BY THE GRAVITY NETWORK. ANY LPS NETWORK ALREADY CONSTRUCTED MAY BE REDIRECTED TO THE PUBLIC TRUNK NETWORK.
6.

THE PROPOSED WASTEWATER PUMP STATION SERVING STAGES 14 AND 15 IS REQUIRED ONLY WHERE THOSE STAGES ARE SERVICED BY THE GRAVITY NETWORK. IT IS NOT REQUIRED UNDER THE LPS SERVICING ARRANGEMENT.
7.

THE SERVICING ARRANGEMENT FOR EACH STAGE WILL BE CONFIRMED AT ENGINEERING APPROVAL, SUBJECT TO CONFIRMED PUBLIC CAPACITY, AN APPROVED CONNECTION AND WATERCARE APPROVAL.
8.

EXISTING BOUNDARIES SHOWN INCLUDE FUTURE BOUNDARIES CONSENTED UNDER BUN60446761 AND BUN60430899. THESE BOUNDARIES ARE SUBJECT TO FINAL SURVEY APPROVAL.

LEGEND

- EXTENTS OF MILLDALE STAGES 14-17 DEVELOPMENT AREA


- EXTENTS OF TE KOROWAI O MARAEARIKI


- PROPOSED BOUNDARIES


- EXISTING BOUNDARIES


- DESIGN CONTOURS (1.00m INTERVAL)


- POST-DEVELOPMENT WATERCOURSE


- PROPOSED WASTEWATER 50mm


- PROPOSED WASTEWATER 63mm


- PROPOSED WASTEWATER 75mm


- PROPOSED WASTEWATER 90mm


- PROPOSED WASTEWATER 110mm


- PROPOSED WASTEWATER 125mm


- PROPOSED WASTEWATER 140mm


- PROPOSED WASTEWATER 180mm


- EXISTING GRAVITY WASTEWATER PIPE


- EXISTING WASTEWATER TRANSMISSION PIPE



REVISION DETAILS		BY	DATE
1	ISSUED FOR CONSENT	SK	AUG 2026

SURVEYED	WOODS	WAINUI ROAD MILLDALE AUCKLAND
DESIGNED	WOODS	
DRAWN	DH	
CHECKED	SK	
APPROVED	JW	
		WOODS.CO.NZ



MILLDALE
STAGES 14-17
FAST-TRACK

PHASE 1: LOW PRESSURE SEWER
NETWORK LAYOUT PLAN - SHEET 2

STATUS	ISSUED FOR CONSENT	REV
SCALE	1:4000 @ A3	1
COUNCIL	AUCKLAND COUNCIL	
DWG NO	P25-609-01-4002-DR	

File: C:\1205\DATA\WP-AKL-APP-02\P25-609 - MILLDALE NORTH FAST-TRACK APPLICATION_22695\02 DRAWINGS\01 ENG\01 PHASE 1 - DEVELOPMENT AREA\P25-609-01-4000-WW-WASTEWATER DRAINAGE LAYOUT PLANDWG

LEGEND

EXTENTS OF MILLDALE STAGES 14-17 DEVELOPMENT AREA	
EXTENTS OF TE KOROWAI O MARAEARIKI	
PROPOSED BOUNDARIES	
EXISTING BOUNDARIES	
DESIGN CONTOURS (1.00m INTERVAL)	
POST-DEVELOPMENT WATERCOURSE	
PROPOSED WASTEWATER 50mm	
PROPOSED WASTEWATER 63mm	
PROPOSED WASTEWATER 75mm	
PROPOSED WASTEWATER 90mm	
PROPOSED WASTEWATER 110mm	
PROPOSED WASTEWATER 125mm	
PROPOSED WASTEWATER 140mm	
PROPOSED WASTEWATER 180mm	
EXISTING GRAVITY WASTEWATER PIPE	
EXISTING WASTEWATER TRANSMISSION PIPE	

REVISION DETAILS	BY	DATE
1 ISSUED FOR CONSENT	SK	AUG 2026

SURVEYED	WOODS	WAINUI ROAD MILLDALE AUCKLAND
DESIGNED	WOODS	
DRAWN	DH	
CHECKED	SK	
APPROVED	JW	
		WOODS.CO.NZ

MILLDALE
STAGES 14-17
FAST-TRACK

PHASE 1: LOW PRESSURE SEWER
NETWORK LAYOUT PLAN - SHEET 3

STATUS	ISSUED FOR CONSENT	REV
SCALE	1:4000 @ A3	1
COUNCIL	AUCKLAND COUNCIL	
DWG NO	P25-609-01-4003-DR	

NOTES

- WASTEWATER DESIGN AND LAYOUT SHOWN IS INDICATIVE ONLY. FINAL DETAILED DESIGN AND LAYOUT ARE TO BE DETERMINED AT ENGINEERING APPROVAL STAGE.
- ALL WORKS AND MATERIALS TO COMPLY WITH AUCKLAND COUNCIL AND WATERCARE STANDARDS.
- THE LOW-PRESSURE SEWER (LPS) AND GRAVITY NETWORKS SHOWN REPRESENT ALTERNATIVE SERVICING ARRANGEMENTS. BOTH NETWORKS WILL NOT BE CONSTRUCTED WITHIN THE SAME AREA.
- WHERE PUBLIC WASTEWATER CAPACITY AND AN APPROVED CONNECTION ARE NOT AVAILABLE AT THE TIME OF CONSTRUCTION, THE RELEVANT STAGES WILL BE SERVICED BY THE LPS NETWORK TO THE PRIVATE WASTEWATER TREATMENT PLANT AND DISPERSAL WETLAND.
- WHERE PUBLIC WASTEWATER CAPACITY AND AN APPROVED CONNECTION ARE NOT AVAILABLE, UNCONSTRUCTED STAGES MAY BE SERVICED BY THE GRAVITY NETWORK. ANY LPS NETWORK ALREADY CONSTRUCTED MAY BE REDIRECTED TO THE PUBLIC TRUNK NETWORK.
- THE PROPOSED WASTEWATER PUMP STATION SERVING STAGES 14 AND 15 IS REQUIRED ONLY WHERE THOSE STAGES ARE SERVICED BY THE GRAVITY NETWORK. IT IS NOT REQUIRED UNDER THE LPS SERVICING ARRANGEMENT.
- THE SERVICING ARRANGEMENT FOR EACH STAGE WILL BE CONFIRMED AT ENGINEERING APPROVAL, SUBJECT TO CONFIRMED PUBLIC CAPACITY, AN APPROVED CONNECTION AND WATERCARE APPROVAL.
- EXISTING BOUNDARIES SHOWN INCLUDE FUTURE BOUNDARIES CONSENTED UNDER BUN60446761 AND BUN60430899. THESE BOUNDARIES ARE SUBJECT TO FINAL SURVEY APPROVAL.



NOTES

- 1. WASTEWATER DESIGN AND LAYOUT SHOWN IS INDICATIVE ONLY. FINAL DETAILED DESIGN AND LAYOUT ARE TO BE DETERMINED AT ENGINEERING APPROVAL STAGE.
- 2. ALL WORKS AND MATERIALS TO COMPLY WITH AUCKLAND COUNCIL AND WATERCARE STANDARDS.
- 3. THE LOW-PRESSURE SEWER (LPS) AND GRAVITY NETWORKS SHOWN REPRESENT ALTERNATIVE SERVICING ARRANGEMENTS. BOTH NETWORKS WILL NOT BE CONSTRUCTED WITHIN THE SAME AREA.
- 4. WHERE PUBLIC WASTEWATER CAPACITY AND AN APPROVED CONNECTION ARE NOT AVAILABLE AT THE TIME OF CONSTRUCTION, THE RELEVANT STAGES WILL BE SERVICED BY THE LPS NETWORK TO THE PRIVATE WASTEWATER TREATMENT PLANT AND DISPERSAL WETLAND.
- 5. WHERE PUBLIC WASTEWATER CAPACITY AND AN APPROVED CONNECTION ARE AVAILABLE, UNCONSTRUCTED STAGES MAY BE SERVICED BY THE GRAVITY NETWORK. ANY LPS NETWORK ALREADY CONSTRUCTED MAY BE REDIRECTED TO THE PUBLIC TRUNK NETWORK.
- 6. THE PROPOSED WASTEWATER PUMP STATION SERVING STAGES 14 AND 15 IS REQUIRED ONLY WHERE THOSE STAGES ARE SERVICED BY THE GRAVITY NETWORK. IT IS NOT REQUIRED UNDER THE LPS SERVICING ARRANGEMENT.
- 7. THE SERVICING ARRANGEMENT FOR EACH STAGE WILL BE CONFIRMED AT ENGINEERING APPROVAL, SUBJECT TO CONFIRMED PUBLIC CAPACITY, AN APPROVED CONNECTION AND WATERCARE APPROVAL.
- 8. EXISTING BOUNDARIES SHOWN INCLUDE FUTURE BOUNDARIES CONSENTED UNDER BUN60446761 AND BUN60430899. THESE BOUNDARIES ARE SUBJECT TO FINAL SURVEY APPROVAL.

REFER TO THE P25-609-02
DRAWING SERIES FOR FURTHER
INFORMATION RELATING TO
THE PRIVATE WASTEWATER
TREATMENT PLANT

POTENTIAL FUTURE WASTEWATER
TREATMENT PLANT (TO PUMP FLOWS
TO THE EXISTING TRANSMISSION
LINE, SHOULD PUBLIC CAPACITY
BECOME AVAILABLE)

LEGEND

- EXTENTS OF MILLDALE STAGES 14-17 DEVELOPMENT AREA
- EXTENTS OF TE KOROWAI O MARAEARIKI
- PROPOSED BOUNDARIES
- EXISTING BOUNDARIES
- DESIGN CONTOURS (1.00m INTERVAL)
- POST-DEVELOPMENT WATERCOURSE
- PROPOSED GRAVITY WASTEWATER PIPE
- EXISTING GRAVITY WASTEWATER PIPE
- EXISTING WASTEWATER TRANSMISSION PIPE

REVISION DETAILS		BY	DATE
1	ISSUED FOR CONSENT	SK	AUG 2026

SURVEYED	WOODS	WAINUI ROAD MILLDALE AUCKLAND
DESIGNED	WOODS	
DRAWN	DH	
CHECKED	SK	
APPROVED	JW	
		WOODS.CO.NZ

MILLDALE
STAGES 14-17
FAST-TRACK

PHASE 1: WASTEWATER GRAVITY
NETWORK LAYOUT PLAN - SHEET 1

STATUS	ISSUED FOR CONSENT	REV
SCALE	1:4000 @ A3	1
COUNCIL	AUCKLAND COUNCIL	
DWG NO	P25-609-01-4004-DR	

File: C:\1205\DATA\WP-AKL-APP-02\P25-609 - MILLDALE NORTH FAST-TRACK APPLICATION_22695\02 DRAWINGS\01 ENG\01 PHASE 1 - DEVELOPMENT AREA\P25-609-01-4000-WW-WASTEWATER DRAINAGE LAYOUT PLAN.DWG

NOTES

1.

WASTEWATER DESIGN AND LAYOUT SHOWN IS INDICATIVE ONLY. FINAL DETAILED DESIGN AND LAYOUT ARE TO BE DETERMINED AT ENGINEERING APPROVAL STAGE.
2.

ALL WORKS AND MATERIALS TO COMPLY WITH AUCKLAND COUNCIL AND WATERCARE STANDARDS.
3.

THE LOW-PRESSURE SEWER (LPS) AND GRAVITY NETWORKS SHOWN REPRESENT ALTERNATIVE SERVICING ARRANGEMENTS. BOTH NETWORKS WILL NOT BE CONSTRUCTED WITHIN THE SAME AREA.
4.

WHERE PUBLIC WASTEWATER CAPACITY AND AN APPROVED CONNECTION ARE NOT AVAILABLE AT THE TIME OF CONSTRUCTION, THE RELEVANT STAGES WILL BE SERVICED BY THE LPS NETWORK TO THE PRIVATE WASTEWATER TREATMENT PLANT AND DISPERSAL WETLAND.
5.

WHERE PUBLIC WASTEWATER CAPACITY AND AN APPROVED CONNECTION ARE AVAILABLE, UNCONSTRUCTED STAGES MAY BE SERVICED BY THE GRAVITY NETWORK. ANY LPS NETWORK ALREADY CONSTRUCTED MAY BE REDIRECTED TO THE PUBLIC TRUNK NETWORK.
6.

THE PROPOSED WASTEWATER PUMP STATION SERVING STAGES 14 AND 15 IS REQUIRED ONLY WHERE THOSE STAGES ARE SERVICED BY THE GRAVITY NETWORK. IT IS NOT REQUIRED UNDER THE LPS SERVICING ARRANGEMENT.
7.

THE SERVICING ARRANGEMENT FOR EACH STAGE WILL BE CONFIRMED AT ENGINEERING APPROVAL, SUBJECT TO CONFIRMED PUBLIC CAPACITY, AN APPROVED CONNECTION AND WATERCARE APPROVAL.
8.

EXISTING BOUNDARIES SHOWN INCLUDE FUTURE BOUNDARIES CONSENTED UNDER BUN60446761 AND BUN60430899. THESE BOUNDARIES ARE SUBJECT TO FINAL SURVEY APPROVAL.

LEGEND

- EXTENTS OF MILLDALE STAGES 14-17 DEVELOPMENT AREA


- EXTENTS OF TE KOROWAI O MARAEARIKI


- PROPOSED BOUNDARIES


- EXISTING BOUNDARIES


- DESIGN CONTOURS (1.00m INTERVAL)


- POST-DEVELOPMENT WATERCOURSE


- PROPOSED GRAVITY WASTEWATER PIPE


- EXISTING GRAVITY WASTEWATER PIPE


- EXISTING WASTEWATER TRANSMISSION PIPE



REVISION DETAILS		BY	DATE
1	ISSUED FOR CONSENT	SK	AUG 2026

SURVEYED	WOODS	WAINUI ROAD MILLDALE AUCKLAND
DESIGNED	WOODS	
DRAWN	DH	
CHECKED	SK	
APPROVED	JW	
		WOODS.CO.NZ




MILLDALE
STAGES 14-17
FAST-TRACK

PHASE 1: WASTEWATER GRAVITY
NETWORK LAYOUT PLAN - SHEET 2

STATUS	ISSUED FOR CONSENT	REV
SCALE	1:4000 @ A3	1
COUNCIL	AUCKLAND COUNCIL	
DWG NO	P25-609-01-4005-DR	



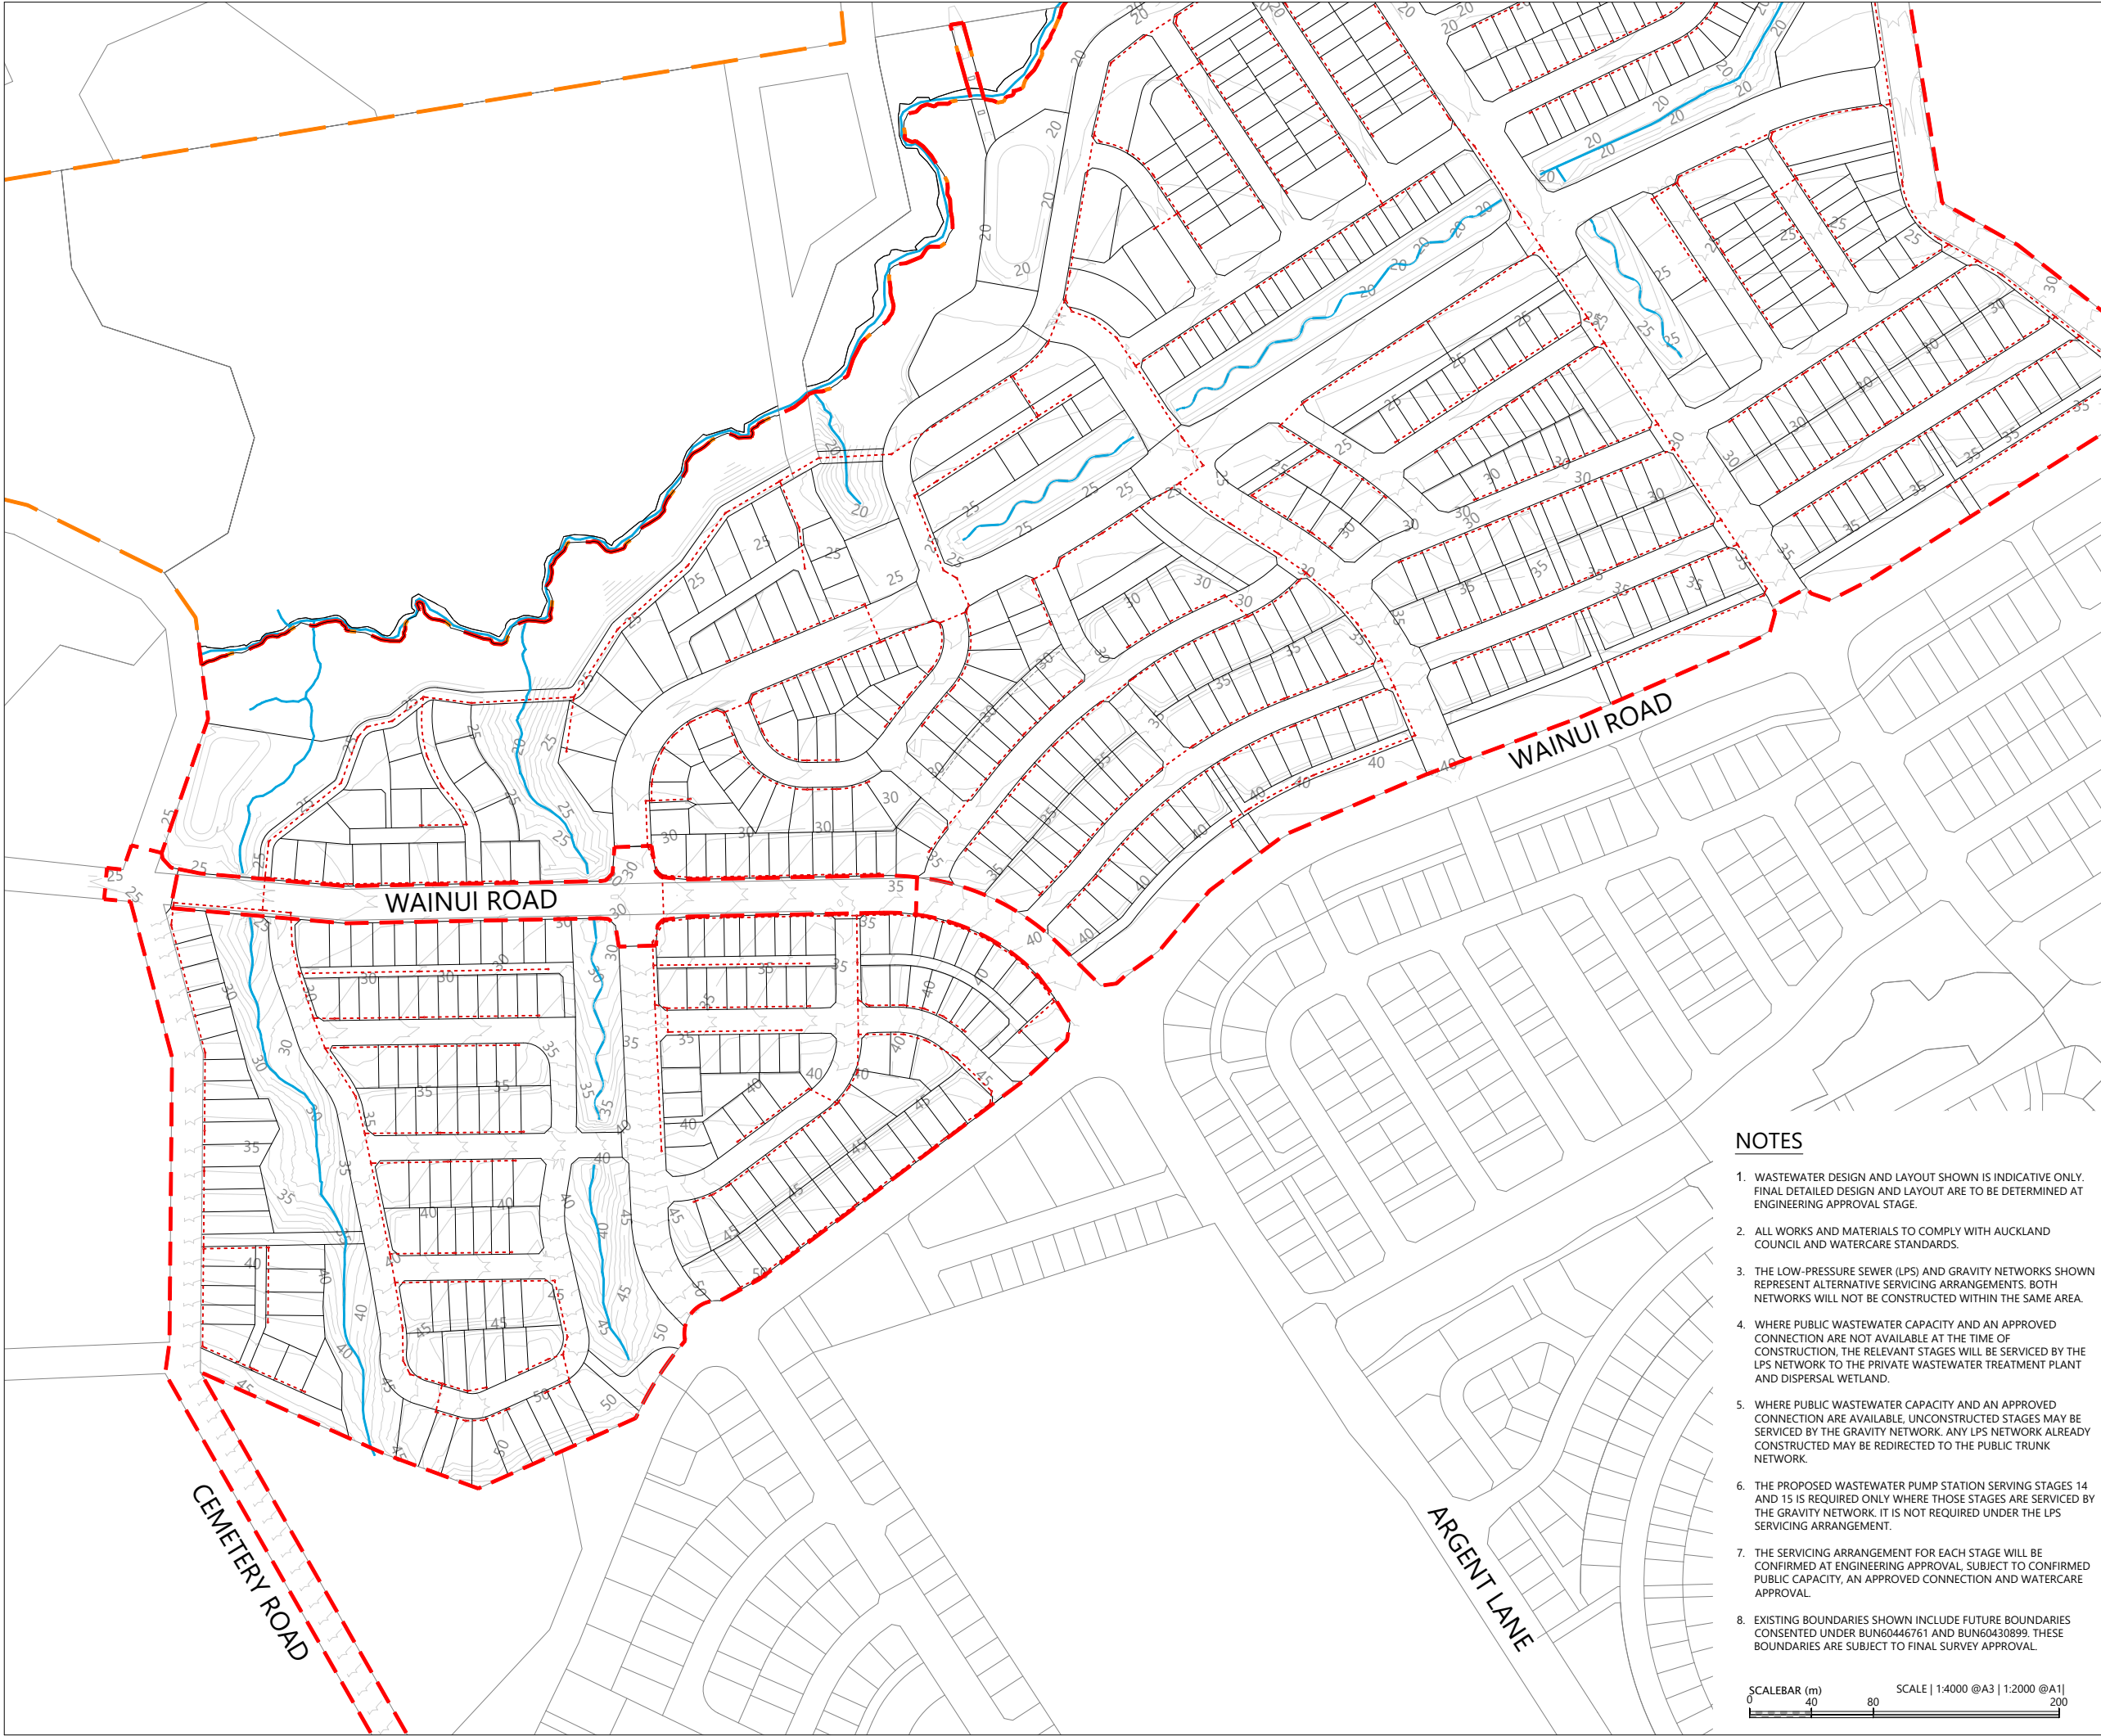

LEGEND

- EXTENTS OF MILLDALE STAGES 14-17 DEVELOPMENT AREA
- EXTENTS OF TE KOROWAI O MARAEARIKI
- PROPOSED BOUNDARIES
- EXISTING BOUNDARIES
- DESIGN CONTOURS (1.00m INTERVAL)
- POST-DEVELOPMENT WATERCOURSE
- PROPOSED GRAVITY WASTEWATER PIPE
- EXISTING GRAVITY WASTEWATER PIPE
- EXISTING WASTEWATER TRANSMISSION PIPE

REVISION DETAILS		BY	DATE
1	ISSUED FOR CONSENT	SK	AUG 2026

SURVEYED	WOODS	WAINUI ROAD MILLDALE AUCKLAND
DESIGNED	WOODS	
DRAWN	DH	
CHECKED	SK	
APPROVED	JW	
		WOODS.CO.NZ

MILLDALE
STAGES 14-17
FAST-TRACK

PHASE 1: WASTEWATER GRAVITY
NETWORK LAYOUT PLAN - SHEET 3

STATUS	ISSUED FOR CONSENT	REV
SCALE	1:4000 @ A3	1
COUNCIL	AUCKLAND COUNCIL	
DWG NO	P25-609-01-4006-DR	

NOTES

- WASTEWATER DESIGN AND LAYOUT SHOWN IS INDICATIVE ONLY. FINAL DETAILED DESIGN AND LAYOUT ARE TO BE DETERMINED AT ENGINEERING APPROVAL STAGE.
- ALL WORKS AND MATERIALS TO COMPLY WITH AUCKLAND COUNCIL AND WATERCARE STANDARDS.
- THE LOW-PRESSURE SEWER (LPS) AND GRAVITY NETWORKS SHOWN REPRESENT ALTERNATIVE SERVICING ARRANGEMENTS. BOTH NETWORKS WILL NOT BE CONSTRUCTED WITHIN THE SAME AREA.
- WHERE PUBLIC WASTEWATER CAPACITY AND AN APPROVED CONNECTION ARE NOT AVAILABLE AT THE TIME OF CONSTRUCTION, THE RELEVANT STAGES WILL BE SERVICED BY THE LPS NETWORK TO THE PRIVATE WASTEWATER TREATMENT PLANT AND DISPERSAL WETLAND.
- WHERE PUBLIC WASTEWATER CAPACITY AND AN APPROVED CONNECTION ARE AVAILABLE, UNCONSTRUCTED STAGES MAY BE SERVICED BY THE GRAVITY NETWORK. ANY LPS NETWORK ALREADY CONSTRUCTED MAY BE REDIRECTED TO THE PUBLIC TRUNK NETWORK.
- THE PROPOSED WASTEWATER PUMP STATION SERVING STAGES 14 AND 15 IS REQUIRED ONLY WHERE THOSE STAGES ARE SERVICED BY THE GRAVITY NETWORK. IT IS NOT REQUIRED UNDER THE LPS SERVICING ARRANGEMENT.
- THE SERVICING ARRANGEMENT FOR EACH STAGE WILL BE CONFIRMED AT ENGINEERING APPROVAL, SUBJECT TO CONFIRMED PUBLIC CAPACITY, AN APPROVED CONNECTION AND WATERCARE APPROVAL.
- EXISTING BOUNDARIES SHOWN INCLUDE FUTURE BOUNDARIES CONSENTED UNDER BUN60446761 AND BUN60430899. THESE BOUNDARIES ARE SUBJECT TO FINAL SURVEY APPROVAL.

